



ETA-Danmark A/S
Göteborg Plads 1
DK-2150 Nordhavn
Tel. +45 72 24 59 00
Fax +45 72 24 59 04
Internet www.etadanmark.dk

Authorised and notified according
to Article 29 of the Regulation (EU)
No 305/2011 of the European
Parliament and of the Council of 9
March 2011

MEMBER OF EOTA



European Technical Assessment ETA-07/0245 of 15/08/2018

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:

SIMPSON STRONG-TIE® Joist End connector
SIMPSON STRONG-TIE® concealed beam hangers

Product family to which the above construction product belongs:

Three-dimensional nailing plate (connector for wood to wood connections and wood to concrete or steel connections)

Manufacturing plant:

SIMPSON STRONG-TIE A/S
Hedegaardsvej 4 – 11, Boulstrup
DK-8300 Odder
Tel. +45 87 81 74 00
Fax +45 87 81 74 09

SIMPSON STRONG-TIE Manufacturing facilities

This European Technical Assessment contains:

123 pages including 4 annexes which form an integral part of the document

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:

Guideline for European Technical Approval (ETAG) No. 015 Three Dimensional Nailing Plates, April 2013, used as European Assessment Document (EAD).

This version replaces:

The ETA with the same number and issued on 2016-08-10

Index

| | | |
|--------------|--|-----|
| II | SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT | 4 |
| 1 | Technical description of product and intended use..... | 4 |
| 2 | Specification of the intended use in accordance with the applicable EAD..... | 4 |
| 3 | Performance of the product and references to the methods used for its assessment..... | 5 |
| 3.1 | Mechanical resistance and stability*) (BWR1) | 5 |
| 3.2 | Safety in case of fire (BWR2) | 5 |
| 3.3 | Hygiene, health and the environment (BWR3) | 5 |
| 3.7 | Sustainable use of natural resources (BWR7) | 5 |
| 3.8 | General aspects related to the performance of the product | 5 |
| 3.9 | Mechanical resistance and stability | 6 |
| 3.10 | Aspects related to the performance of the product | 6 |
| 3.11 | General aspects related to the fitness for use of the product | 6 |
| 4 | Attestation and verification of constancy of performance (AVCP)..... | 7 |
| 4.1 | AVCP system | 7 |
| 5 | Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD | 7 |
| Annex A | Revision History | 8 |
| Annex B | Typical Installation | 10 |
| B.1 | Concealed joist hangers typical installation..... | 10 |
| B.2 | Typical Installation for ETB, EL, ELS | 11 |
| B.3 | Typical Installation of ICS and ICST: | 17 |
| B.4 | Typical installation of ETS/ETSN | 17 |
| B.5 | Typical Installation of ATFN | 21 |
| B.6 | Installation for fire justification | 23 |
| Annex C | Design..... | 27 |
| C.1 | Basis of Design | 27 |
| C.2 | Definition of force directions..... | 29 |
| C.3 | Fastener specification and capacities | 34 |
| Annex D- | Product definition and capacities..... | 36 |
| D1 | Concealed joist hanger BTN, BT4, BTALU, BTx | 36 |
| Figure D1-1: | Dimension drawing of concealed joist hangers | 36 |
| D2 | Concealed joist hanger TU, TUB, TUS, TUBS..... | 74 |
| D3 | Concealed joist hanger ETNM | 83 |
| D4 | Concealed joist hanger BTCx | 86 |
| D5 | ICS | 91 |
| D6 | ETB..... | 94 |
| D7 | EL | 96 |
| D8 | ELS | 99 |
| D9 | CBH..... | 101 |
| D10 | ETS / ETSN | 106 |
| D11 | ICST..... | 110 |
| D12 | Janebo : JHHU, JHDU, JHGU | 112 |
| D13 | ATFN..... | 122 |

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of product and intended use

Technical description of the product

The SIMSPON Strong-Tie Concealed Beam Hangers are three dimensional nailing plates made of pre-galvanized steel Grade S 250 GD + (min. Z 275) according to EN 10346 or stainless steel 1.4401 and 1.4404 according to EN 10088 or a stainless steel with a minimum characteristic yield stress of 235 N/mm² or a minimum ultimate tensile strength of 330 N/mm², or aluminium AlMgSi 0,7 according to DIN 1749-1. The range addressed by this approval consists of various hangers which have in common the necessity to practice a notch and holes in the joist for the dowels path : TU, TUB, TUS, TUBS, ETNM, BTN, BT4, BT, BTC, BTALU, CBH, Janebo-family. They are intended for wood-wood connections and wood-concrete connections with angles varying from 30° to 90°. The geometry and standard dimensions are given in Annexes D.

ETB and ETS connectors are two-piece non-welded, face-fixed connectors to be used in timber to timber connections.

ICS and ICST are two-piece non-welded element-connectors to be used in timber to timber connections.

EL connectors are one-piece non-welded, face-fixed connectors to be used in timber to timber connections as well as connections between a timber joist and a concrete structure or a steel member.

ELS connectors are one-piece non-welded, face-fixed connectors to be used in timber to timber connections.

The connectors are made from aluminium grade EN AW-6082 T6 according to EN 755-2 with minimum yield strength of 250 MPa, a minimum tensile strength of 295 MPa and a minimum ultimate strain of 8%. Dimensions, hole positions and aluminium type are shown in Annex D6 to D8. Typical installations are shown in Annex C.

2 Specification of the intended use in accordance with the applicable EAD

The intended use of the SIMPSON Strong-Tie Concealed Beam Hangers is to establish connections of joists with rectangular cross sections to their support, where requirements for mechanical resistance and stability and safety in use in the sense of the Basic Works Requirements 1 and 4 of Regulation (EU) 305/2011 shall be fulfilled.

The joist may be either of solid sawn or Engineering Wood Product listed in Annex C1.

The support may also be either a solid sawn element, an Engineering Wood Product listed in Annex C1, or concrete. With regard to moisture behaviour of the support and/or joist, the use is possible in service classes 1 and 2 as defined in EN 1995-1-1:2004 for the Concealed Beam Hangers made out of galvanised steel. The use is possible in service class 1, 2 and 3 defined in EN 1995-1-1:2004 for Concealed Beam Hangers made out of stainless steel 1.4401 and 1.4404 according to EN 10088, or another stainless steel as described before in structures subject to internal or external atmospheric exposure (including industrial and marine environment), or exposure in permanently damp internal conditions, if no particular aggressive conditions exist. Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used). A concealed joist hanger produced from steel, which is resistant for these atmospheres, may be used in these areas.

The scope of the connectors regarding resistance to corrosion shall be defined according to national provisions that apply at the installation site considering environmental conditions.

They are not intended to be used in areas where they might support seismic actions. They are supposed to be used with specified fasteners mentioned in Annex C3 and according to fastening combinations and nail patterns given in Annexes B.

The ETB, ETS, EL and EL-S connectors are intended for use in making end-grain to side-grain connections in load bearing timber structures, as a connection between a timber joist and a solid timber or wood based header, where requirements for mechanical resistance and stability and safety in use in the sense of the Basic Works Requirements 1 and 4 of Regulation (EU) 305/2011 shall be fulfilled. The EL connectors are also intended for use in making an end-grain connection between a timber joist and a concrete structure or a steel member.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the connectors of 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

| Characteristic | Assessment of characteristic |
|--|--|
| 3.1 Mechanical resistance and stability*) (BWR1) | |
| Characteristic load-carrying capacity | See Annex D |
| Stiffness | No performance assessed |
| Ductility in cyclic testing | No performance assessed |
| 3.2 Safety in case of fire (BWR2) | |
| Reaction to fire | SIMPSON Strong-Tie Concealed Beam Hangers and Joist End connectors are classified as Euro class A1 in accordance with EN 13501-1 and EC decision 96/603/EC, amended by EC Decision 2000/605/EC |
| 3.3 Hygiene, health and the environment (BWR3) | |
| Influence on air quality | The product does not contain/release dangerous substances specified in TR 034, dated March 2012**) |
| 3.7 Sustainable use of natural resources (BWR7) | |
| | No Performance Determined |
| 3.8 General aspects related to the performance of the product | |
| | The SIMPSON Strong-Tie Concealed Beam Hangers and Joist End connectors have been assessed as having satisfactory durability and serviceability when used in timber structures using the timber species described in Eurocode 5 and subject to the conditions defined by service class 1, 2 and 3 |
| Identification | See Annex A |

*) See additional information in section 3.9 – 3.12.

**) In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.9 Mechanical resistance and stability

See annex D for characteristic load-carrying capacities of the SIMPSON Strong-Tie Concealed Beam Hangers and SIMPSON Strong-Tie Joist End connectors.

The mechanical capacities of the concealed beam hangers and Joist End connectors are determined by calculation assisted by testing as described in the EOTA Guideline 015 clause 5.1.2. They should be used for designs in accordance with EN-1995-1-1 (Eurocode 5) or a similar national timber code.

The load-bearing capacities given in Annexes D of the concealed beam hangers and Joist End connectors have been determined based on the use of connector nails or 4.0 x 60 in accordance to ETA-04/0013 and screws are described in Annex C3. It is allowed to use connector screws or connector nails 4.0 x 50 or 4.2 x 50 or 4.2 x 60 in accordance to ETA-04/0013. Case by case calculations have to be carried out to determine the load-bearing capacity of the connection.

The design also allows the use of threaded nails in accordance to EN 14592 with a diameter in the range 4.0-4.2 mm and a minimum length of 35 mm, assuming a thick steel plate when calculating the lateral nail load-bearing capacity. If no calculations are made a reduction factor equal to the ratio between the characteristic withdrawal capacity of the actual used threaded nail and the characteristic withdrawal capacity of the corresponding connector nail according to table B1 in ETA-04/0013 is applicable for all load-bearing capacities of the connection.

No performance has been determined in relation to ductility of a joint under cyclic testing.

The contribution to the performance of structures in seismic zones, therefore, has not been assessed

3.10 Aspects related to the performance of the product

3.10.1 Corrosion protection in service class 1, 2 and 3.

The thickness of galvanisation (Z275 according to EN 10143) or the aluminium AlMgSi 0,7 is such that a reasonable durability may be expected in service classes 1 and 2 according to EN 1995-1-1:2004, in the conditions stated in 1.1 above. ZM310 can be used as corrosion protection in service class 3 (applicable for all steel thicknesses).

The use of stainless steel 1.4401 and 1.4404 according to EN 10088 extends the scope to service class 3 according to EN 1995-1-1:2004 in the conditions stated in 1.1 above.

The ETB, ETS, EL and EL-S connectors have been assessed as having satisfactory durability and serviceability when used in timber structures using the timber species described in Eurocode 5 and subject to the conditions defined by service class 1 and 2

The ATFN connectors have been assessed as having satisfactory durability and serviceability when used in timber structures using the timber species described in Eurocode 5 and subject to the conditions defined by service class 1

Serviceability of the Concealed Beam Hangers is understood as their ability to resist loads without unacceptable deformations.

3.11 General aspects related to the fitness for use of the product

Concealed Beam Hangers and Joist End connectors are manufactured in accordance with the provisions of this European Technical Assessment using the manufacturing processes as identified in the inspection of the plant by the notified inspection body and laid down in the technical documentation.

SIMPSON Strong-Tie Concealed Beam Hangers and Joist End connectors shall be installed on the basis of a specific structural design for each installation, using the load-bearing capacities given in Annexes D and applying the appropriate k_{mod} factor depending on the relevant service class / load duration and the appropriate National partial safety factor for materials.

The fixing of the Concealed Beam Hangers and Joist End connectors to the support shall use the appropriate nails or screws in case of solid wood or wood-based support, appropriate CE marked metal anchors for use in concrete in case of concrete support. The load bearing capacities indicated in the Annexes are given provided that the fixing device has been appropriately designed and installed.

The Concealed Beam Hangers shall be installed by appropriately qualified personnel, following an installation plan and relevant construction details worked out for each individual building project. The installation plan shall be based on the manufacturers general guide and provisions for installing SIMPSON Strong-Tie connections

4 Attestation and verification of constancy of performance (AVCP)

4.1 AVCP system

According to the decision 97/638/EC of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 2+.

5 Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking

Issued in Copenhagen on 2018-08-15 by



Thomas Bruun
Managing Director, ETA-Danmark

Annex A Revision History

| Revision History | |
|------------------|--|
| Issue | update |
| 3 | <p>TU for force direction axial and lateral</p> <p>Update BTN, BT4, BTALU up to size 240</p> <p>BT280 up to BT600</p> <p>BTC120 up to BTC600</p> <p>Merged with the ETA 07/0245 Joist End connectors ET, ETB, ELS</p> <p>Added the possibility for a slope $< 0^\circ$</p> |
| 4 | Add ETS |
| 5 | BT - Update of the tables 13 to 20 in annex D1 |
| 6 | <p>New definition of force directions</p> <p>BTN, BT4, BTALU, BT - several revisions</p> <p>BTALU – Download with dowels $\varnothing 7$, $\varnothing 8$, $\varnothing 10$ and $\varnothing 12$</p> <p>BTx for Racking</p> <p>BTC - all types added in the tables</p> <p>Fire resistant for concealed beam hangers/hidden connectors - principle</p> <p>TU, TUB, TUS, TUBS - several revisions</p> <p>Addition of new product range Janebo: JHHU, JHDU, JHGU, JHH, JHD</p> <p>Addition of new product: ICST</p> <p>Some more correction / clarifications, update of standards reference</p> |
| 7 | <p>ATF - renamed to ATFN</p> <p>modified depth of holes from 2,8 to 3,1, and d=12 to d=10</p> <p>Change the corrosion protection to Chrome VI free</p> <p>Add the fire rules to get F30 with timber protection</p> <hr/> <p>BTN/BT4/BTALU/BT</p> <p>Update tables for BT acc to modifications made next to mistake identified</p> <p>Table 9 to 12: values corrected</p> <p>Table 33 and 34 values for BTN corrected</p> <p>Table 34 the number of SD's and nails are corrected</p> <hr/> <p>BTC</p> <p>Table D4-3, additional option for timber size b=60mm.</p> <p>added the option for slope connections</p> <hr/> <p>CBH</p> <p>added the types of fastener to header for CBH, table D9-3</p> <p>to added the size CBH105</p> <p>CBH - thickness changed from 3,0 to 2,5mm</p> |

Janebo

correct a typing error in the formula (the index 2 in the box shall be 4)


added the product names/sizes for types without uplift hook

Correction of some typing errors.

to add additional coatings: Z800 and ZM310

Annex B Typical Installation

B.1 Concealed joist hangers typical installation

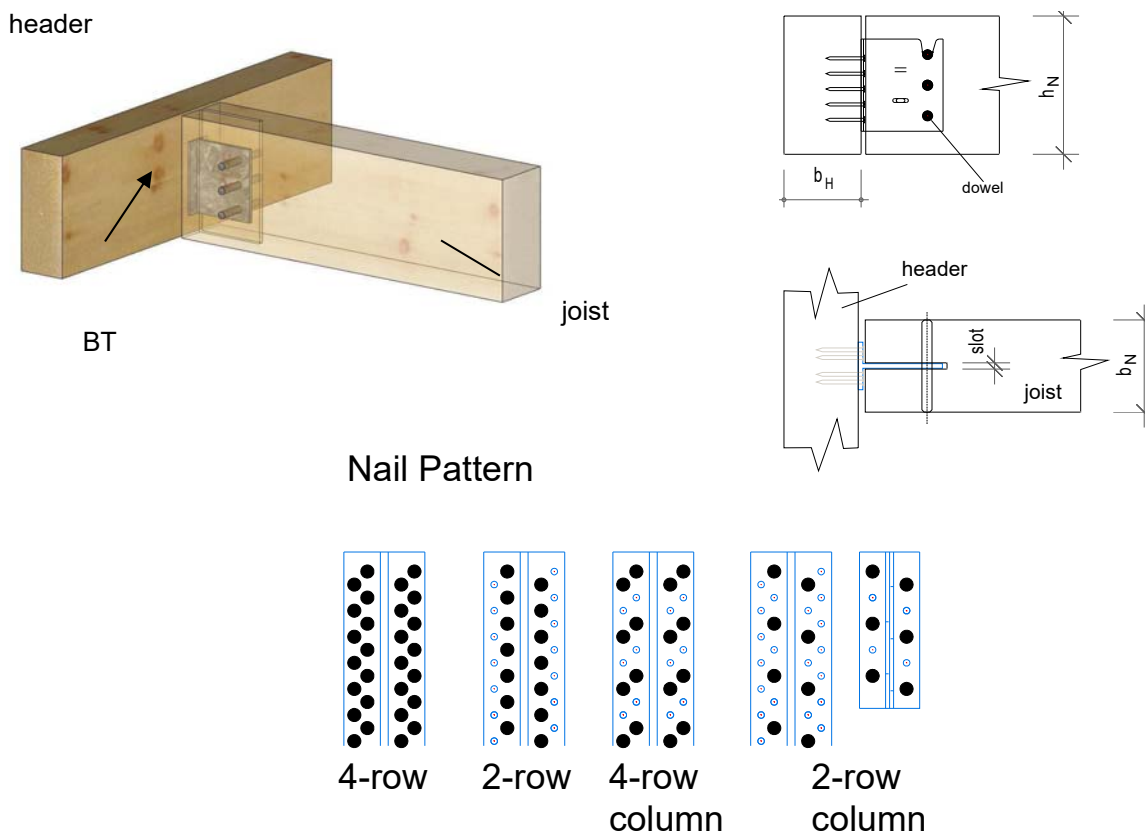

Other nail pattern is described in annex D.


Concealed joist hangers (“BT” in the following text)

A BT connection is deemed fit for its intended use under following conditions:

1. BT can be fastened to wood-based members by nails or screws.
2. There shall be nails or screws in all holes or a partial nailing pattern as shown in Annex A and prescribed in Annex B can be used.
3. The characteristic capacity of the BT connection is calculated according to the manufacturer’s technical documentation.
4. The concealed Joist Hangers connection is designed in accordance with Eurocode 5 or an appropriate National Code.
5. The thickness of the beam shall be at least l , where l is the length of the fasteners in the beam. This is in accordance with Eurocode 5.
6. The depth of the Joist shall be so large that the steel dowel has at least a distance of $3d$ to the edge, where d = the diameter of the steel dowel.
7. The depth of the beam shall be so large that the fasteners have at least a distance according EN 1995-1-1, in relation to the force direction.

8. The slot for the BT in the joist may be $t +1/ +2$ mm , where t = the thickness of the bar of the BT, for the type TU12, TUS12, TUB12 and TUBS12 the slot may be 6 mm, for the other size of type TU, TUS, TUB and TUBS the slot may be 9-10mm
9. For connection to concrete the anchor bolts shall be mounted according to the approval of the used anchor bolt
10. For connection to steel the bolts shall be mounted according the relevant standard
11. The backside of the BT shall have contact along the full height of the connector.
12. BT made from stainless steel shall only be fastened with fasteners made from suitable stainless steel. Zinc-coated concealed joist hangers shall not be fastened with fasteners of stainless steel.
13. Nails or screws to be used shall have a diameter, which fits to the holes of the BTs. They shall have a diameter which is not smaller than the diameter of the hole minus 1 mm.
14. The execution of the connection shall be in accordance with the approval holder's technical literature.

B.2 Typical Installation for ETB, EL, ELS

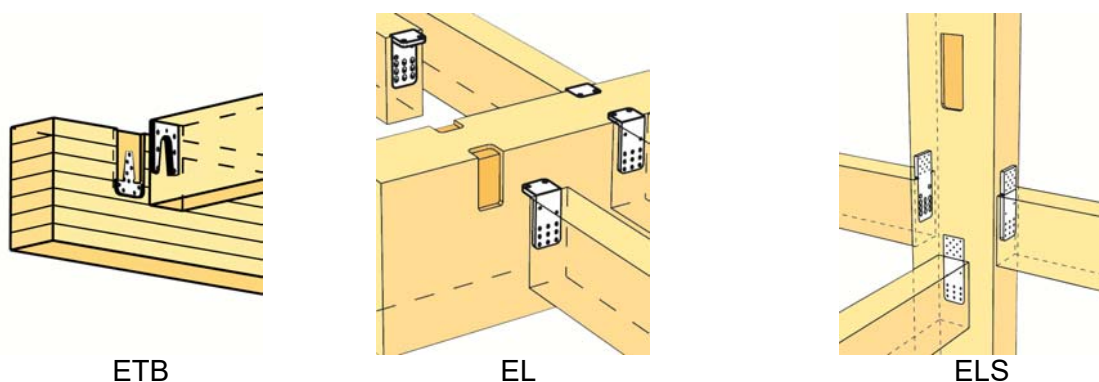

The connection to the header or the column for the ETB and ELS can be made with Nails or CSA screws and screws only for Type EL.

The connection to the end grain of the joist is made with screws $\text{\O}5$ mm according to the corresponding Annex. The angle between the Joist End connector and the screws is 45° . A slope and a skew is possible in these product ranges.


An ETB, EL and EL-S connection is deemed fit for its intended use provided:

1. The header shall be restrained against rotation.
2. If the connection only has a connector on one side of the header, the eccentricity moment from the joists shall be considered when verifying the strength of the header.
3. For a header with joists from both sides but with different reaction forces a similar consideration applies.
4. There shall be nails or screws in all holes or a partial nailing pattern as prescribed in Annex D.
5. For EL connectors fastened to timber frame members as shown in arrangement 1 (see following), only the thread length in the timber member may be taken into account.
6. For EL connectors fastened to timber frame members as shown in arrangement 2 (see following), the sheathing (e.g. OSB) must be flush with the header surface.
7. The gap between the side grain of the header and the vertical flap of the hanger shall be limited. The gap between the side grain of the header and the vertical flap of the connector shall be maximum 3 mm for connections made with the EL connector. For connections made with the ETB and ELS connectors the gap between the member surface and the connector shall be maximum 1 mm.
8. The EL connector shall be in close contact with the concrete or steel over the horizontal flap.
9. For ETB and EL-S connectors the width of the header shall be at least $l+4d$, where l is the length and d is the diameter of the nails or screws in the header.


10. For ETB, EL and EL-S connectors the depth of the joist shall allow an edge distance of at least 10 mm between the screw tip and the adjacent joist surface.
11. The header shall have a plane surface against the whole ETB, EL or EL-S connector.
12. Nails or screws to be used shall have a diameter, which fits the holes of the ETB, EL and EL-S connectors.
13. Minimum end and edge distance for the nails/screws have to be observed according to the standard or, if applicable, according to the relevant assessment of the fastener.

ETB

Section

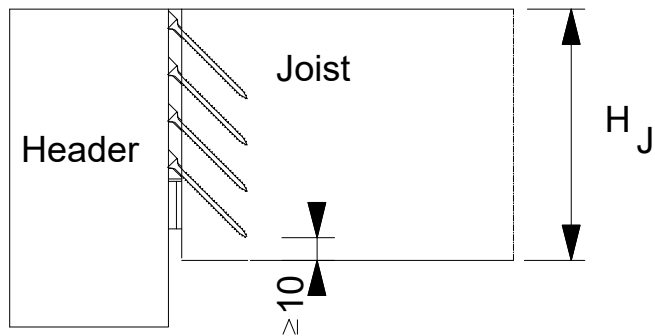


Section

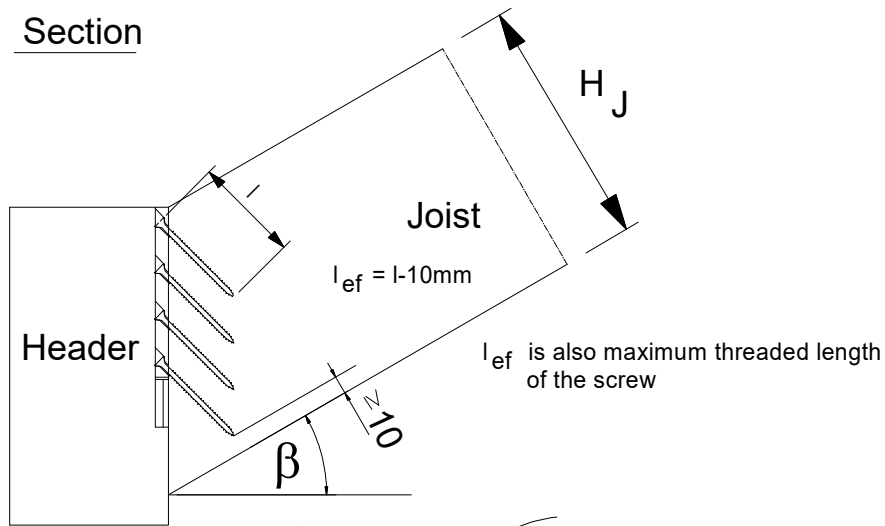

$-15^\circ \leq \beta \leq 90^\circ$ **

For a slope $\beta < 0^\circ$ the angle $\gamma \geq 30^\circ$, in accordance with the approval of the screws, which is used to determine $R_{ax,\alpha,k}$ **




Top View

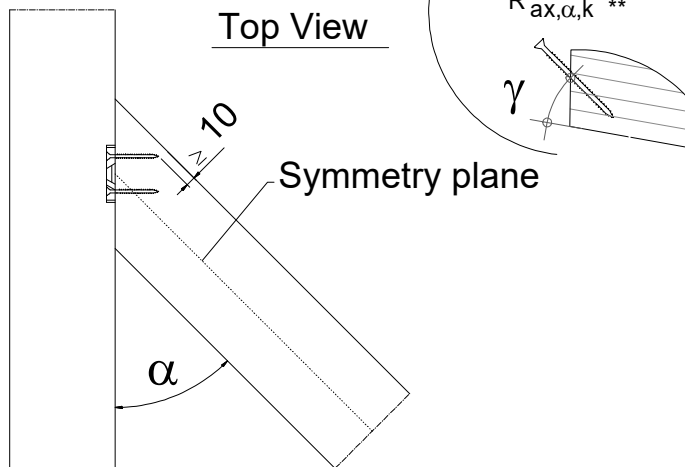

$15^\circ \leq \alpha \leq 165^\circ$

** if $\gamma < 30^\circ$ and the screws are covered by approval for this application, the values for the connector may be evaluated accordingly.


EL

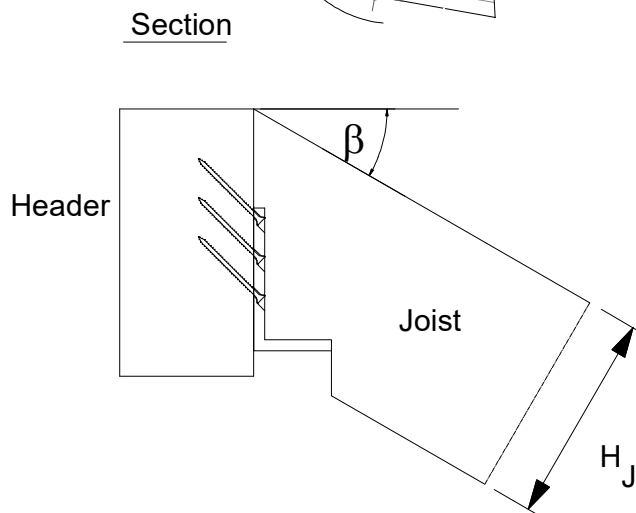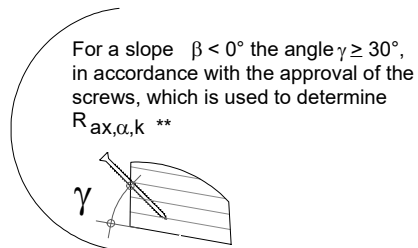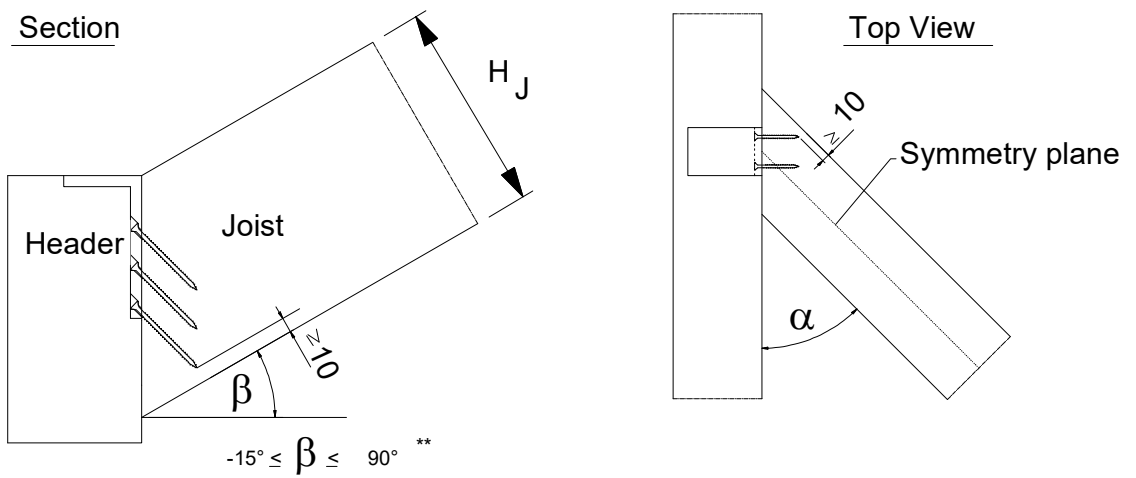



** if $\gamma < 30^\circ$ and the screws are covered by approval for this application, the values for the connector may be evaluated accordingly.

Installations



embed in the header

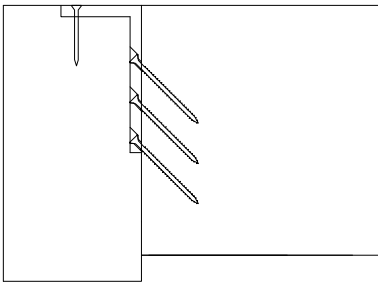


embed in the header and the front of joist

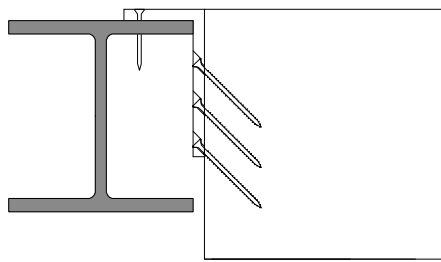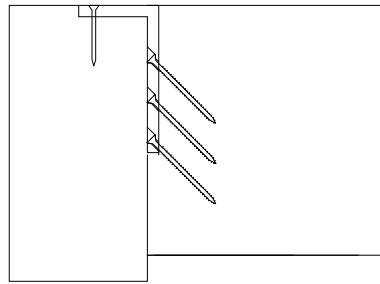


without any embedding

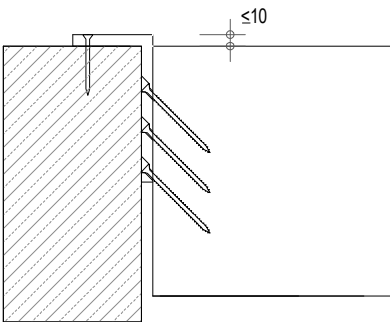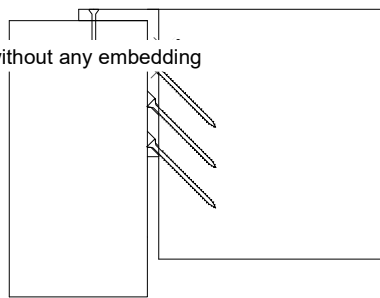

Arrangement 1




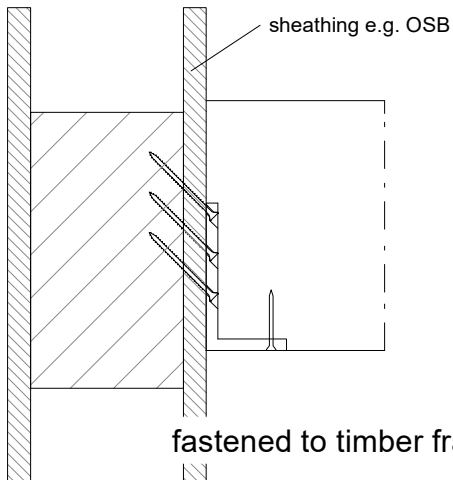


Arrangement 2


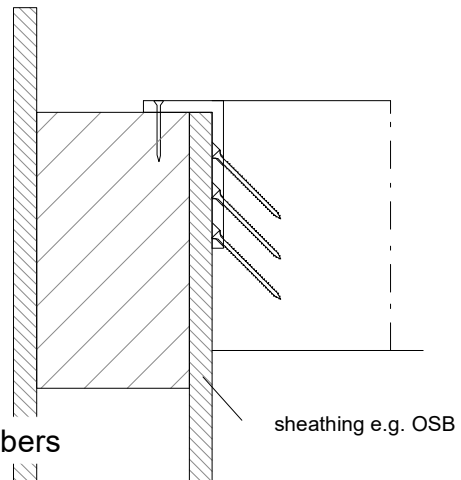


ELS

Section

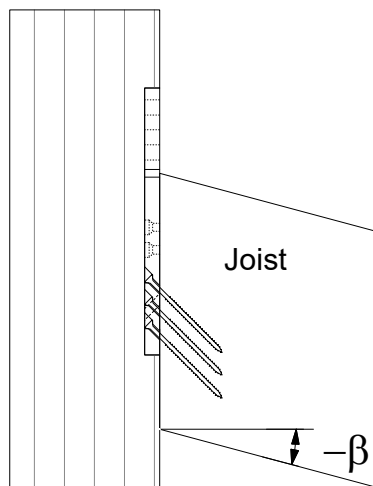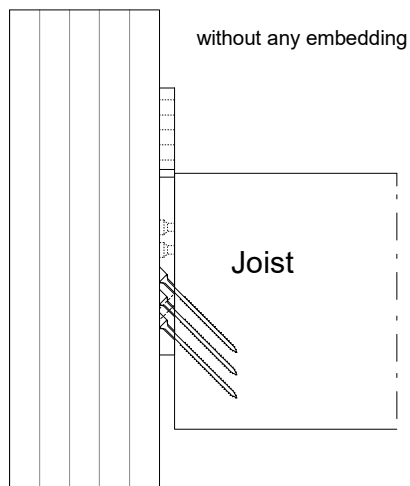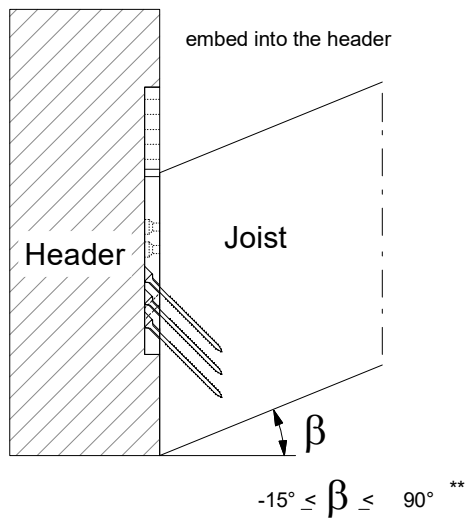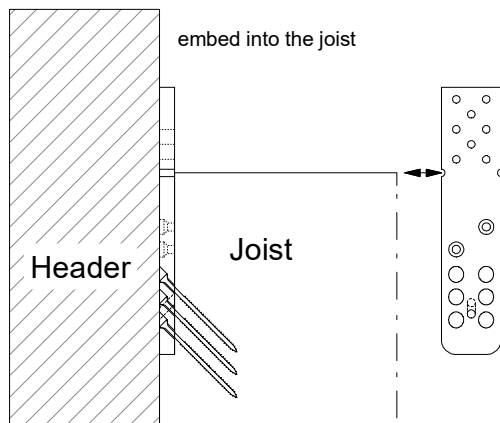

Top-View

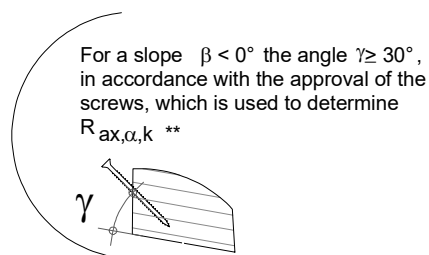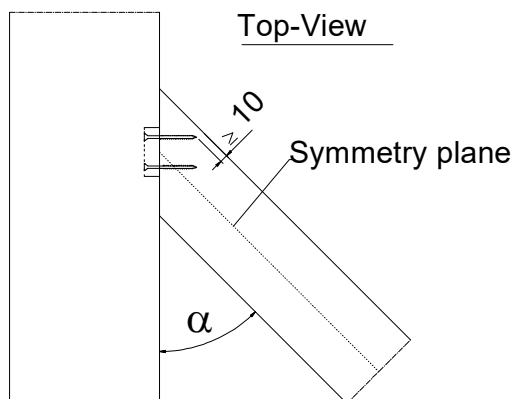

* if $\gamma < 30^\circ$ and the screws are covered by approval for this application, the values for the connector may be evaluated accordingly.


B.3 Typical Installation of ICS and ICST:

ICS

A 12 mm deep pocket is necessary in each timber element before installing the ICS male and female part. The characteristic capacities given below are only available when the ICS are installed in these pockets.

The ICS male part needs to be fixed on the face of the timber element, on top of the 12 mm deep and 40 mm wide pocket as shown below. The pocket must continue at least 80 mm below the male part in order to connect the 2 parts

The ICS female part needs to be fixed in the back of the 12 mm deep and 80 mm wide pocket as shown below. The pocket must continue at least 80 mm above the female part in order to connect the 2 parts.

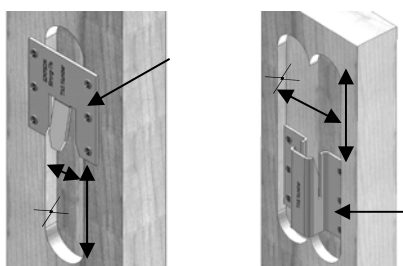

ICST


Routing is necessary on 1 side only. This routing should be 15 mm deep, 90 mm wide and 220 mm long as a minimum.

The distance between the ICST and the end of the timber elements should be 100 mm as a minimum.


ICST is composed of two parts, which will be face to face in final position.

The guiding central part of the connector facilitates the timber assembly.

The ICST connector is intended in the case of “closed” walls (installation of exterior and interior wall coverings).

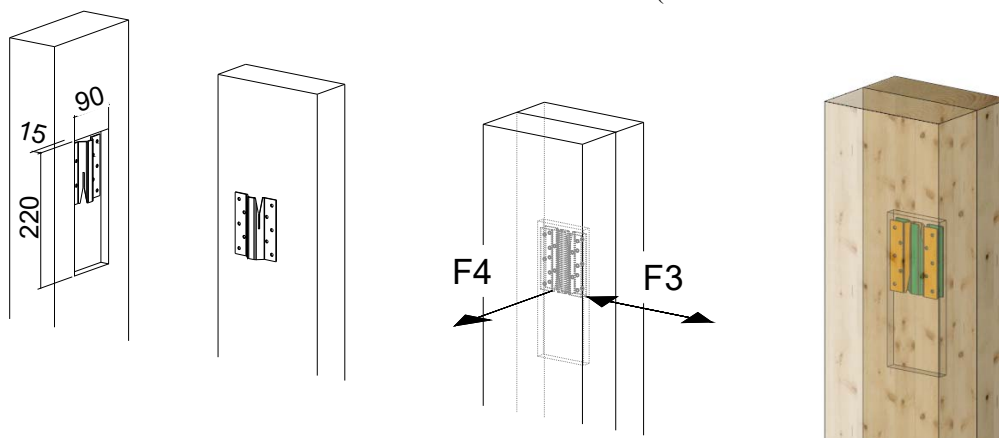

B.4 Typical installation of ETS/ETSN

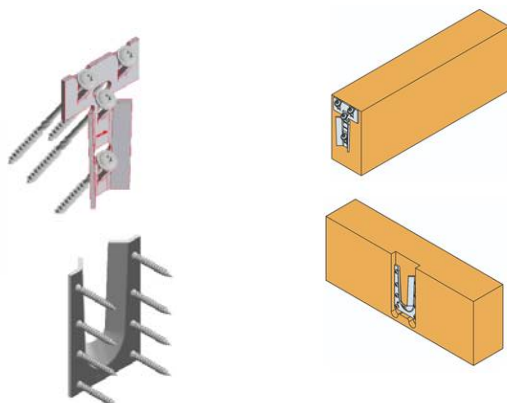

The connection to the header for the ETS can be only made with CSA screws.

For ETS: The connection to the end grain of the joist is made with screws $\text{\O}5$ mm according to the corresponding Annex. The angle between the Joist End connector and the screws is 45° .


For ETSN: The connection to the end grain of the joist is made with washer head screws $\text{\O}6$ mm according to the corresponding Annex. A slope and a skew is possible in these product ranges.

An ETS/ETSN connection is deemed fit for its intended use provided:


1. The header shall be restrained against rotation.
2. If the connection only has a connector on one side of the header, the eccentricity moment from the joists shall be considered when verifying the strength of the header.
3. For a header with joists from both sides but with different reaction forces a similar consideration applies.
4. For ETS, there shall be screws in all tab-aperture, filling the additional $\text{\O}5$ mm hole is optional. For ETSN, there shall be one screw for each fastener alignment guide composed of a tab-aperture and an oblong hole.
5. For connections made with the ETS/ETSN connectors the gap between the member surface and the connector shall be maximum 1 mm.
6. For ETS connectors the width of the header shall be at least $l+4d$, where l is the length and d is the diameter of the nails or screws in the header.
7. For ETS connectors the depth of the joist shall allow an edge distance of at least 10 mm between the screw tip and the adjacent joist surface.
8. For ETSN connectors the depth of the joist shall allow an edge distance of at least 8 mm (for ETSN100) & 10 mm (for ETSN130 & ETSN180) between the screw tip and the adjacent joist surface.
9. The header shall have a plane surface against the whole ETS / ETSN connector.
10. Screws to be used shall have a diameter, which fits the holes of the ETS connectors.


ETS / ETSN

The header must be routed as described below.

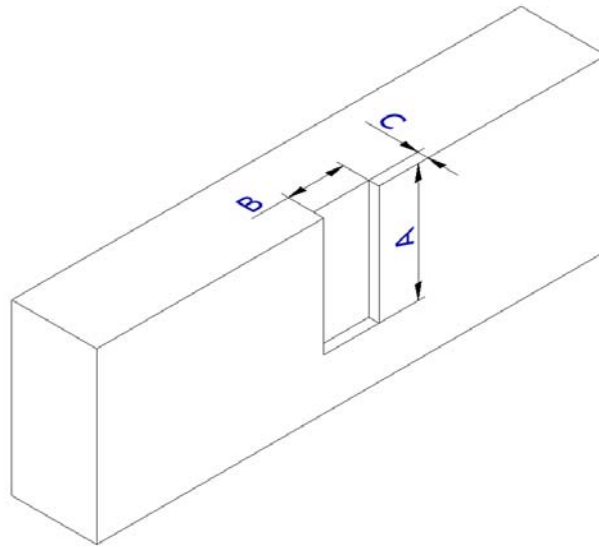


| Model | Dimensions of the routing | | |
|---------|---------------------------|--------|--------|
| | A (mm) | B (mm) | C (mm) |
| ETS100 | 100 | 65 | 12 |
| ETS140 | 140 | 65 | 12 |
| ETS180 | 180 | 75 | 12 |
| ETSN100 | 100 | 60 | 12 |
| ETSN130 | 130 | 65 | 12 |
| ETSN180 | 180 | 75 | 12 |

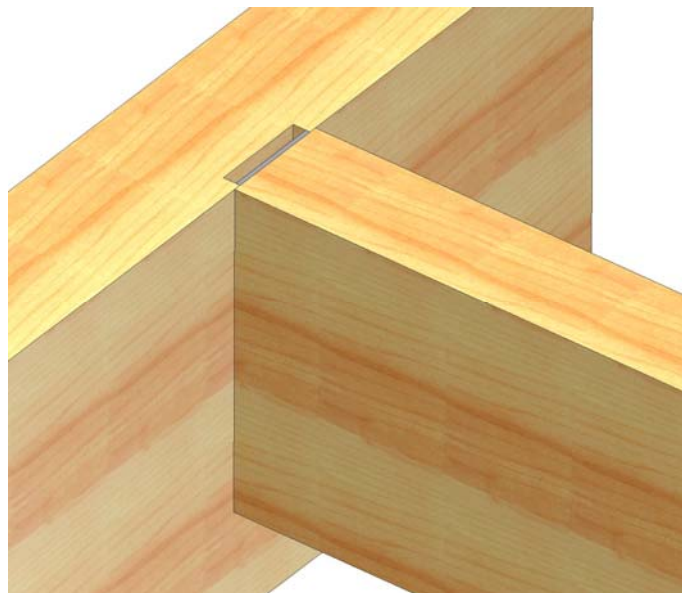

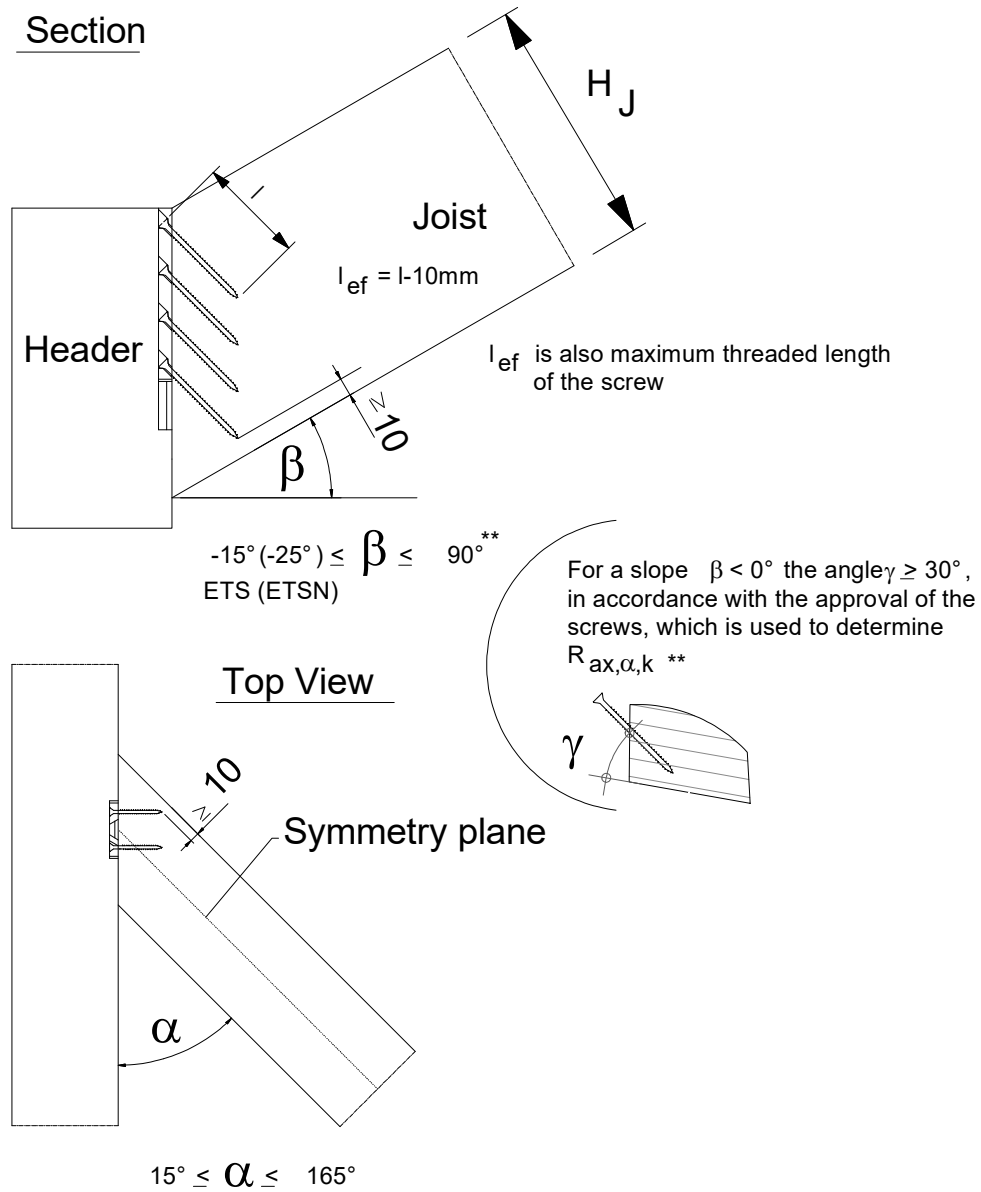


** if $\gamma < 30^\circ$ and the screws are covered by approval for this application, the values for the connector may be evaluated accordingly.


B.5 Typical Installation of ATFN

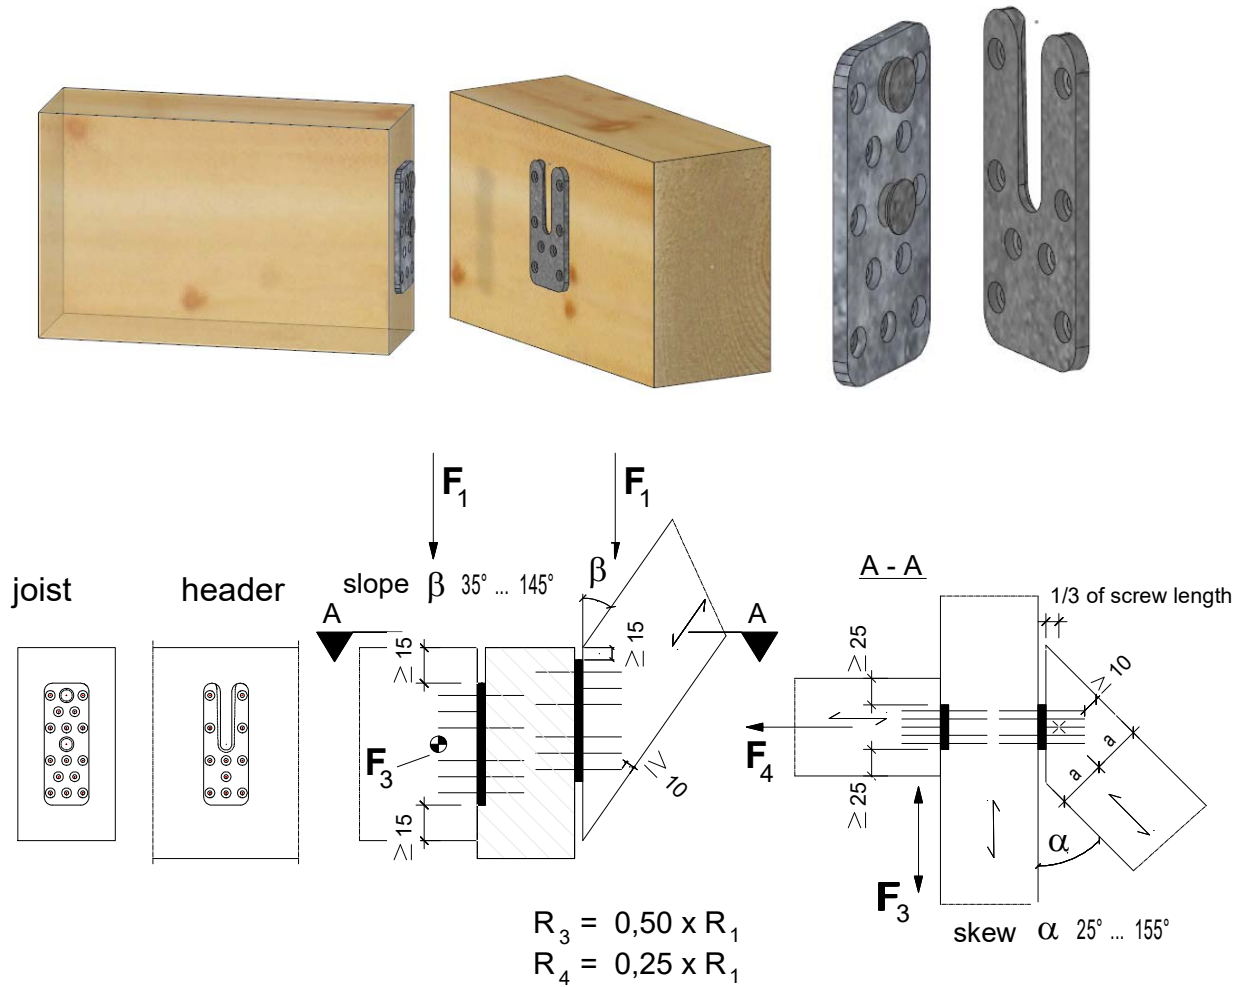

The distances to the border according to the picture above have to be considered.

Additional option for installation:

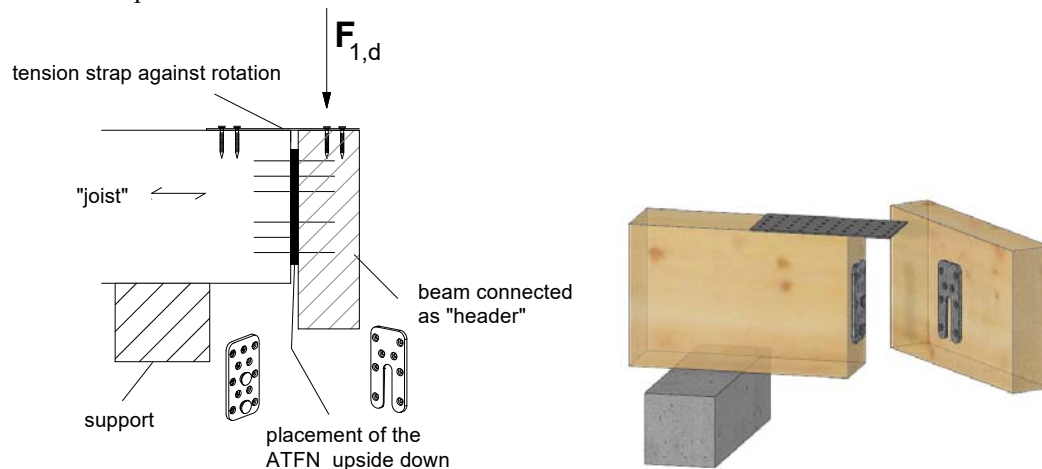


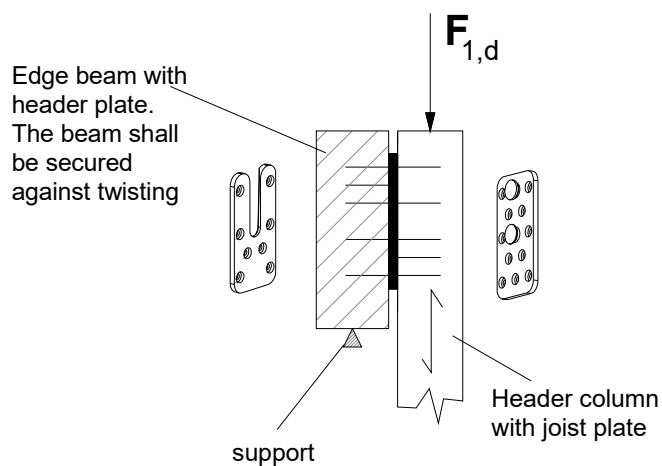


The routing can be made a) in the joist with 10mm, b) in the header with 10mm, or c) in both parts with together ≤ 10 mm.



The connection to the header can be made with nails in the case where the header is prevented from rotation. In other cases, the CSA screws have to be installed.

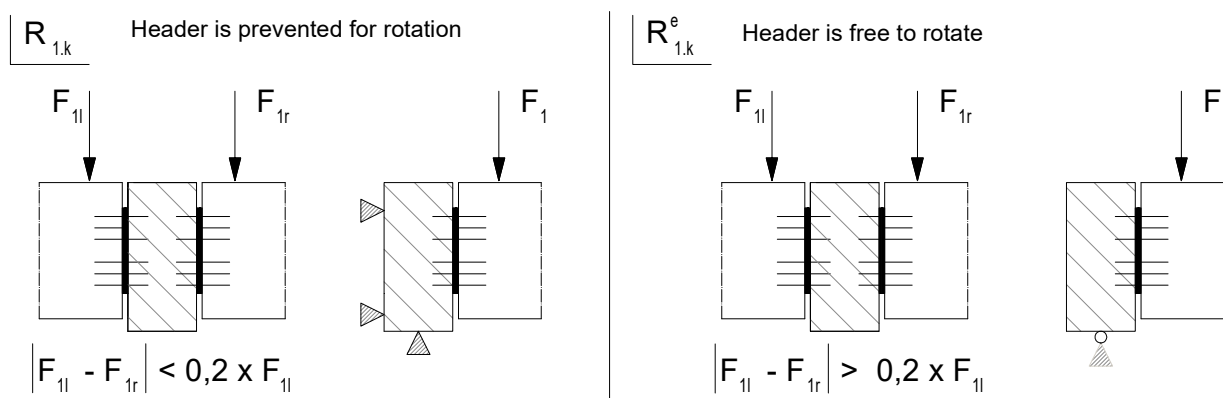

B.6 Installation for fire justification

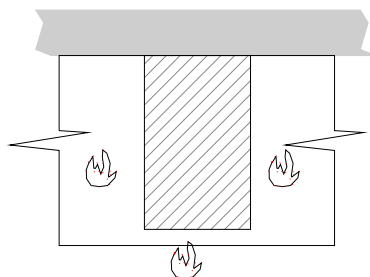

Fire from max 3 sides.

- **Concealed beam Hangers:** (TU, CBH, BT, BT4, BTN, BTALU, BTC, Janebo)
- Below are the parameters for the concealed beam hangers for a 30min and a 60min fire resistance.

Routing is compulsory

| | Fire resistance period – timber C24 | |
|---------------|-------------------------------------|---------------------|
| | 30min | 60min |
| t_1 (mm) | 50 | 50 |
| a_{fi} (mm) | 10 | 30* |
| d_{g1} (mm) | 10 [30] | 30 [Not Applicable] |
| d_{g2} (mm) | 20[30] | 60[Not Applicable] |

*must be plugs

For BTALU connector use values between []

For connection with a gap of ≤ 1 mm d_{g2} can be decreased to d_{g1} , this does not apply for the BTALU.


t_1 : thickness of the timber member on each side of the connector


a_{fi} : the end and edge distance to dowels (can be plugs)

d_{g1} : thickness of the glued-in strips

d_{g2} : thickness of timber for overlapping for the back plate with a gap ≤ 3 mm,


gap = the distance between the end of the joist and the surface of the header

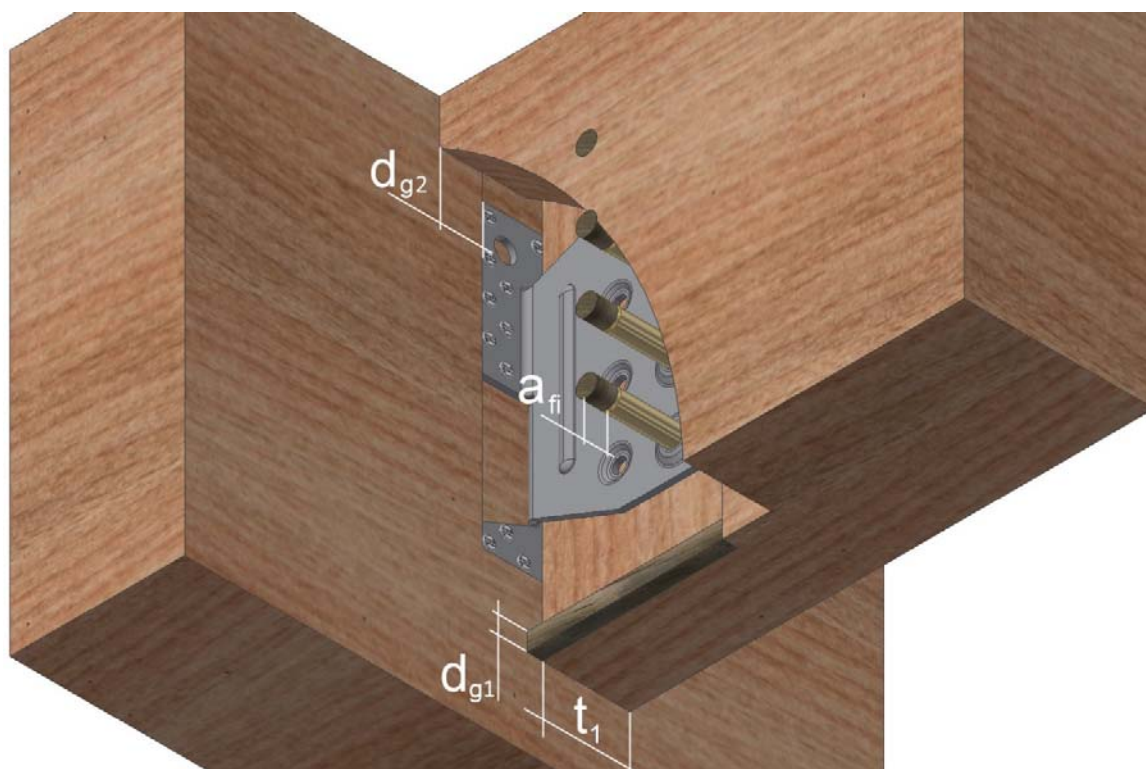

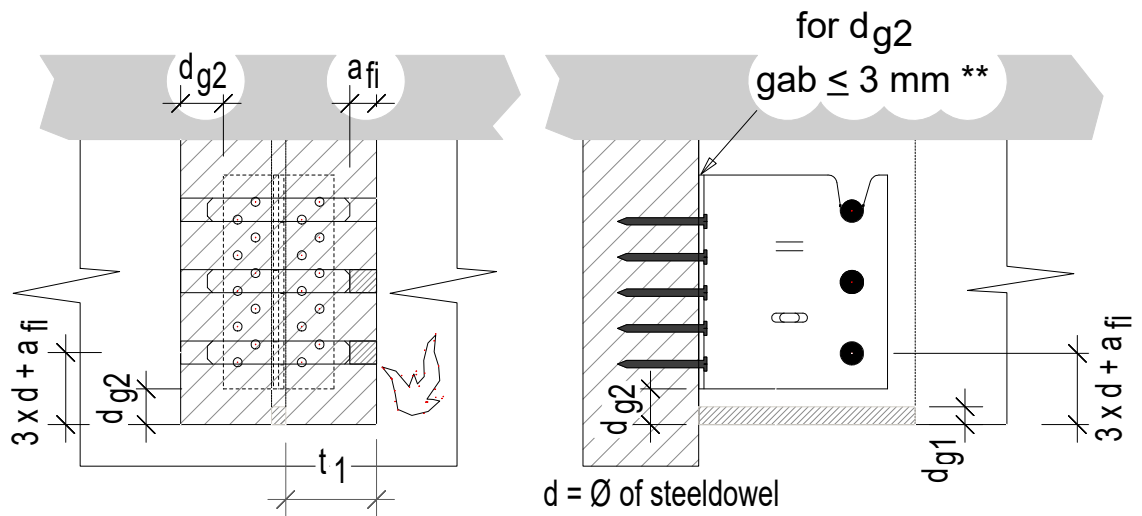

** For connector type BTALU: the gap is limited by $\leq 1\text{mm}$.

- **BTC ; CBH bolted**

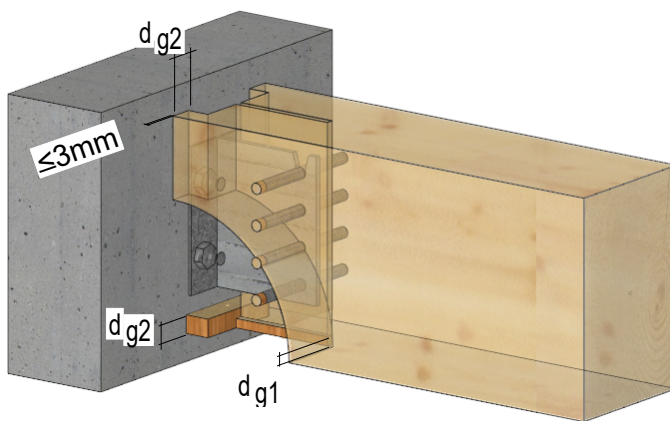

The gap is limited by $\leq 3\text{mm}$

- **Hidden connector :** (ATFN, ETB, ETS, EL/ELS, ICS, ICST)

Hidden connectors such as ATFN, ETB, ETS, and EL/ELS, ICS, ICST can also be justified by using this solution. In this case, a routing is compulsory. A thickness of timber d_g on each side of the connector must be respected.


| | | Fire resistance period – timber C24 | |
|------------|---------------------------------|-------------------------------------|-------|
| | | 30min | 60min |
| d_g (mm) | ETS/ETSN ICS, ICST | 10 | 30 |
| | ATFN, ETB, EL/ELS | 30 | - |
| | ICS, ICST | 10 | 30 |
| a_1 (mm) | ETS, ETSN, ICS, ICST | 40 | 55 |
| | ATFN, EL/ELS, ETB | 40 | - |
| | ETS, ETSN, ATFN, EL/ELS, ETB | 28 | 58 |
| a_3 (mm) | ETS, ETSN, ATFN, EL/ELS, ETB | 28 | - |




d_g : thickness of the timber protection

a_1 : edge distance of the axis of the fastener

a_3 : edge distance of the point of the fastener

The protection of the top of the connector is made with the deck, a timber element, or other protective materials.

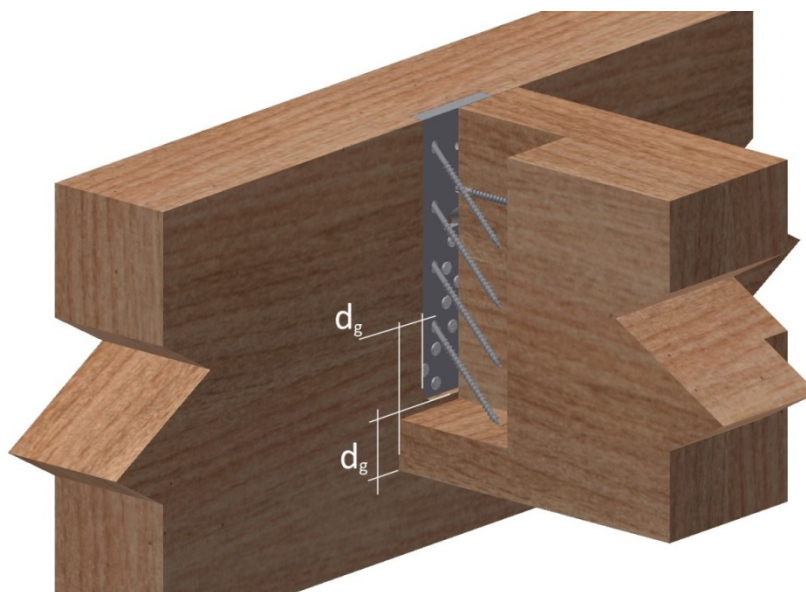

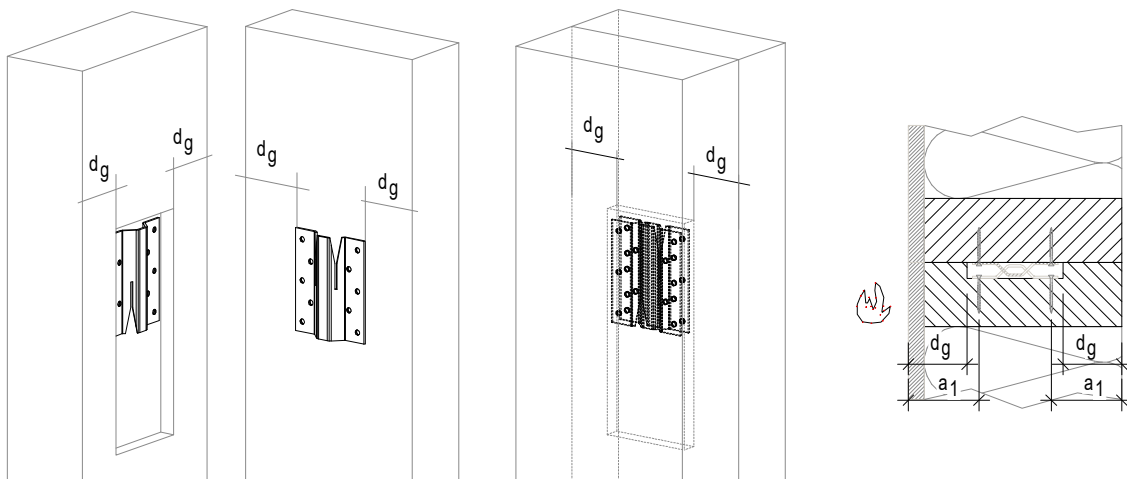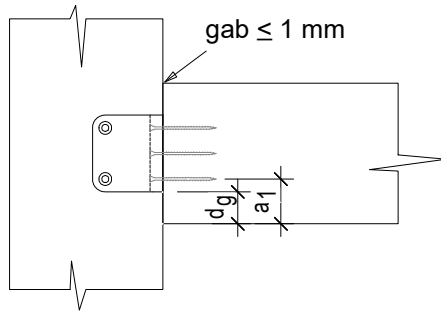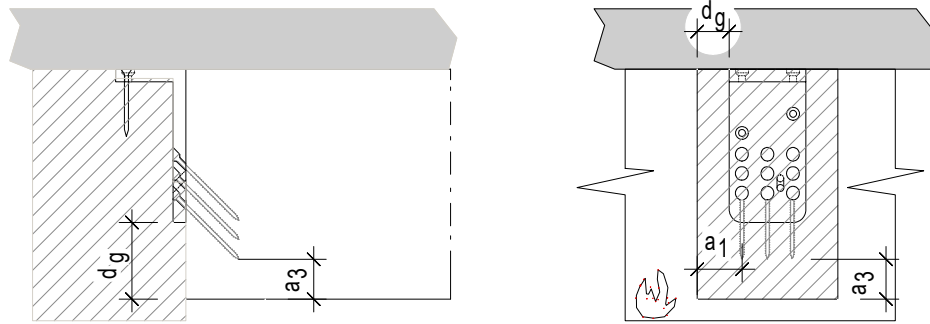

For ICS and ICST; fire from max 2 sides

Annex C Design

C.1 Basis of Design

Characteristic capacities of the concealed joist hangers with nails or screws.

The formulas are applicable for connectors made from stainless steel with a characteristic yield stress of at least 235 Mpa or a characteristic ultimate tensile strength of at least 330 Mpa and for ordinary steel of the quality S250GD + Z275 according to EN 10346 or S235JR according to EN10025, or aluminium AlMgSi 0,7 to DIN 1749-1.

The Joist End connectors are made from aluminium grade EN AW-6082 T6 according to EN 755-2 with minimum yield strength of 250 MPa, a minimum tensile strength of 295 MPa and a minimum ultimate strain of 8 %.

The ATFN connector is made from:

Plates; S355MC according to EN10149

Pins: steel with a minimum yield strength of 580N/mm² a minimum tensile strength of 610 N/mm² and a minimum ultimate strain of 16%. The pins are connected with the plates by compression strain

Requirements for the header or the joist for the concealed beam hangers:

- The wood members can be of solid timber, glued laminated timber and similar glued members, or wood-based structural members.
- The requirements of the wood members can be fulfilled by using the following materials:
- Solid timber classified to C24 or better according to EN 338
- Glued members of timber classified to C24 or better according to EN 338 when structural adhesives are used.
- Glued laminated timber classified to GL24c or better according to EN 1194.
- Solid Wood Panels, SWP according to EN 13353.
- Laminated Veneer Lumber LVL according to EN 14374
- Plywood according to EN 636
- Other Engineering Wood products classified for their resistance and with certified mechanical performances for fasteners

The characteristic density of the wood members shall be at least 350 kg/m³. Lower densities are applicable but the load bearing capacities shall be reduced by the k_{dens} factor, given by

$$k_{dens} = \left(\frac{\rho_k}{350} \right)^2$$

Where ρ_k is the characteristic density of the timber in kg/m³.

In case of concrete support, concrete shall be specified according to EN 206-1 with a resistance class within the following range : C20/25 to C50/60.

The wood members shall have a thickness which is larger than the penetration depth of the fasteners into the members

Requirements for the header or the joist for the Joist End connectors:

For screws or nails in the end grain of the wood (joist) the requirement to the material of the wood members can be fulfilled by using the following materials:

- Solid timber classified to C14-C40 according to EN 338 / EN 14081,
- Glued members of timber classified to GL24c or better according to EN 1194 / EN 14080,
- Solid Wood Panels, SWP according to EN 13353,

For nailing in the side of the wood members (header) the requirement to the wood members can be fulfilled by using the following materials:


- Solid timber classified to C14-C40 according to EN 338 / EN 14081,
- Glued members of timber classified C14-C40 according to EN 338 / EN 14081 when structural adhesives are used.
- Glued members of timber classified to GL24c or better according to EN 1194 / EN 14080,
- Solid Wood Panels, SWP according to EN 13353,
- Laminated Veneer Lumber LVL according to EN 14374,
- Parallam PSL,
- Laminated Strand Lumber LSL e.g. Parallam PSL and Timber Strand,
- Oriented Strand Board OSB according to EN 300
- Duo- and Triobalken,
- Layered wood plates,
- Plywood according to EN 636
- For EWP (Engineered Wood Products), please refer to the manufacturer's specifications.

The load-carrying formulas stated in Annex B are applicable for a wood density from 290 kg/m³ to 460 kg/m³. It is allowed to use wood with a density up to 500 kg/m³. However, increased load-carrying capacity than that for a density of 460 kg/m³ should not be employed. For density between 420 and 500 kg/m³ pre-drilling of nail and screw holes are necessary.

C.2 Definition of force directions

The characteristic load-carrying capacities are for the following force directions:

- F_1 Downward
- F_2 Uplift
- F_3 Lateral – horizontal
- F_4 Axial in the middle of the beam



Concealed joist hangers type BTN, BT4, BTALU, BTx, BTCx

Force direction F_1 :

These are given in different tables for each connection.

“Table for connection with header free from rotation”. Here it is assumed, that the connection has a BT both sides of the header and the difference between the active forces is no more than 20%, or the header is clamped. In this case the calculation for the header may be made separately.

“Table for connection with header free to rotate”. Here the eccentricity of the BT is used so the moment is absorbed in the BT – connection.

For the capacity for the header with $b = 240$ mm it is to multiply the values for $b_{HT} = 180$ mm with the factor 0,77.

For an uplift force, the upper dowel in the cut-out hole may not be used for the calculation.

Force direction F_2 :


The values for F_1 can be used where the number of steel dowel has to reduce by the upper one in the “cut-out” hole.

How to use the tables:

| $R_{1,k}$ | the used fastener and size | | nail pattern | |
|----------------|----------------------------|-------|----------------------|------|
| | CNA 4,0x50 | 4-row | length of steeldowel | |
| Length SD [mm] | 80 | 100 | | |
| number of SD | n_N | [kN] | n_N | [kN] |
| 3 | 20 | 18,2 | 20 | 19,4 |
| | 44 | 32,2 | 44 | 34,5 |
| 4 | 28 | 29,5 | 28 | 31,2 |
| | 48 | 43,0 | 52 | 46,1 |
| 5 | 36 | 41,9 | 36 | 44,3 |
| | 56 | 53,9 | 60 | 57,6 |

Sample: a connection with a BT with 4 Steel dowel with a length of 100mm, the width of joist is min. 100mm, nail pattern = 4-row, and 28 nails 4,0x50 is $R_{1,k} = 31,2$ kN.
for the same connection with 52 nails $R_{1,k} = 46,1$ kN.

For using another number of nails, it must be between the number of fasteners listed in the table, the capacity may be determined by linear interpolation based on the number of nails. In the sample before the number of nails may be between 28 and 52.

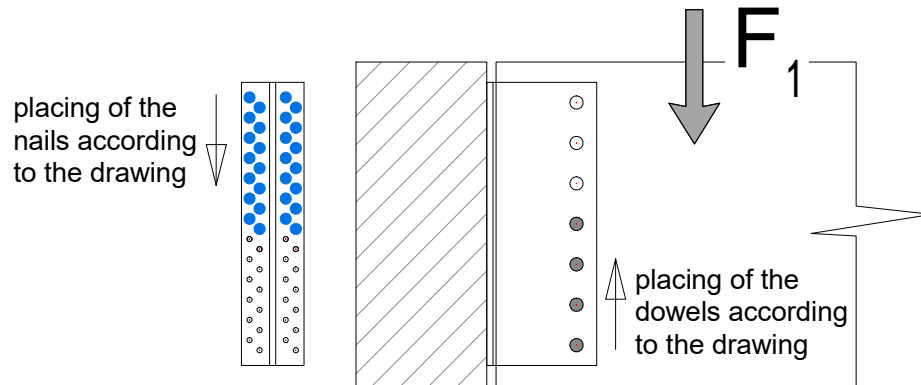


Force direction F_3 :

These are given in the table, with and without screws. For connections with screws, the screws are inserted perpendicular next to the BT, see following picture.


The screws for reinforcement of the joist shall have a length $<$ the width of the joist. The assumed length for the tables in Annex B is width of the joist -20 mm. The screws are inserted from both sides. The screws shall be fully threaded.

b des Nebenträgers

$b - 20 = \text{Länge der Schraube}$

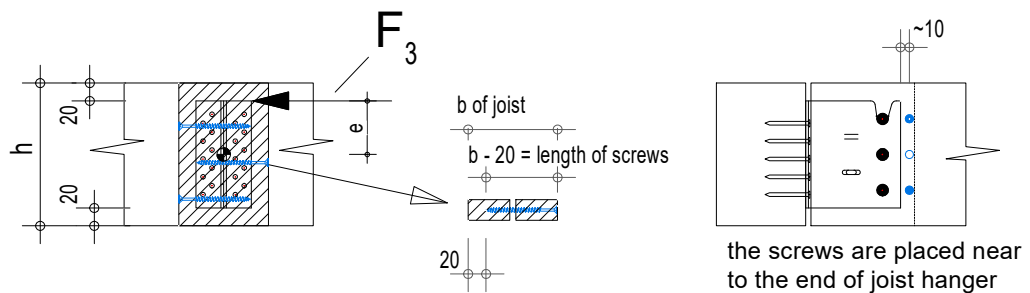


Where screws are inserted from one side, it shall be the side of the applied force. Otherwise the capacity is reduced with the factor 0,8 ; see following picture

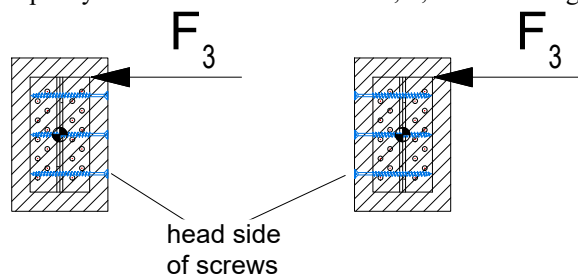


Use the table values use the table values $\times 0,8$

Force direction F_4


The force is in the direction of joist and in the middle of the joist.

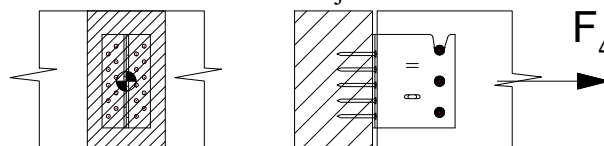


General

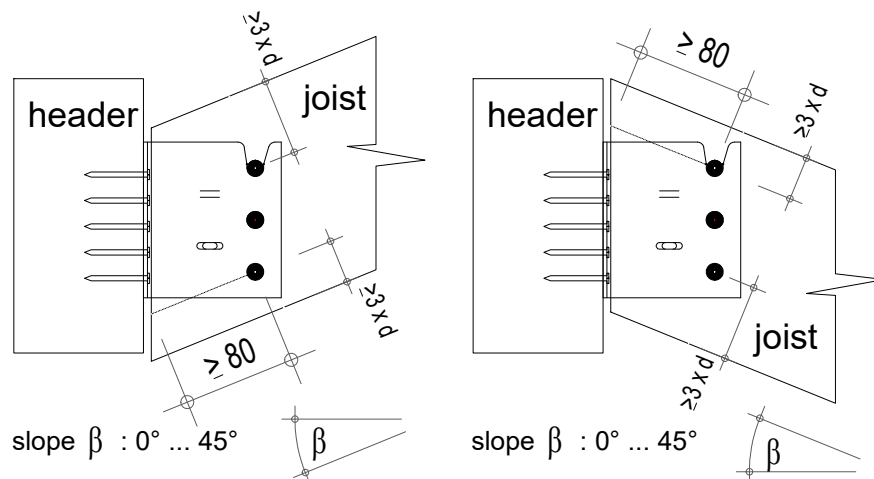


Type BTN-90 and BT4-90.

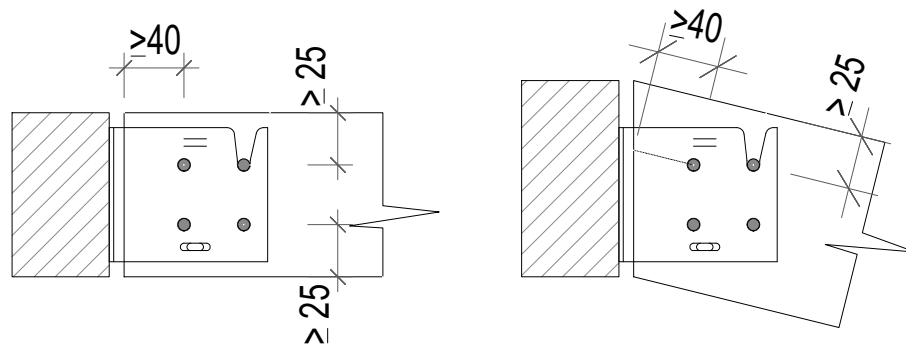

For the types TUS and TUBS; additional skews are possible:

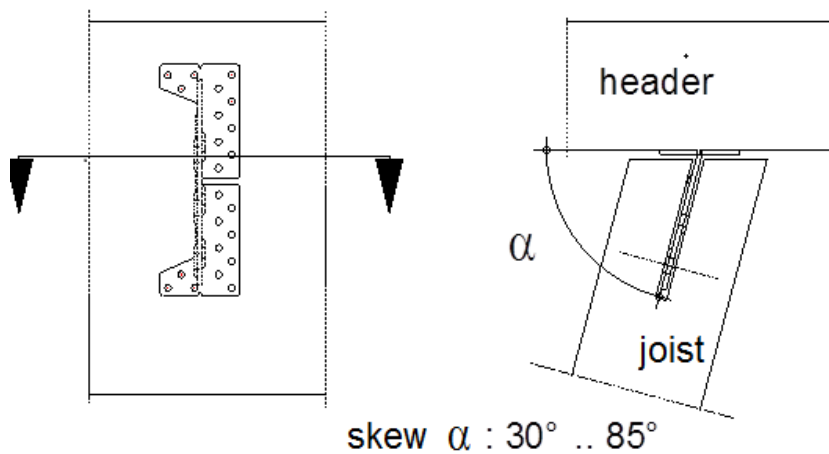


The above picture shows a skew to the left side. The design for right is the same.

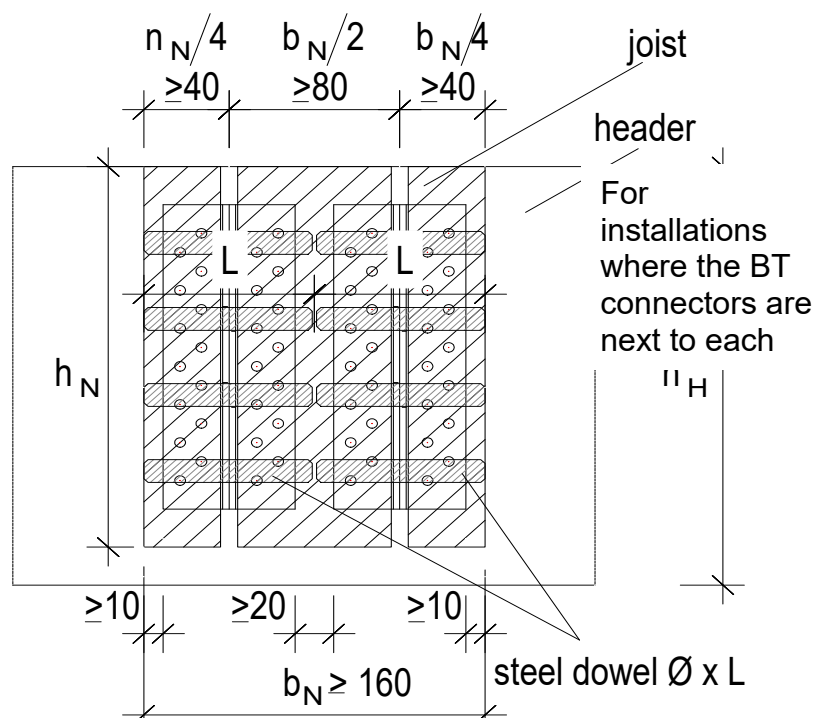

The dowels should be inserted from both sides meeting in the middle of the joist.

Connection to concrete / steel

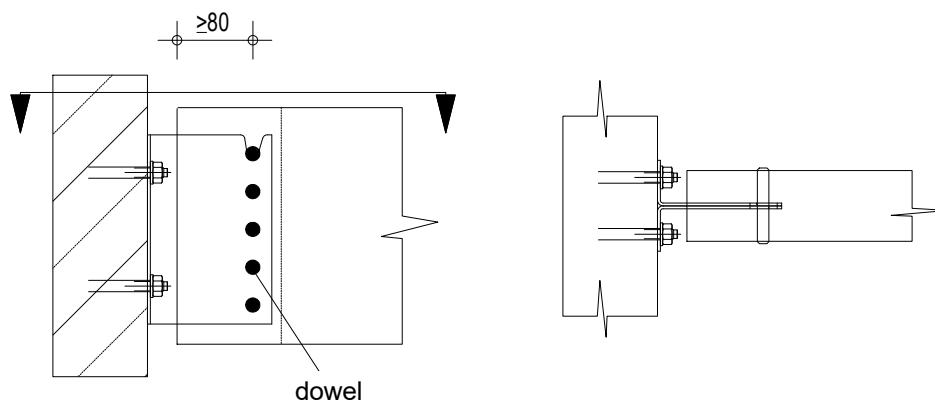

The connection for force direction F_1 is with min. 2 anchor bolts, used in the upper holes.

For an uplift force, F_2 and F_3 a minimum of 4 anchor bolts, must be used in the upper and lower holes.

Racking check


Due to the high rigidity of CLT wall, the racking load can be transferred to the BTALU at the bottom and decomposed as an axial load and a lateral load.

$$F = F_{x,1} + F_{x,2} + \dots + F_{x,i} \text{ and } F_{x,1} = F_{x,2} = \dots = F_{x,i}$$

$$F_{y,1} = F \times x_1 \times y / (\sum(x_i^2))$$

Optional : For the other BTALU : $F_{y,i} = x_i/x_1 \times F_{y,1}$

The use of formulas provides no gap between wall and floor members. With F the racking load, Y the height of the wall and X_i the distance between the BTALU and the rotation point. It is assumed, that the "pressure" area is close to the end of the CLT wall, and the last Connector (it's the right one in the picture below) doesn't absorb any axial load.

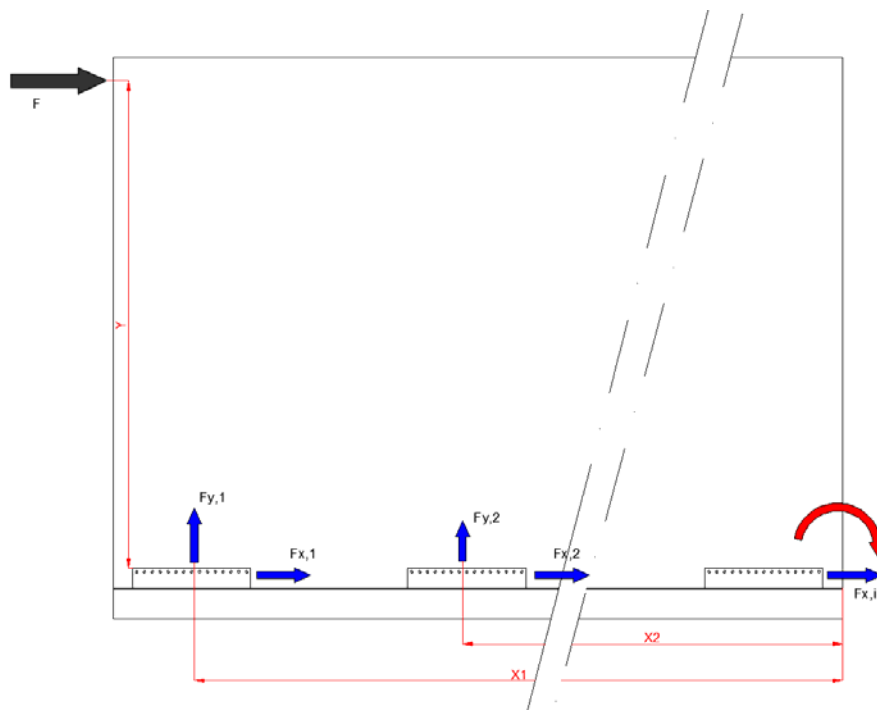

Then interaction formula must be used on the first BTALU:

$$\left(\frac{F_{y,1}}{R_{y,1}}\right)^2 + \left(\frac{F_{x,1}}{R_{x,1}}\right)^2 \leq 1$$

With

$R_{y,1}$ the resistance of the first BTALU to tension loads

$R_{x,1}$ the resistance of the first BTALU to downloads

Characteristic capacities $R_{4,k}$ for BTALU with steel dowel Ø7, 8 and 10mm

| |
|---|
| Table 35 |
| Tension resistance of BTALU is calculated using the following equation: |
| $R_{4,k} = \min(n_d \times F_{lat,SD,Rk}; n_N \times F_{ax,Rk})$ |
| n_d is the number of dowels |
| n_N is the number of nails/screws |
| $F_{lat,SD,Rk}$ is the characteristic load-carrying capacity per dowel in the timber for both shear planes (acc.to EN1995-1-1 §8.6). |
| $F_{ax,Rk}$ is the axial capacity of the fastener in the header |
| The slot to be used with the BTALU is 7 to 8 mm thick. |
| See the additional information below table 34 for placing the nails/ steel dowel, respectively the number for using in the calculation. |

Steel dowels

The steel dowels must be mechanically equivalent or greater than S235JR ($f_{y,k,min} = 235$ N/mm).

The standard spacing between dowels is 40mm. If the spacing increases and the number of dowels remain the same, the capacity with standard spacing can be used as normally it increases the values.



For dowels Ø8 the values can be used with a distance between the header and the dowels of 89mm to 93mm

ETB, EL, ELS, ETS, ETSN

The part in the header has to be fixed with nails or CSA screws or only with CSA screws for ETS connectors. The part in the joist has to be fixed with screws with an angle of 45° to the connector. For ETSN, the part in the joist has

to be fixed with screws with an angle of 35° to the connector. The screws have to have a angle between grain of timber and the screw according the approval of the screws. For the ETB, ETS & ETSN both parts of the connector are to be fixed separately on the header and the joist before assembly of the connection

For the types EL and EL-S the connector has to be fixed to the joist and then connected to the header or the column.

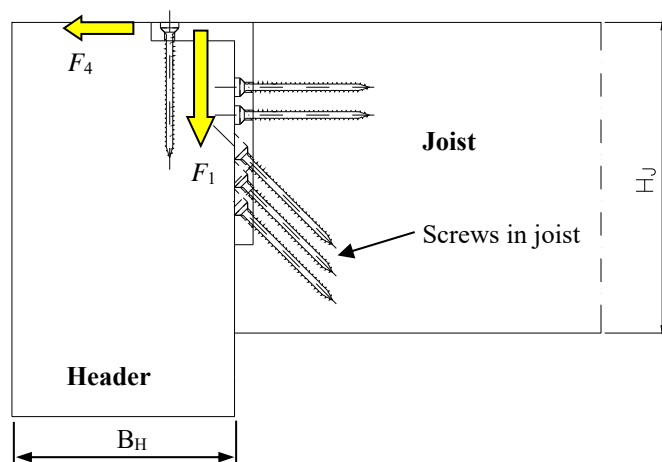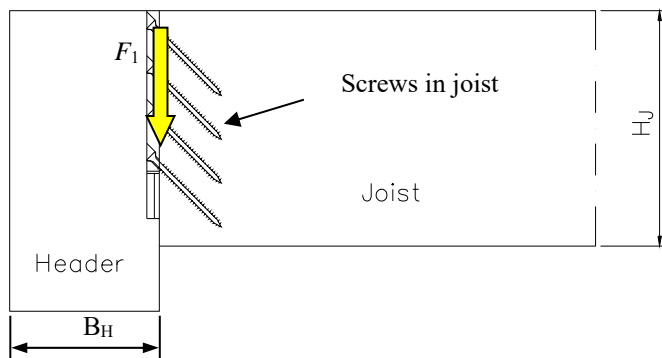

C.3 Fastener specification and capacities

| Nail and screw type | Nail and screw size (mm) | | Finish |
|--|--------------------------|-------------------------|------------------------------|
| | Diameter | Length | |
| According to ETA 04/0013 Annex A drawing 1 and 2 | | | Electroplated zinc |
| Connector nail | 4 | 35, 40, 50, 60, 75, 100 | |
| Connector screw | 5 | 35, 40, 50 | |
| Connector nail | 4,2 | 35, 50, 60 | stainless steel as described |
| Connector nail | 4 | 35, 40, 50, 60, 75, 100 | |
| Connector screw | 5 | 35, 40, 50 | |

| other fastener | size [mm] | | Finish |
|--|-----------|-----------|--|
| | Diameter | Length | |
| Screws according to EN 14592 or according to an ETA | 5 | 60-120 | Electroplated zinc |
| Washer head screws according to EN14592 or according to an ETA | 6 | 80-160 | Electroplated zinc |
| Screws according to EN 14592 or according to an ETA | 8 | Up to 300 | Electroplated zinc |
| dowel according to EN 14529 | 8 | - | Electroplated zinc hot dip galvanised stainless steel |
| | 12 | - | |
| Bolt M10 | 10 | - | For relevant concealed joist hangers see the assumed characteristic capacities of the bolt connection and compare with the specification of the manufacturer |
| Bolt M12 | 12 | - | |


The capacities are given in the named standards or relevant approvals.

Annex D- Product definition and capacities

D1 Concealed joist hanger BTN, BT4, BTALU, BTx

| Product Name | alternative names | | | | old name |
|--------------|-------------------|-----------|-----------|-----------|----------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 | |
| BTN | | | | | 2 rows |
| BT4 | | | | | 4 rows |
| BTALU | | | | | ALU |
| BT | | | | | - |

Figure D1-1: Dimension drawing of concealed joist hangers

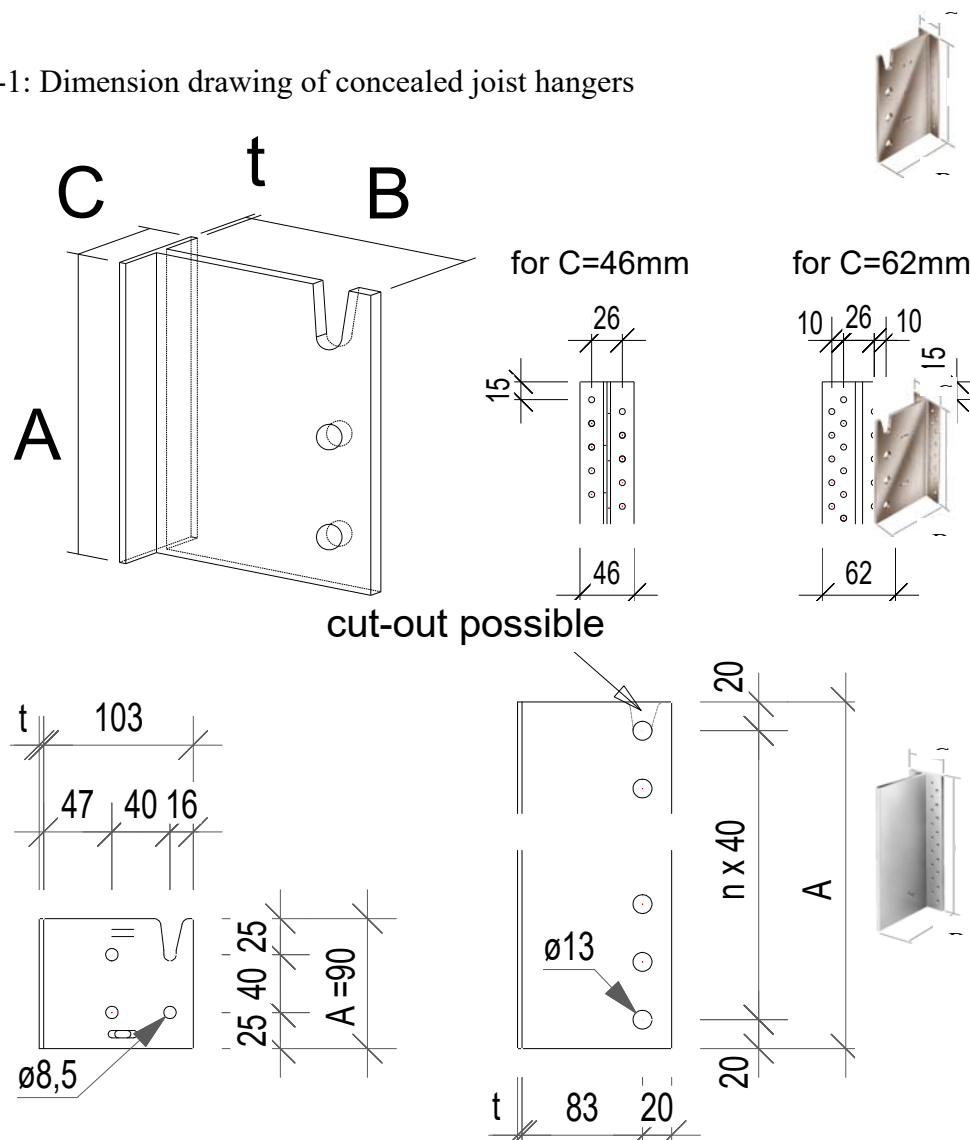

Type BTALU connectors are produced without holes for the dowels, these holes should be made before or during installation by the user, the hole pattern is shown above., the holes can be made also with other diameters (\varnothing of steel dowel :7, 8 and 10 mm)

The concealed joist hanger BTN and BT4 up to size 240 are supplied with the cut-out for the upper dowel and it's an option for the other sizes.

Additional Option for outside using

For the types BTALU, up to size 240, and the BT made from stainless steel also up to size 240, it's allowed to reduce the distance of the steel dowel to the end grain of the joist like the following. In this case, full threaded screws have to be placed as given in the picture. An approval/assessment for the screw and the given distances is necessary.

The minimum edge and end distances for the full threaded screws have to be observe according to the approval/ assessment of the used screws.

For a construction in this way the load directions F1, F2 and F4 are possible.

This application is an option for service class 3, e.g. balcony, where a distance is meaningful for a good aeration.

A professional construction for a wood preservation is required.

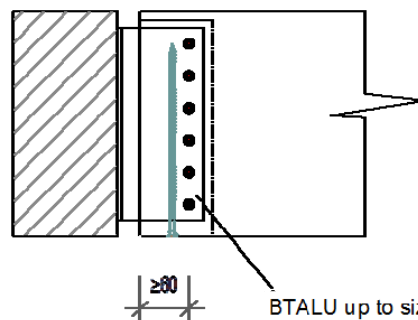
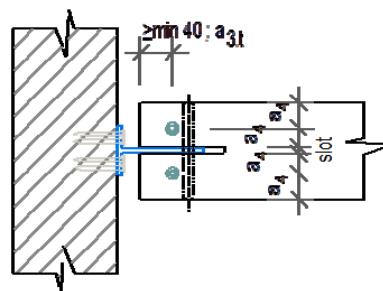


Table D1-1: Size specification

| Type | A [mm] | B [mm] | C [mm] | t [mm] | no of holes | |
|------------|--------------|-----------|-----------|-----------|-------------|----------------------|
| | | | | | Ø 5mm | Ø13mm dowel |
| BTN90 | 90 | 103 | 46 | 3 | 8 | 4* |
| BTN120 | 120 | 103 | 46 | 3 | 10 | 3 |
| BTN160 | 160 | 103 | 46 | 3 | 14 | 4 |
| BTN200 | 200 | 103 | 46 | 3 | 18 | 5 |
| BTN240 | 240 | 103 | 46 | 3 | 22 | 6 |
| BT4-90 | 90 | 103 | 62 | 3 | 16 | 4* |
| BT4-120 | 120 | 103 | 62 | 3 | 20 | 3 |
| BT4-160 | 160 | 103 | 62 | 3 | 28 | 4 |
| BT4-200 | 200 | 103 | 62 | 3 | 36 | 5 |
| BT4-240 | 240 | 103 | 62 | 3 | 44 | 6 |
| BTALU90 | 90 | 103 | 62 | 6 | 16 | 4*,** |
| BTALU120 | 120 | 103 | 62 | 6 | 20 | 3** |
| BTALU160 | 160 | 103 | 62 | 6 | 28 | 4** |
| BTALU200 | 200 | 103 | 62 | 6 | 36 | 5** |
| BTALU240 | 240 | 103 | 62 | 6 | 44 | 6** |
| BTALUx *** | up to 600 | 103 | 62 | 6 | up to 112 | up to 12 x Ø13 ** |
| BTx *** | up to 600 | 103 | 62 | 3 | up to 112 | up to 15x Ø13 |

* Ø8,5mm

** hole pattern according the types BT4, to drill additional

*** here is given the high in mm, same as the size "A" in the table.

Table D1-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|---|-----------------------|
| 3 | S 250 GD | Z275 |
| 6 | Aluminium AW-6005A according to EN755- 2:2008 | |
| 3 | stainless steel as described | |

For installation for fire justification, see clause B6

Characteristic capacities

The tables are based on a timber having a density of 350 kg/m³ and a slope of 0°

For other configurations the following modification are necessary:

for different density the values shall be multiplied by:

| | | | |
|------------|------|------|-------|
| $\rho_k =$ | 380 | 410 | 430,0 |
| factor | 1,05 | 1,10 | 1,13 |

for different slope β

| | | | | |
|---------|----|------|-----|------|
| β | 0° | 15° | 30° | 45° |
| factor | 1 | 0,95 | 0,9 | 0,85 |

only for less as 7 SD, for 7 or more SD no reducing is necessary

SD = Steel dowel


For using steel dowels with a length of 60mm the values for steel dowel with 80mm may be multiplied by 0,95; only for the types BTN90 and BT4-90 the values for a dowel with l=60mm are given directly.

Characteristic capacity $R_{1,k}$ [kN] for BTN90/ BT4-90 and steel dowel Ø8mm

| BTN90 / BT4-90 | | $R_{1,k}$ [kN] | | to beam | |
|----------------|---|-------------------|------|---------|--|
| CNA 4,0x50 | | kg/m ³ | | | |
| n_N | Timber width = length of steel dowel [mm] | | | | |
| | 60 | 80 | 100 | ≥ 120 | |
| 8 | 8,3 | 9,2 | 10,3 | 11,02 | |
| 16 | 10,8 | 11,8 | 12,9 | 13,72 | |

| BTN90 / BT4-90 | | $R_{1,k}$ [kN] | | to column | |
|----------------|---|-------------------|------|-----------|--|
| CNA 4,0x50 | | kg/m ³ | | | |
| n_N | Timber width = length of steel dowel [mm] | | | | |
| | 60 | 80 | 100 | ≥ 120 | |
| 4 | 7,1 | 7,9 | 8,6 | 8,9 | |
| 8 | 9,0 | 9,9 | 10,9 | 11,6 | |

BTN90 / BT4-90
column nailing



| | BTN90 / BT4-90 | | $R_{3,k}$ [kN] | | to column | |
|----------------|----------------|---|-------------------|-------|-----------|--|
| | CNA 4,0x50 | | kg/m ³ | | | |
| | n_N | Timber width = length of steel dowel [mm] | | | | |
| 60 | | 80 | 100 | ≥ 120 | | |
| without screws | 4 | 1,2 | 1,6 | 2,0 | 2,4 | |
| | 8 | 1,5 | 1,9 | 2,3 | 2,7 | |
| with screws | 4 | 1,7 | 3,4 | 4,7 | 5,0 | |
| | 8 | 1,9 | 3,7 | 4,7 | 5,8 | |

The characteristic capacities for the different load directions F_1 , F_2 , F_3 for the other dimensions of BTs, please refer to table 1 to 35 on the following pages. The connections are with steel dowel $\varnothing 12\text{mm}$, except for BT90 with $\varnothing 8\text{mm}$. The values in the tables 1 to 34 are also for the concealed joist hangers BTALU with $\varnothing 12\text{mm}$ steel dowel.

Tables for BTN, BT4, BT, BTALU


| No of table | force direction | nail /screw | nail pattern | supporting member as a | supported member | b_H [mm] | No of table | force direction | nail /screw | reinforcement: with/without screws | supporting member as a |
|-------------|-----------------|-------------|----------------|------------------------|------------------|------------|----------------|-----------------|-------------|------------------------------------|------------------------|
| 1 | F_1 | CNA4,0x50 | 4-row | Header | C24 | | 21 | F_3 | CNA 4,0x50 | with screws | Header |
| 2 | | CNA 4,0x60 | | | | | without screws | | | | |
| 3 | | CSA 5,0x50 | | | | | with screws | | | | |
| 4 | | CNA4,0x50 | | | | | | | | | |
| 5 | | CNA 4,0x60 | without screws | | | | | | | | |
| 6 | | CSA 5,0x50 | | | | | | | | | |
| 7 | | CNA4,0x50 | 4-row | Column | | | 27 | | CNA 4,0x50 | with screws | Column |
| 8 | | CNA 4,0x60 | | | | | without screws | | | | |
| 9 | | CSA 5,0x50 | | | | | with screws | | | | |
| 10 | | CNA4,0x50 | | | | | | | | | |
| 11 | | CNA 4,0x60 | without screws | | | | | | | | |
| 12 | | CSA 5,0x50 | | | | | | | | | |
| 13 | F_1 f. H. | CNA 4,0x60 | 4-row | Header | 120 | 33 | all | Header | | | |
| 14 | | CSA 5,0x50 | | | 2-row | 180 | 34 | all | Column | | |
| 15 | | | | | | CNA 4,0x60 | 2-row | 120 | 35 | all | Header/Column |
| 16 | | | | | | | | CSA 5,0x50 | | | |
| 17 | | | CNA 4,0x60 | | | 2-row | 120 | | | | |
| 18 | | CSA 5,0x50 | | | 180 | | | | | | |
| 19 | | | CNA 4,0x60 | | 2-row | 120 | | | | | |
| 20 | | CSA 5,0x50 | | | | 180 | | | | | |

F_1 f.H. : the header is free for rotation


Tables for force direction F_1 for BTALU only

| No of table | force direction | nail /screw | nail pattern | supporting member as a | supported member | Steel dowel \varnothing | No of table | force direction | nail /screw | nail pattern | supporting member as a | supported member | Steel dowel \varnothing | | |
|-------------|-----------------|----------------|----------------|------------------------|------------------|---------------------------|----------------|-----------------|----------------|----------------|------------------------|------------------|---------------------------|--------|-----------|
| 40 | F_1 | CNA4.0x50 | 4-row | Header | C24 | SD $\varnothing 7$ | 70 | F_1 | CNA4.0x50 | 4-row | Header | C24 | SD $\varnothing 10$ | | |
| 41 | | CNA4.0x60 | | | | | with screws | | | | | | | | |
| 42 | | CSA5.0x50 | | | | | | | without screws | | | | | | |
| 43 | | CNA4.0x50 | | | | | 2-row | | | | | | | Column | 71 |
| 44 | | CNA4.0x60 | without screws | | | | | | | | | | | | |
| 45 | | CSA5.0x50 | | | | | | | with screws | | | | | | |
| 46 | | CNA4.0x50 | 4-row | | | | | | | Column | | | | | 72 |
| 47 | | CNA4.0x60 | | | | | with screws | | | | | | | | |
| 48 | | CSA5.0x50 | | without screws | | | | | | | | | | | |
| 49 | | CNA4.0x50 | | | | | 2-row | | Column | | 73 | | | | CNA4.0x50 |
| 50 | | CNA4.0x60 | without screws | | | | | | | | | | | | |
| 51 | | CSA5.0x50 | | with screws | | | | | | | | | | | |
| 52 | | CNA4.0x50 | 4-row | | | | | | | | Column | | | 74 | CNA4.0x60 |
| 53 | | CNA4.0x60 | | with screws | | | | | | | | | | | |
| 54 | | CSA5.0x50 | | | | | without screws | | | | | | | | |
| 55 | | CNA4.0x50 | | 2-row | | | | | | Header | | | | 75 | CSA5.0x50 |
| 56 | | CNA4.0x60 | without screws | | | | | | | | | | | | |
| 57 | | CSA5.0x50 | | | with screws | | | | | | | | | | |
| 58 | | CNA4.0x50 | 4-row | | | Header | 76 | | CNA4.0x50 | | | without screws | | | |
| 59 | | CNA4.0x60 | | with screws | | | | | | | | | | | |
| 60 | | CSA5.0x50 | | | without screws | | | | | | | | | | |
| 61 | | CNA4.0x50 | | 2-row | | | Column | | 77 | | CNA4.0x60 | with screws | | | |
| 62 | | CNA4.0x60 | without screws | | | | | | | | | | | | |
| 63 | | CSA5.0x50 | | | with screws | | | | | | | | | | |
| 64 | | CNA4.0x50 | 4-row | | | | | | Column | 78 | CSA5.0x50 | without screws | | | |
| 65 | | CNA4.0x60 | | with screws | | | | | | | | | | | |
| 66 | | CSA5.0x50 | | | without screws | | | | | | | | | | |
| 67 | | CNA4.0x50 | | 2-row | | Column | | | | 79 | CNA4.0x50 | with screws | | | |
| 68 | | CNA4.0x60 | without screws | | | | | | | | | | | | |
| 69 | | CSA5.0x50 | | | with screws | | | | | | | | | | |
| 70 | | CNA4.0x50 | 4-row | | | | Column | | | 80 | CNA4.0x60 | without screws | | | |
| 71 | | CNA4.0x60 | | with screws | | | | | | | | | | | |
| 72 | CSA5.0x50 | without screws | | | | | | | | | | | | | |
| 73 | CNA4.0x50 | | | 2-row | Column | | | 81 | CNA4.0x50 | with screws | | | | | |
| 74 | CNA4.0x60 | without screws | | | | | | | | | | | | | |
| 75 | CSA5.0x50 | | with screws | | | | | | | | | | | | |
| 76 | CNA4.0x50 | 4-row | | | | Column | | 82 | CNA4.0x60 | without screws | | | | | |
| 77 | CNA4.0x60 | | with screws | | | | | | | | | | | | |
| 78 | CSA5.0x50 | | | without screws | | | | | | | | | | | |
| 79 | CNA4.0x50 | | 2-row | | | | Column | 83 | CNA4.0x50 | with screws | | | | | |
| 80 | CNA4.0x60 | without screws | | | | | | | | | | | | | |
| 81 | CSA5.0x50 | | | with screws | | | | | | | | | | | |
| 82 | CNA4.0x50 | 4-row | | | Column | | | 84 | CNA4.0x60 | without screws | | | | | |
| 83 | CNA4.0x60 | | with screws | | | | | | | | | | | | |
| 84 | CSA5.0x50 | | | without screws | | | | | | | | | | | |
| 85 | CNA4.0x50 | | 2-row | | | Column | | 85 | CNA4.0x50 | with screws | | | | | |
| 86 | CNA4.0x60 | without screws | | | | | | | | | | | | | |
| 87 | CSA5.0x50 | | | with screws | | | | | | | | | | | |

Refer to Tables 1 to 12: for header with clamped or lateral hold, or nearly same load each side (free from rotation)

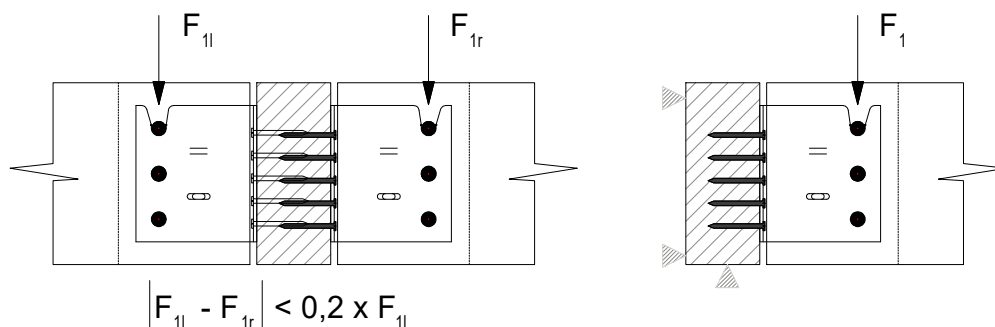

Refer to Tables 13 to 20: header free to rotate, and/or unequal load on both side

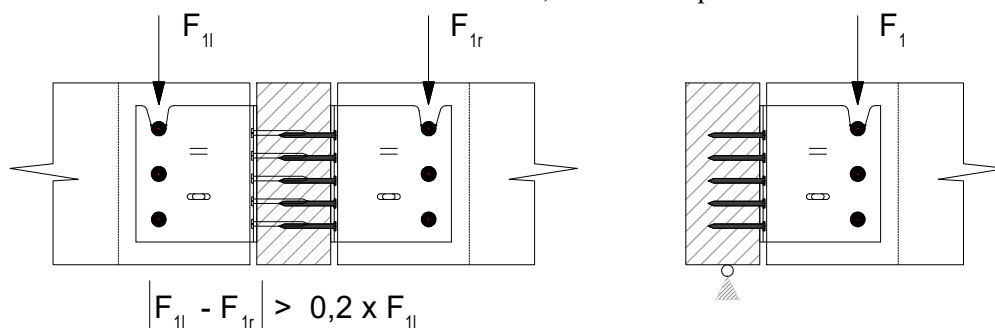

For tables 21 to 32: The note *with screws* or *without screws* means extra screws for an reinforcement of the timber perpendicular to the fibre.

Load direction F_2 (uplift)

The topmost steel dowel in the cut out hole shall not be considered.

The capacities for $R_{2,k}$ shall be modified in relation to one steel dowel less, e.g. for a BTN120/ BT120 with 3 steel dowels, the uplift capacity shall be reduced to: $(3-1) / 3 = 0,67$

For the BTN90/ BT4-90 it shall be $(4-1) / 4 = 0,75$

For the types 160 and up: the values have to be increased for the effective number of steel dowel, or simplified using the method as described before.


For combination of load direction the following equation should be used:

$$\left(\frac{F_{1,d}}{R_{1,d}} \right) + \left(\frac{F_{2,d}}{R_{2,d}} \right) + \left(\frac{F_{3,d}}{R_{3,d}} \right) + \left(\frac{F_{4,d}}{R_{4,d}} \right) \leq 1$$

F_1 and F_2 have to be considered independently

| R _{1,k} | | CNA 4,0x50 | | | | 4-row header | | | | SD: Ø 12mm | | | | C24 | | table 1 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 20 | 18,2 | 20 | 19,4 | 20 | 20,7 | 20 | 22,3 | 20 | 23,9 | 20 | 23,9 | | | | | |
| | 44 | 32,2 | 44 | 34,5 | 48 | 37,6 | 48 | 41,2 | 52 | 45,0 | 52 | 49,1 | | | | | |
| 4 | 28 | 29,5 | 28 | 31,2 | 28 | 33,3 | 28 | 35,7 | 28 | 38,2 | 28 | 38,5 | | | | | |
| | 48 | 43,0 | 52 | 46,1 | 56 | 50,1 | 56 | 55,0 | 60 | 60,1 | 64 | 65,5 | | | | | |
| 5 | 36 | 41,9 | 36 | 44,3 | 36 | 47,2 | 36 | 50,4 | 36 | 53,9 | 36 | 54,9 | | | | | |
| | 56 | 53,9 | 60 | 57,6 | 60 | 62,7 | 64 | 68,7 | 68 | 75,1 | 72 | 81,9 | | | | | |
| 6 | 44 | 54,9 | 44 | 57,9 | 44 | 61,7 | 44 | 65,9 | 44 | 70,3 | 44 | 72,3 | | | | | |
| | 64 | 64,6 | 64 | 69,2 | 68 | 75,3 | 72 | 82,4 | 76 | 90,1 | 80 | 98,3 | | | | | |
| 7 | 52 | 68,0 | 56 | 74,4 | 60 | 82,0 | 64 | 90,3 | 68 | 99,1 | 72 | 108,3 | | | | | |
| | 68 | 75,4 | 72 | 80,7 | 76 | 87,8 | 80 | 96,1 | 84 | 105,2 | 88 | 114,7 | | | | | |
| 8 | 56 | 78,5 | 60 | 85,5 | 64 | 93,8 | 68 | 103,0 | 72 | 112,8 | 80 | 125,7 | | | | | |
| | 72 | 86,2 | 76 | 92,3 | 80 | 100,5 | 84 | 109,9 | 88 | 120,2 | 96 | 131,2 | | | | | |
| 9 | 64 | 91,6 | 68 | 99,0 | 72 | 108,2 | 76 | 118,4 | 80 | 129,3 | 88 | 143,0 | | | | | |
| | 80 | 97,0 | 84 | 103,8 | 88 | 113,0 | 92 | 123,6 | 96 | 135,3 | 104 | 147,6 | | | | | |
| 10 | 68 | 102,2 | 72 | 110,3 | 76 | 120,2 | 80 | 131,4 | 88 | 145,5 | 92 | 158,0 | | | | | |
| | 84 | 107,8 | 88 | 115,4 | 92 | 125,6 | 96 | 137,4 | 104 | 150,3 | 108 | 164,0 | | | | | |
| 11 | 72 | 112,9 | 76 | 121,5 | 80 | 132,3 | 88 | 146,6 | 92 | 159,6 | 100 | 175,4 | | | | | |
| | 88 | 118,6 | 92 | 126,9 | 96 | 138,1 | 104 | 151,2 | 108 | 165,3 | 116 | 180,4 | | | | | |
| 12 | 76 | 123,6 | 80 | 132,9 | 88 | 146,5 | 92 | 159,7 | 100 | 175,8 | 100 | 188,1 | | | | | |
| | 92 | 129,3 | 96 | 138,4 | 104 | 150,7 | 108 | 164,9 | 116 | 180,4 | 116 | 195,8 | | | | | |


| R _{1,k} | | CNA 4,0x60 | | | | 4-row header | | | | SD: Ø 12mm | | | | C24 | | table 2 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 20 | 19,7 | 20 | 20,8 | 20 | 22,2 | 20 | 23,7 | 20 | 25,3 | 20 | 25,4 | | | | | |
| | 40 | 32,2 | 40 | 34,5 | 40 | 37,6 | 44 | 41,1 | 48 | 45,0 | 48 | 49,1 | | | | | |
| 4 | 28 | 31,8 | 28 | 33,5 | 28 | 35,6 | 28 | 37,9 | 28 | 40,4 | 28 | 40,9 | | | | | |
| | 44 | 43,1 | 48 | 46,1 | 48 | 50,2 | 52 | 54,9 | 52 | 60,0 | 56 | 65,6 | | | | | |
| 5 | 36 | 44,9 | 36 | 47,2 | 36 | 50,2 | 36 | 53,4 | 36 | 56,8 | 36 | 58,1 | | | | | |
| | 52 | 53,8 | 52 | 57,7 | 56 | 62,7 | 60 | 68,6 | 60 | 75,1 | 64 | 82,0 | | | | | |
| 6 | 44 | 58,4 | 44 | 61,4 | 44 | 65,2 | 44 | 69,5 | 44 | 73,9 | 44 | 76,3 | | | | | |
| | 56 | 64,6 | 60 | 69,2 | 60 | 75,3 | 64 | 82,5 | 68 | 90,2 | 72 | 98,4 | | | | | |
| 7 | 44 | 65,8 | 48 | 72,5 | 52 | 80,3 | 56 | 88,9 | 60 | 97,9 | 64 | 107,3 | | | | | |
| | 60 | 75,4 | 64 | 80,7 | 68 | 87,8 | 72 | 96,1 | 76 | 105,2 | 80 | 114,7 | | | | | |
| 8 | 52 | 79,5 | 52 | 83,8 | 56 | 92,4 | 60 | 101,8 | 64 | 111,8 | 72 | 125,2 | | | | | |
| | 68 | 86,2 | 68 | 92,3 | 72 | 100,5 | 76 | 109,9 | 80 | 120,3 | 88 | 131,2 | | | | | |
| 9 | 56 | 90,3 | 60 | 98,0 | 64 | 107,4 | 68 | 117,7 | 72 | 128,7 | 76 | 140,2 | | | | | |
| | 72 | 97,0 | 76 | 103,8 | 80 | 113,0 | 84 | 123,6 | 88 | 135,3 | 92 | 147,6 | | | | | |
| 10 | 60 | 101,1 | 64 | 109,4 | 68 | 119,6 | 72 | 130,8 | 76 | 142,8 | 84 | 158,0 | | | | | |
| | 76 | 107,8 | 80 | 115,3 | 84 | 125,5 | 88 | 137,4 | 92 | 150,3 | 100 | 164,0 | | | | | |
| 11 | 64 | 112,0 | 68 | 120,9 | 72 | 131,8 | 76 | 144,0 | 84 | 159,6 | 88 | 173,1 | | | | | |
| | 80 | 118,6 | 84 | 126,9 | 88 | 138,1 | 92 | 151,1 | 100 | 165,4 | 104 | 180,4 | | | | | |
| 12 | 68 | 122,9 | 72 | 132,4 | 80 | 146,4 | 84 | 159,6 | 88 | 173,7 | 96 | 190,9 | | | | | |
| | 84 | 129,4 | 88 | 138,5 | 96 | 150,7 | 100 | 164,9 | 104 | 180,4 | 112 | 196,8 | | | | | |




| R _{1,k} | | CSA 5,0x50 | | | | 4-row header | | | | SD: Ø 12mm | | | | C24 | | table 3 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 20 | 28,2 | 20 | 29,2 | 20 | 30,5 | 20 | 31,9 | 20 | 33,3 | 20 | 33,8 | | | | | |
| | 24 | 32,3 | 28 | 34,5 | 28 | 37,6 | 28 | 41,2 | 32 | 45,0 | 32 | 49,1 | | | | | |
| 4 | 28 | 42,7 | 28 | 44,6 | 28 | 46,9 | 28 | 49,2 | 28 | 51,5 | 28 | 52,8 | | | | | |
| | 32 | 43,0 | 32 | 46,1 | 32 | 50,2 | 36 | 54,9 | 36 | 60,1 | 40 | 65,5 | | | | | |
| 5 | 36 | 53,8 | 36 | 57,6 | 36 | 62,5 | 36 | 66,4 | 36 | 69,9 | 36 | 72,6 | | | | | |
| | 36 | 53,8 | 36 | 57,6 | 40 | 62,7 | 40 | 68,6 | 44 | 75,1 | 44 | 81,9 | | | | | |
| 6 | 44 | 64,6 | 44 | 69,2 | 44 | 75,3 | 44 | 82,3 | 44 | 87,9 | 44 | 92,4 | | | | | |
| | 40 | 64,6 | 40 | 69,2 | 44 | 75,3 | 48 | 82,4 | 48 | 90,1 | 52 | 98,3 | | | | | |
| 7 | 28 | 60,6 | 28 | 63,2 | 32 | 71,9 | 36 | 81,1 | 40 | 90,6 | 40 | 92,8 | | | | | |
| | 44 | 75,4 | 44 | 80,8 | 48 | 87,8 | 52 | 96,1 | 56 | 105,2 | 56 | 114,7 | | | | | |
| 8 | 32 | 71,6 | 32 | 74,5 | 36 | 83,7 | 40 | 93,4 | 44 | 103,5 | 48 | 112,8 | | | | | |
| | 48 | 86,2 | 48 | 92,3 | 52 | 100,4 | 56 | 109,9 | 60 | 120,2 | 64 | 131,2 | | | | | |
| 9 | 36 | 82,6 | 36 | 85,7 | 40 | 95,4 | 44 | 105,6 | 48 | 116,0 | 56 | 132,8 | | | | | |
| | 52 | 97,0 | 52 | 103,8 | 56 | 113,0 | 60 | 123,7 | 64 | 135,3 | 72 | 147,6 | | | | | |
| 10 | 40 | 93,6 | 44 | 102,8 | 44 | 106,9 | 52 | 123,9 | 56 | 135,0 | 60 | 145,5 | | | | | |
| | 56 | 107,8 | 60 | 115,3 | 60 | 125,5 | 68 | 137,4 | 72 | 150,3 | 76 | 164,0 | | | | | |
| 11 | 44 | 104,5 | 48 | 114,0 | 52 | 124,7 | 56 | 135,9 | 60 | 147,3 | 68 | 165,4 | | | | | |
| | 60 | 118,5 | 64 | 126,9 | 68 | 138,1 | 72 | 151,1 | 76 | 165,3 | 84 | 180,4 | | | | | |
| 12 | 48 | 115,3 | 52 | 125,2 | 56 | 136,3 | 60 | 147,7 | 68 | 166,2 | 72 | 177,7 | | | | | |
| | 64 | 129,3 | 68 | 138,4 | 72 | 150,7 | 76 | 164,9 | 84 | 180,4 | 88 | 196,8 | | | | | |

| R _{1,k} | | CNA 4,0x50 | | | | 2-row header | | | | SD: Ø 12mm | | | | C24 | | table 4 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 10 | 14,5 | 10 | 15,6 | 10 | 16,9 | 10 | 18,3 | 10 | 19,5 | 10 | 19,5 | | | | | |
| | 32 | 32,2 | 32 | 34,6 | 34 | 37,6 | 36 | 41,1 | 38 | 45,0 | 40 | 49,1 | | | | | |
| 4 | 14 | 23,2 | 14 | 24,7 | 14 | 26,6 | 14 | 28,5 | 14 | 30,1 | 14 | 30,1 | | | | | |
| | 36 | 43,0 | 38 | 46,2 | 40 | 50,2 | 42 | 55,0 | 44 | 60,0 | 48 | 65,5 | | | | | |
| 5 | 18 | 32,7 | 18 | 34,7 | 18 | 37,0 | 18 | 39,1 | 18 | 39,9 | 18 | 39,9 | | | | | |
| | 42 | 53,9 | 44 | 57,6 | 46 | 62,8 | 48 | 68,6 | 52 | 75,1 | 54 | 82,0 | | | | | |
| 6 | 22 | 42,6 | 22 | 45,0 | 22 | 47,5 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 46 | 64,6 | 50 | 69,2 | 52 | 75,3 | 54 | 82,4 | 58 | 90,2 | 58 | 97,0 | | | | | |
| 7 | 44 | 70,9 | 46 | 76,0 | 48 | 82,2 | 50 | 88,9 | 50 | 93,7 | 50 | 97,0 | | | | | |
| | 52 | 75,4 | 54 | 80,8 | 56 | 87,8 | 58 | 95,5 | 58 | 101,8 | 58 | 107,4 | | | | | |
| 8 | 48 | 81,4 | 50 | 87,0 | 50 | 91,9 | 50 | 97,0 | 50 | 101,9 | 50 | 104,4 | | | | | |
| | 56 | 86,2 | 58 | 92,2 | 58 | 98,8 | 58 | 105,1 | 58 | 111,1 | 58 | 115,5 | | | | | |
| 9 | 50 | 90,1 | 50 | 94,3 | 50 | 99,4 | 50 | 104,4 | 50 | 108,6 | 50 | 110,0 | | | | | |
| | 58 | 96,2 | 58 | 101,3 | 58 | 107,4 | 58 | 113,6 | 58 | 119,3 | 58 | 122,7 | | | | | |
| 10 | 50 | 96,9 | 50 | 101,2 | 50 | 106,1 | 50 | 110,0 | 50 | 110,8 | 50 | 110,8 | | | | | |
| | 58 | 104,2 | 58 | 109,2 | 58 | 115,2 | 58 | 121,1 | 58 | 126,0 | 58 | 127,8 | | | | | |
| 11 | 50 | 103,2 | 50 | 107,3 | 50 | 110,6 | 50 | 110,8 | 50 | 110,8 | 50 | 110,8 | | | | | |
| | 58 | 111,3 | 58 | 116,4 | 58 | 122,2 | 58 | 127,1 | 58 | 128,5 | 58 | 128,5 | | | | | |
| 12 | 50 | 108,6 | 50 | 110,8 | 50 | 110,8 | 50 | 110,8 | 50 | 110,8 | 50 | 110,8 | | | | | |
| | 58 | 118,0 | 58 | 122,8 | 58 | 127,5 | 58 | 128,5 | 58 | 128,5 | 58 | 128,5 | | | | | |

| R _{1,k} | | CNA 4,0x60 | | | | 2-row header | | | | SD: Ø 12mm | | | | C24 | | table 5 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 10 | 15,2 | 10 | 16,3 | 10 | 17,6 | 10 | 18,9 | 10 | 20,1 | 10 | 20,1 | | | | | |
| | 28 | 32,3 | 30 | 34,5 | 30 | 37,6 | 32 | 41,2 | 34 | 45,1 | 36 | 49,1 | | | | | |
| 4 | 14 | 24,3 | 14 | 25,8 | 14 | 27,6 | 14 | 29,5 | 14 | 31,3 | 14 | 31,3 | | | | | |
| | 34 | 43,0 | 34 | 46,1 | 36 | 50,2 | 38 | 55,0 | 40 | 60,1 | 42 | 65,5 | | | | | |
| 5 | 18 | 34,2 | 18 | 36,1 | 18 | 38,4 | 18 | 40,6 | 18 | 42,3 | 18 | 42,4 | | | | | |
| | 38 | 53,9 | 40 | 57,6 | 42 | 62,7 | 44 | 68,7 | 46 | 75,1 | 50 | 81,9 | | | | | |
| 6 | 22 | 44,5 | 22 | 46,8 | 22 | 49,4 | 22 | 51,6 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 42 | 64,7 | 44 | 69,2 | 46 | 75,3 | 50 | 82,4 | 52 | 90,1 | 56 | 98,4 | | | | | |
| 7 | 38 | 68,7 | 42 | 76,1 | 44 | 82,4 | 48 | 91,4 | 50 | 98,6 | 50 | 102,8 | | | | | |
| | 46 | 75,4 | 50 | 80,7 | 52 | 87,9 | 56 | 96,1 | 58 | 105,2 | 58 | 112,4 | | | | | |
| 8 | 44 | 81,6 | 46 | 87,4 | 48 | 94,3 | 50 | 101,7 | 50 | 106,8 | 50 | 110,0 | | | | | |
| | 52 | 86,2 | 54 | 92,3 | 56 | 100,4 | 58 | 109,1 | 58 | 116,2 | 58 | 122,1 | | | | | |
| 9 | 48 | 92,4 | 50 | 98,6 | 50 | 103,9 | 50 | 109,2 | 50 | 113,8 | 50 | 115,9 | | | | | |
| | 56 | 97,0 | 58 | 103,8 | 58 | 111,6 | 58 | 118,6 | 58 | 124,8 | 58 | 129,2 | | | | | |
| 10 | 50 | 101,2 | 50 | 105,6 | 50 | 110,8 | 50 | 115,4 | 50 | 118,1 | 50 | 118,2 | | | | | |
| | 58 | 107,5 | 58 | 113,4 | 58 | 120,1 | 58 | 126,5 | 58 | 132,0 | 58 | 134,8 | | | | | |
| 11 | 50 | 107,6 | 50 | 111,9 | 50 | 116,3 | 50 | 118,2 | 50 | 118,2 | 50 | 118,2 | | | | | |
| | 58 | 115,7 | 58 | 121,1 | 58 | 127,4 | 58 | 133,0 | 58 | 136,7 | 58 | 137,1 | | | | | |
| 12 | 50 | 113,3 | 50 | 116,8 | 50 | 118,2 | 50 | 118,2 | 50 | 118,2 | 50 | 118,2 | | | | | |
| | 58 | 122,7 | 58 | 127,9 | 58 | 133,5 | 58 | 137,0 | 58 | 137,1 | 58 | 137,1 | | | | | |




2-row



| R _{1,k} | | CSA 5,0x50 | | | | 2-row header | | | | SD: Ø 12mm | | | | C24 | | table 6 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 10 | 19,0 | 10 | 19,8 | 10 | 20,7 | 10 | 21,7 | 10 | 22,7 | 10 | 22,7 | | | | | |
| | 20 | 32,2 | 20 | 34,5 | 22 | 37,6 | 22 | 41,1 | 24 | 45,0 | 26 | 49,1 | | | | | |
| 4 | 14 | 29,3 | 14 | 30,4 | 14 | 31,6 | 14 | 32,8 | 14 | 33,9 | 14 | 33,9 | | | | | |
| | 24 | 43,0 | 24 | 46,1 | 26 | 50,1 | 28 | 54,9 | 30 | 60,0 | 32 | 65,5 | | | | | |
| 5 | 18 | 40,0 | 18 | 41,2 | 18 | 42,6 | 18 | 43,9 | 18 | 44,8 | 18 | 44,9 | | | | | |
| | 28 | 53,8 | 30 | 57,6 | 30 | 62,7 | 34 | 68,6 | 36 | 75,1 | 38 | 81,9 | | | | | |
| 6 | 22 | 50,8 | 22 | 52,2 | 22 | 53,6 | 22 | 54,7 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 32 | 64,6 | 34 | 69,2 | 36 | 75,3 | 38 | 82,4 | 42 | 90,1 | 44 | 98,3 | | | | | |
| 7 | 28 | 65,2 | 30 | 70,5 | 32 | 76,2 | 36 | 85,9 | 38 | 91,9 | 42 | 101,6 | | | | | |
| | 36 | 75,4 | 38 | 80,7 | 40 | 87,8 | 44 | 96,1 | 46 | 105,2 | 50 | 114,7 | | | | | |
| 8 | 32 | 76,0 | 34 | 81,5 | 36 | 87,4 | 40 | 97,3 | 44 | 107,5 | 48 | 117,5 | | | | | |
| | 40 | 86,2 | 42 | 92,2 | 44 | 100,4 | 48 | 109,9 | 52 | 120,2 | 56 | 131,2 | | | | | |
| 9 | 36 | 86,7 | 38 | 92,3 | 42 | 102,3 | 46 | 112,6 | 50 | 123,0 | 50 | 124,3 | | | | | |
| | 44 | 97,0 | 46 | 103,8 | 50 | 113,0 | 54 | 123,6 | 58 | 135,3 | 58 | 141,5 | | | | | |
| 10 | 40 | 97,3 | 42 | 103,0 | 46 | 113,2 | 50 | 123,6 | 50 | 125,1 | 50 | 125,5 | | | | | |
| | 48 | 107,8 | 50 | 115,4 | 54 | 125,5 | 58 | 137,3 | 58 | 142,4 | 58 | 144,3 | | | | | |
| 11 | 44 | 107,8 | 48 | 117,6 | 50 | 124,0 | 50 | 125,4 | 50 | 125,5 | 50 | 125,5 | | | | | |
| | 52 | 118,5 | 56 | 126,9 | 58 | 137,9 | 58 | 142,8 | 58 | 144,9 | 58 | 145,5 | | | | | |
| 12 | 48 | 118,3 | 50 | 124,2 | 50 | 125,4 | 50 | 125,5 | 50 | 125,5 | 50 | 125,5 | | | | | |
| | 56 | 129,3 | 58 | 138,1 | 58 | 142,9 | 58 | 145,1 | 58 | 145,6 | 58 | 145,6 | | | | | |

| R _{1,k} | | CNA 4,0x50 | | | | 4-row column | | | | SD: Ø 12mm | | | | C24 | | table 7 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 12 | 15,5 | 12 | 16,6 | 12 | 17,9 | 12 | 19,4 | 12 | 20,7 | 12 | 20,7 | | | | | |
| | 32 | 32,2 | 32 | 34,5 | 36 | 37,6 | 36 | 41,2 | 40 | 45,0 | 40 | 49,2 | | | | | |
| 4 | 16 | 24,4 | 16 | 26,0 | 16 | 27,9 | 16 | 30,0 | 16 | 32,0 | 16 | 32,0 | | | | | |
| | 40 | 43,0 | 40 | 46,1 | 40 | 50,2 | 44 | 54,9 | 48 | 60,0 | 48 | 65,5 | | | | | |
| 5 | 20 | 34,1 | 20 | 36,2 | 20 | 38,7 | 20 | 41,2 | 20 | 43,4 | 20 | 43,5 | | | | | |
| | 44 | 53,8 | 44 | 57,7 | 48 | 62,7 | 52 | 68,6 | 52 | 75,2 | 56 | 81,9 | | | | | |
| 6 | 24 | 44,3 | 24 | 46,8 | 24 | 49,7 | 24 | 52,3 | 24 | 53,2 | 24 | 53,2 | | | | | |
| | 48 | 64,6 | 52 | 69,2 | 52 | 75,4 | 56 | 82,4 | 60 | 90,1 | 60 | 98,0 | | | | | |
| 7 | 36 | 62,7 | 40 | 69,9 | 44 | 77,9 | 44 | 82,3 | 44 | 86,6 | 44 | 88,7 | | | | | |
| | 52 | 75,5 | 56 | 80,7 | 60 | 87,8 | 60 | 96,1 | 60 | 103,2 | 60 | 109,2 | | | | | |
| 8 | 40 | 73,4 | 44 | 81,0 | 44 | 85,4 | 44 | 90,0 | 44 | 94,1 | 44 | 95,5 | | | | | |
| | 56 | 86,2 | 60 | 92,2 | 60 | 99,7 | 60 | 106,6 | 60 | 112,9 | 60 | 118,0 | | | | | |
| 9 | 44 | 84,0 | 44 | 87,9 | 44 | 92,4 | 44 | 96,3 | 44 | 97,5 | 44 | 97,5 | | | | | |
| | 60 | 96,9 | 60 | 102,4 | 60 | 108,9 | 60 | 115,4 | 60 | 121,5 | 60 | 125,5 | | | | | |
| 10 | 44 | 90,4 | 44 | 94,1 | 44 | 97,3 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | | | | | |
| | 60 | 105,4 | 60 | 110,7 | 60 | 117,0 | 60 | 123,4 | 60 | 128,8 | 60 | 131,3 | | | | | |
| 11 | 44 | 95,8 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | | | | | |
| | 60 | 112,9 | 60 | 118,2 | 60 | 124,4 | 60 | 130,0 | 60 | 133,0 | 60 | 133,0 | | | | | |
| 12 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | | | | | |
| | 60 | 119,8 | 60 | 125,0 | 60 | 130,5 | 60 | 133,0 | 60 | 133,0 | 60 | 133,0 | | | | | |

| R _{1,k} | | CNA 4,0x60 | | | | 4-row column | | | | SD: Ø 12mm | | | | C24 | | table 8 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 12 | 16,5 | 12 | 17,5 | 12 | 18,8 | 12 | 20,2 | 12 | 21,6 | 12 | 21,6 | | | | | |
| | 28 | 32,3 | 32 | 34,5 | 32 | 37,6 | 32 | 41,1 | 36 | 45,0 | 36 | 49,2 | | | | | |
| 4 | 16 | 25,8 | 16 | 27,3 | 16 | 29,2 | 16 | 31,2 | 16 | 33,2 | 16 | 33,2 | | | | | |
| | 36 | 43,0 | 36 | 46,1 | 36 | 50,2 | 40 | 54,9 | 40 | 60,0 | 44 | 65,5 | | | | | |
| 5 | 20 | 35,9 | 20 | 37,9 | 20 | 40,3 | 20 | 42,8 | 20 | 45,1 | 20 | 45,3 | | | | | |
| | 40 | 53,8 | 40 | 57,7 | 44 | 62,7 | 44 | 68,7 | 48 | 75,1 | 52 | 81,9 | | | | | |
| 6 | 24 | 46,4 | 24 | 48,8 | 24 | 51,7 | 24 | 54,5 | 24 | 56,5 | 24 | 56,6 | | | | | |
| | 44 | 64,6 | 44 | 69,2 | 48 | 75,3 | 52 | 82,4 | 56 | 90,1 | 56 | 98,4 | | | | | |
| 7 | 32 | 61,7 | 36 | 69,2 | 36 | 72,9 | 40 | 81,8 | 44 | 91,0 | 44 | 93,6 | | | | | |
| | 48 | 75,4 | 52 | 80,7 | 52 | 87,9 | 56 | 96,1 | 60 | 105,2 | 60 | 113,8 | | | | | |
| 8 | 36 | 72,6 | 40 | 80,6 | 44 | 89,5 | 44 | 94,2 | 44 | 98,4 | 44 | 100,3 | | | | | |
| | 52 | 86,2 | 56 | 92,2 | 60 | 100,4 | 60 | 109,8 | 60 | 117,8 | 60 | 124,3 | | | | | |
| 9 | 40 | 83,4 | 44 | 91,9 | 44 | 96,4 | 44 | 100,7 | 44 | 103,7 | 44 | 104,0 | | | | | |
| | 56 | 97,0 | 60 | 103,8 | 60 | 112,5 | 60 | 120,3 | 60 | 127,0 | 60 | 132,1 | | | | | |
| 10 | 44 | 94,3 | 44 | 98,2 | 44 | 102,2 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | | | | | |
| | 60 | 107,8 | 60 | 114,5 | 60 | 121,8 | 60 | 128,7 | 60 | 134,8 | 60 | 138,2 | | | | | |
| 11 | 44 | 99,9 | 44 | 103,1 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | | | | | |
| | 60 | 117,0 | 60 | 122,8 | 60 | 129,5 | 60 | 135,8 | 60 | 140,5 | 60 | 141,7 | | | | | |
| 12 | 44 | 103,8 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | | | | | |
| | 60 | 124,5 | 60 | 130,0 | 60 | 136,2 | 60 | 140,9 | 60 | 141,8 | 60 | 141,8 | | | | | |




4-row column

| R _{1,k} | | CSA 5,0x50 | | | | 4-row column | | | | SD: Ø 12mm | | | | C24 | | table 9 | |
|------------------|---|------------|----------------|-------|----------------|--------------|----------------|-------|----------------|------------|----------------|-------|--|-----|--|---------|--|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 12 | 21,4 | 12 | 22,3 | 12 | 23,3 | 12 | 24,4 | 12 | 25,4 | 12 | 25,5 | | | | | |
| | 20 | 32,2 | 20 | 34,6 | 24 | 37,6 | 24 | 41,1 | 24 | 45,1 | 28 | 49,1 | | | | | |
| 4 | 16 | 32,1 | 16 | 33,3 | 16 | 34,6 | 16 | 35,9 | 16 | 37,2 | 16 | 37,4 | | | | | |
| | 24 | 43,0 | 28 | 46,1 | 28 | 50,1 | 28 | 54,9 | 32 | 60,0 | 32 | 65,5 | | | | | |
| 5 | 20 | 43,1 | 20 | 44,4 | 20 | 46,0 | 20 | 47,5 | 20 | 48,8 | 20 | 49,0 | | | | | |
| | 28 | 53,8 | 32 | 57,6 | 32 | 62,7 | 36 | 68,6 | 36 | 75,1 | 40 | 81,9 | | | | | |
| 6 | 24 | 54,1 | 24 | 55,6 | 24 | 57,3 | 24 | 58,8 | 24 | 59,8 | 24 | 60,0 | | | | | |
| | 32 | 64,6 | 36 | 69,2 | 36 | 75,3 | 40 | 82,4 | 44 | 90,1 | 44 | 98,3 | | | | | |
| 7 | 20 | 49,9 | 24 | 59,0 | 24 | 60,0 | 28 | 69,7 | 32 | 79,4 | 36 | 88,6 | | | | | |
| | 36 | 75,4 | 40 | 80,7 | 40 | 87,9 | 44 | 96,1 | 48 | 105,2 | 52 | 114,7 | | | | | |
| 8 | 24 | 60,0 | 28 | 69,5 | 32 | 79,2 | 32 | 80,2 | 36 | 90,1 | 40 | 99,7 | | | | | |
| | 40 | 86,2 | 44 | 92,2 | 48 | 100,4 | 48 | 109,9 | 52 | 120,3 | 56 | 131,2 | | | | | |
| 9 | 28 | 70,2 | 32 | 79,9 | 36 | 89,8 | 40 | 99,8 | 44 | 109,9 | 44 | 110,3 | | | | | |
| | 44 | 97,0 | 48 | 103,8 | 52 | 113,0 | 56 | 123,6 | 60 | 135,3 | 60 | 145,0 | | | | | |
| 10 | 32 | 80,3 | 36 | 90,2 | 40 | 100,2 | 44 | 110,3 | 44 | 110,4 | 44 | 110,4 | | | | | |
| | 48 | 107,8 | 52 | 115,3 | 56 | 125,5 | 60 | 137,4 | 60 | 146,1 | 60 | 148,8 | | | | | |
| 11 | 36 | 90,4 | 40 | 100,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | | | | | |
| | 52 | 118,5 | 56 | 126,9 | 60 | 138,1 | 60 | 146,5 | 60 | 149,4 | 60 | 150,3 | | | | | |
| 12 | 40 | 100,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | | | | | |
| | 56 | 129,3 | 60 | 138,4 | 60 | 146,5 | 60 | 149,5 | 60 | 150,6 | 60 | 150,6 | | | | | |


| R _{1,k} | | CNA 4,0x50 | | | | 2-row column | | | | SD: Ø 12mm | | | | C24 | | table | 10 |
|------------------|---|------------|----------------|------|----------------|--------------|----------------|------|----------------|------------|----------------|------|--|-----|--|-------|----|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 6 | 13,0 | 6 | 13,3 | 6 | 13,3 | 6 | 13,3 | 6 | 13,3 | 6 | 13,3 | | | | | |
| | 24 | 32,2 | 26 | 34,5 | 26 | 37,7 | 28 | 41,1 | 30 | 45,0 | 30 | 48,7 | | | | | |
| 4 | 8 | 17,7 | 8 | 17,7 | 8 | 17,7 | 8 | 17,7 | 8 | 17,7 | 8 | 17,7 | | | | | |
| | 28 | 43,0 | 30 | 46,1 | 30 | 49,4 | 30 | 51,8 | 30 | 53,9 | 30 | 55,3 | | | | | |
| 5 | 10 | 22,2 | 10 | 22,2 | 10 | 22,2 | 10 | 22,2 | 10 | 22,2 | 10 | 22,2 | | | | | |
| | 30 | 51,5 | 30 | 53,3 | 30 | 55,5 | 30 | 57,7 | 30 | 59,7 | 30 | 60,6 | | | | | |
| 6 | 12 | 26,6 | 12 | 26,6 | 12 | 26,6 | 12 | 26,6 | 12 | 26,6 | 12 | 26,6 | | | | | |
| | 30 | 56,6 | 30 | 58,4 | 30 | 60,6 | 30 | 62,8 | 30 | 64,6 | 30 | 65,0 | | | | | |
| 7 | 22 | 48,6 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 61,1 | 30 | 62,9 | 30 | 64,9 | 30 | 66,2 | 30 | 66,5 | 30 | 66,5 | | | | | |
| 8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 64,9 | 30 | 66,1 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | | | | | |
| 9 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | | | | | |
| 10 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | | | | | |
| 11 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | | | | | |
| 12 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | | | | | |
| | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | | | | | |

| R _{1,k} | | CNA 4,0x60 | | | | 2-row column | | | | SD: Ø 12mm | | | | C24 | | table | 11 |
|------------------|---|------------|----------------|------|----------------|--------------|----------------|------|----------------|------------|----------------|------|--|-----|--|-------|----|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 6 | 13,0 | 6 | 13,8 | 6 | 14,2 | 6 | 14,2 | 6 | 14,2 | 6 | 14,2 | | | | | |
| | 22 | 32,2 | 22 | 34,5 | 24 | 37,6 | 26 | 41,1 | 28 | 45,0 | 28 | 49,2 | | | | | |
| 4 | 8 | 18,9 | 8 | 18,9 | 8 | 18,9 | 8 | 18,9 | 8 | 18,9 | 8 | 18,9 | | | | | |
| | 26 | 43,0 | 28 | 46,1 | 30 | 50,1 | 30 | 54,8 | 30 | 57,8 | 30 | 59,8 | | | | | |
| 5 | 10 | 23,6 | 10 | 23,6 | 10 | 23,6 | 10 | 23,6 | 10 | 23,6 | 10 | 23,6 | | | | | |
| | 30 | 53,9 | 30 | 56,7 | 30 | 59,2 | 30 | 61,5 | 30 | 63,6 | 30 | 64,7 | | | | | |
| 6 | 12 | 28,4 | 12 | 28,4 | 12 | 28,4 | 12 | 28,4 | 12 | 28,4 | 12 | 28,4 | | | | | |
| | 30 | 60,2 | 30 | 62,1 | 30 | 64,3 | 30 | 66,4 | 30 | 68,3 | 30 | 68,8 | | | | | |
| 7 | 22 | 51,2 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 64,7 | 30 | 66,5 | 30 | 68,5 | 30 | 70,1 | 30 | 70,9 | 30 | 70,9 | | | | | |
| 8 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 68,4 | 30 | 69,9 | 30 | 70,8 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | | | | | |
| 9 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 70,7 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | | | | | |
| 10 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | | | | | |
| 11 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | | | | | |
| 12 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | | | | | |
| | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | | | | | |

| R _{1,k} | | CSA 5,0x50 | | | | 2-row column | | | | SD: Ø 12mm | | | | C24 | | table | 12 |
|------------------|---|------------|----------------|------|----------------|--------------|----------------|------|----------------|------------|----------------|------|--|-----|--|-------|----|
| no of SD | width of timber = length of the dowels [mm] | | | | | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | | | | | |
| | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | n _N | [kN] | | | | | |
| 3 | 6 | 14,2 | 6 | 14,7 | 6 | 15,0 | 6 | 15,1 | 6 | 15,1 | 6 | 15,1 | | | | | |
| | 16 | 32,2 | 18 | 34,5 | 18 | 37,6 | 20 | 41,1 | 22 | 45,0 | 22 | 49,1 | | | | | |
| 4 | 8 | 20,0 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | | | | | |
| | 20 | 43,0 | 22 | 46,1 | 24 | 50,1 | 24 | 55,0 | 26 | 60,1 | 28 | 65,6 | | | | | |
| 5 | 10 | 25,1 | 10 | 25,1 | 10 | 25,1 | 10 | 25,1 | 10 | 25,1 | 10 | 25,1 | | | | | |
| | 24 | 53,8 | 26 | 57,6 | 28 | 62,7 | 30 | 68,6 | 30 | 72,3 | 30 | 73,2 | | | | | |
| 6 | 12 | 30,1 | 12 | 30,1 | 12 | 30,1 | 12 | 30,1 | 12 | 30,1 | 12 | 30,1 | | | | | |
| | 28 | 64,6 | 30 | 69,2 | 30 | 72,4 | 30 | 73,5 | 30 | 74,3 | 30 | 74,5 | | | | | |
| 7 | 22 | 54,8 | 22 | 55,1 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 72,5 | 30 | 73,5 | 30 | 74,3 | 30 | 74,9 | 30 | 75,2 | 30 | 75,3 | | | | | |
| 8 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 74,2 | 30 | 74,8 | 30 | 75,2 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | | | | | |
| 9 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 75,1 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | | | | | |
| 10 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | | | | | |
| 11 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | | | | | |
| 12 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | | | | | |
| | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | | | | | |





2-row
column




| R _{1,k} | | CNA 4,0x60 | | 4-row | | The header is free to rotate, b _{HT} = 120mm | | table | | 13 | | |
|------------------|------------|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | CNA 4,0x60 | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 20 | 7,4 | 20 | 8,2 | 20 | 9,1 | 20 | 10,2 | 20 | 11,0 | 20 | 11,0 |
| 4 | 20 | 12,1 | 20 | 13,4 | 24 | 15,0 | 24 | 16,7 | 24 | 18,2 | 24 | 18,2 |
| 5 | 24 | 17,9 | 24 | 19,8 | 28 | 22,1 | 28 | 24,6 | 28 | 26,8 | 28 | 26,8 |
| 6 | 28 | 24,6 | 32 | 27,1 | 32 | 30,3 | 32 | 33,7 | 36 | 36,9 | 36 | 36,9 |
| 7 | 32 | 32,0 | 36 | 35,4 | 36 | 39,4 | 40 | 43,9 | 40 | 48,2 | 40 | 48,2 |
| 8 | 20 | 14,9 | 24 | 20,6 | 24 | 20,6 | 28 | 27,0 | 32 | 34,1 | 32 | 34,1 |
| | 36 | 40,2 | 40 | 44,4 | 40 | 49,4 | 44 | 55,0 | 48 | 60,7 | 48 | 60,7 |
| 9 | 24 | 20,6 | 28 | 27,0 | 32 | 34,1 | 32 | 34,1 | 36 | 41,7 | 36 | 41,7 |
| | 40 | 49,1 | 44 | 54,1 | 48 | 60,2 | 48 | 66,9 | 52 | 74,1 | 52 | 74,2 |
| 10 | 32 | 34,1 | 32 | 34,1 | 36 | 41,7 | 40 | 49,8 | 44 | 58,3 | 44 | 58,3 |
| | 48 | 58,4 | 48 | 64,3 | 52 | 71,5 | 56 | 79,4 | 60 | 87,9 | 60 | 88,5 |
| 11 | 36 | 41,7 | 36 | 41,7 | 40 | 49,8 | 44 | 58,3 | 48 | 67,2 | 48 | 67,2 |
| | 52 | 68,2 | 52 | 75,0 | 56 | 83,3 | 60 | 92,5 | 64 | 102,4 | 64 | 103,5 |
| 12 | 40 | 49,8 | 44 | 58,3 | 48 | 67,2 | 52 | 76,3 | 56 | 85,7 | 56 | 85,7 |
| | 56 | 78,4 | 60 | 86,1 | 64 | 95,6 | 68 | 106,1 | 72 | 117,3 | 72 | 119,2 |

| R _{1,k} | | CNA 4,0x60 | | 4-row | | The header is free to rotate, b _{HT} = 180mm | | table | | 14 | | |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 20 | 6,2 | 20 | 6,9 | 20 | 7,7 | 20 | 8,6 | 20 | 9,3 | 20 | 9,3 |
| 4 | 20 | 10,2 | 24 | 11,3 | 24 | 12,7 | 24 | 14,1 | 28 | 15,3 | 28 | 15,3 |
| 5 | 28 | 15,1 | 28 | 16,8 | 28 | 18,7 | 32 | 20,9 | 32 | 22,7 | 32 | 22,7 |
| 6 | 32 | 20,9 | 32 | 23,1 | 36 | 25,8 | 36 | 28,8 | 40 | 31,3 | 40 | 31,3 |
| 7 | 20 | 10,2 | 24 | 14,3 | 24 | 14,3 | 28 | 18,9 | 28 | 18,9 | 28 | 18,9 |
| | 36 | 27,4 | 40 | 30,4 | 40 | 33,9 | 44 | 37,7 | 44 | 41,2 | 44 | 41,2 |
| 8 | 24 | 14,3 | 28 | 18,9 | 28 | 18,9 | 32 | 24,1 | 36 | 29,9 | 36 | 29,9 |
| | 40 | 34,7 | 44 | 38,3 | 44 | 42,7 | 48 | 47,6 | 52 | 52,1 | 52 | 52,1 |
| 9 | 28 | 18,9 | 32 | 24,1 | 36 | 29,9 | 40 | 36,1 | 40 | 36,1 | 40 | 36,1 |
| | 44 | 42,6 | 48 | 47,0 | 52 | 52,3 | 56 | 58,3 | 56 | 64,1 | 56 | 64,1 |
| 10 | 36 | 29,9 | 36 | 29,9 | 40 | 36,1 | 44 | 42,8 | 48 | 49,9 | 48 | 49,9 |
| | 52 | 51,0 | 52 | 56,2 | 56 | 62,6 | 60 | 69,7 | 64 | 76,9 | 64 | 76,9 |
| 11 | 40 | 36,1 | 44 | 42,8 | 48 | 49,9 | 48 | 49,9 | 52 | 57,4 | 56 | 65,2 |
| | 56 | 59,9 | 60 | 66,0 | 64 | 73,5 | 64 | 81,7 | 68 | 90,4 | 72 | 90,6 |
| 12 | 44 | 42,8 | 48 | 49,9 | 52 | 57,4 | 56 | 65,2 | 60 | 73,4 | 60 | 73,4 |
| | 60 | 69,3 | 64 | 76,3 | 68 | 84,8 | 72 | 94,3 | 76 | 104,3 | 76 | 104,9 |




| R _{1,k} | | CSA 5,0x50 | | 4-row | | The header is free to rotate, b _{HT} = 120mm | | table | | 15 | | |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 20 | 7,4 | 20 | 8,2 | 20 | 9,1 | 20 | 10,2 | 20 | 11,0 | 20 | 11,0 |
| 4 | 20 | 12,1 | 20 | 13,4 | 20 | 15,0 | 20 | 16,7 | 20 | 18,2 | 20 | 18,2 |
| 5 | 20 | 17,9 | 20 | 19,8 | 20 | 22,1 | 20 | 24,6 | 20 | 26,8 | 20 | 26,8 |
| 6 | 20 | 24,6 | 20 | 27,1 | 20 | 30,3 | 24 | 33,7 | 24 | 36,9 | 24 | 36,9 |
| 7 | 24 | 32,0 | 24 | 35,4 | 24 | 39,4 | 28 | 43,9 | 28 | 48,2 | 28 | 48,2 |
| 8 | 24 | 40,2 | 28 | 44,4 | 28 | 49,4 | 32 | 55,0 | 32 | 60,7 | 32 | 60,7 |
| 9 | 28 | 49,1 | 32 | 54,1 | 32 | 60,2 | 36 | 66,9 | 40 | 74,1 | 40 | 74,2 |
| 10 | 32 | 58,4 | 36 | 64,3 | 36 | 71,5 | 40 | 79,4 | 44 | 87,9 | 44 | 88,5 |
| 11 | 20 | 30,9 | 24 | 40,7 | 28 | 50,9 | 28 | 50,9 | 32 | 61,4 | 32 | 61,4 |
| | 36 | 68,2 | 40 | 75,0 | 44 | 83,3 | 44 | 92,5 | 48 | 102,4 | 48 | 103,5 |
| 12 | 24 | 40,7 | 28 | 50,9 | 32 | 61,4 | 36 | 72,1 | 40 | 82,8 | 40 | 82,8 |
| | 40 | 78,4 | 44 | 86,1 | 48 | 95,6 | 52 | 106,1 | 56 | 117,3 | 56 | 119,2 |


| R _{1,k} | | CSA 5,0x50 | | 4-row | | The header is free to rotate, b _{HT} = 180mm | | table | | 16 | | |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 20 | 6,2 | 20 | 6,9 | 20 | 7,7 | 20 | 8,6 | 20 | 9,3 | 20 | 9,3 |
| 4 | 20 | 10,2 | 20 | 11,3 | 20 | 12,7 | 20 | 14,1 | 20 | 15,3 | 20 | 15,3 |
| 5 | 20 | 15,1 | 20 | 16,8 | 20 | 18,7 | 20 | 20,9 | 20 | 22,7 | 20 | 22,7 |
| 6 | 20 | 20,9 | 20 | 23,1 | 24 | 25,8 | 24 | 28,8 | 24 | 31,3 | 24 | 31,3 |
| 7 | 24 | 27,4 | 24 | 30,4 | 28 | 33,9 | 28 | 37,7 | 32 | 41,2 | 32 | 41,2 |
| 8 | 28 | 34,7 | 28 | 38,3 | 32 | 42,7 | 32 | 47,6 | 36 | 52,1 | 36 | 52,1 |
| 9 | 32 | 42,6 | 32 | 47,0 | 36 | 52,3 | 36 | 58,3 | 40 | 64,1 | 40 | 64,1 |
| 10 | 20 | 23,2 | 20 | 23,2 | 24 | 31,4 | 24 | 31,4 | 28 | 40,4 | 28 | 40,4 |
| | 36 | 51,0 | 36 | 56,2 | 40 | 62,6 | 40 | 69,7 | 44 | 76,9 | 44 | 76,9 |
| 11 | 24 | 31,4 | 24 | 31,4 | 28 | 40,4 | 32 | 49,9 | 32 | 49,9 | 32 | 49,9 |
| | 40 | 59,9 | 40 | 66,0 | 44 | 73,5 | 48 | 81,7 | 48 | 90,4 | 48 | 90,6 |
| 12 | 24 | 31,4 | 28 | 40,4 | 32 | 49,9 | 36 | 59,8 | 40 | 70,0 | 40 | 70,0 |
| | 40 | 69,3 | 44 | 76,3 | 48 | 84,8 | 52 | 94,3 | 56 | 104,3 | 56 | 104,9 |




| R _{1,k} | | CNA 4,0x60 | | 2-row | | The header is free to rotate, b _{HT} = 120mm | | table | | 17 | | |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 10 | 7,4 | 12 | 8,2 | 12 | 9,1 | 12 | 10,2 | 14 | 11,0 | 14 | 11,0 |
| 4 | 14 | 12,1 | 14 | 13,4 | 16 | 15,0 | 16 | 16,7 | 18 | 18,2 | 18 | 18,2 |
| 5 | 18 | 17,9 | 18 | 19,8 | 20 | 22,1 | 20 | 24,6 | 22 | 26,8 | 22 | 26,8 |
| 6 | 20 | 24,6 | 22 | 27,1 | 24 | 30,3 | 26 | 33,7 | 26 | 36,9 | 26 | 36,9 |
| 7 | 16 | 17,0 | 18 | 20,9 | 20 | 24,9 | 22 | 29,2 | 24 | 33,6 | 24 | 33,6 |
| | 24 | 32,0 | 26 | 35,4 | 28 | 39,4 | 30 | 43,9 | 32 | 48,2 | 32 | 48,2 |
| 8 | 20 | 24,9 | 22 | 29,2 | 24 | 33,6 | 26 | 38,2 | 28 | 42,9 | 28 | 42,9 |
| | 28 | 40,2 | 30 | 44,4 | 32 | 49,4 | 34 | 55,0 | 36 | 60,7 | 36 | 60,7 |
| 9 | 24 | 33,6 | 26 | 38,2 | 28 | 42,9 | 30 | 47,6 | 34 | 57,4 | 34 | 57,4 |
| | 32 | 49,1 | 34 | 54,1 | 36 | 60,2 | 38 | 66,9 | 42 | 74,1 | 42 | 74,2 |
| 10 | 28 | 42,9 | 30 | 47,6 | 32 | 52,5 | 36 | 62,4 | 40 | 72,5 | 40 | 72,5 |
| | 36 | 58,4 | 38 | 64,3 | 40 | 71,5 | 44 | 79,4 | 48 | 87,9 | 48 | 88,5 |
| 11 | 32 | 52,5 | 34 | 57,4 | 38 | 67,5 | 40 | 72,5 | 44 | 82,7 | 46 | 87,8 |
| | 40 | 68,2 | 42 | 75,0 | 46 | 83,3 | 48 | 92,5 | 52 | 102,4 | 54 | 103,5 |
| 12 | 36 | 62,4 | 38 | 67,5 | 42 | 77,6 | 46 | 87,8 | 50 | 98,0 | 50 | 98,0 |
| | 44 | 78,4 | 46 | 86,1 | 50 | 95,6 | 54 | 106,1 | 58 | 117,3 | 58 | 118,4 |




2-row




| R _{1,k} | | CNA 4,0x60 | | 2-row | | The header is free to rotate, b _{HT} = 180mm | | table | | 18 | | |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] |
| 3 | 10 | 5,1 | 10 | 5,1 | 10 | 5,1 | 10 | 5,1 | 10 | 5,1 | 10 | 5,1 |
| | 12 | 6,2 | 12 | 6,9 | 14 | 7,7 | 14 | 8,6 | 14 | 9,3 | 14 | 9,3 |
| 4 | 14 | 9,5 | 14 | 9,5 | 14 | 9,5 | 14 | 9,5 | 14 | 9,5 | 14 | 9,5 |
| | 16 | 10,2 | 16 | 11,3 | 18 | 12,7 | 18 | 14,1 | 20 | 15,3 | 20 | 15,3 |
| 5 | 18 | 14,9 | 18 | 14,9 | 18 | 14,9 | 18 | 14,9 | 18 | 14,9 | 18 | 14,9 |
| | 20 | 15,1 | 20 | 16,8 | 22 | 18,7 | 22 | 20,9 | 24 | 22,7 | 24 | 22,7 |
| 6 | 22 | 20,9 | 24 | 23,1 | 26 | 25,8 | 28 | 28,8 | 28 | 31,3 | 28 | 31,3 |
| 7 | 18 | 14,9 | 20 | 18,1 | 22 | 21,4 | 24 | 25,0 | 26 | 28,7 | 26 | 28,7 |
| | 26 | 27,4 | 28 | 30,4 | 30 | 33,9 | 32 | 37,7 | 34 | 41,2 | 34 | 41,2 |
| 8 | 22 | 21,4 | 24 | 25,0 | 26 | 28,7 | 28 | 32,6 | 30 | 36,7 | 30 | 36,7 |
| | 30 | 34,7 | 32 | 38,3 | 34 | 42,7 | 36 | 47,6 | 38 | 52,1 | 38 | 52,1 |
| 9 | 26 | 28,7 | 28 | 32,6 | 30 | 36,7 | 32 | 40,9 | 36 | 49,7 | 36 | 49,7 |
| | 34 | 42,6 | 36 | 47,0 | 38 | 52,3 | 40 | 58,3 | 44 | 64,1 | 44 | 64,1 |
| 10 | 30 | 36,7 | 32 | 40,9 | 34 | 45,3 | 38 | 54,3 | 40 | 58,9 | 40 | 58,9 |
| | 38 | 51,0 | 40 | 56,2 | 42 | 62,6 | 46 | 69,7 | 48 | 76,9 | 48 | 76,9 |
| 11 | 34 | 45,3 | 36 | 49,7 | 40 | 58,9 | 42 | 63,6 | 46 | 73,3 | 46 | 73,3 |
| | 42 | 59,9 | 44 | 66,0 | 48 | 73,5 | 50 | 81,7 | 54 | 90,4 | 54 | 90,6 |
| 12 | 38 | 54,3 | 40 | 58,9 | 44 | 68,4 | 48 | 78,1 | 50 | 83,1 | 50 | 83,1 |
| | 46 | 69,3 | 48 | 76,3 | 52 | 84,8 | 56 | 94,3 | 58 | 103,1 | 58 | 103,1 |




| R _{1,k} | | CSA 5,0x50 | | 2-row | | The header is free to rotate, b _{HT} = 120mm | | | | | | table | 19 |
|------------------|---|------------|-----|-------|-----|---|-----|-------|-----|-------|-----|-------|----|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | |
| 3 | 10 | 7,4 | 10 | 8,2 | 10 | 9,1 | 10 | 10,2 | 10 | 11,0 | 10 | 11,0 | |
| | 10 | 12,1 | 10 | 13,4 | 10 | 15,0 | 12 | 16,7 | 12 | 18,2 | 12 | 18,2 | |
| 4 | 12 | 17,9 | 12 | 19,8 | 14 | 22,1 | 14 | 24,6 | 16 | 26,8 | 16 | 26,8 | |
| | 14 | 24,6 | 16 | 27,1 | 16 | 30,3 | 18 | 33,7 | 20 | 36,9 | 20 | 36,9 | |
| 7 | 10 | 15,5 | 10 | 15,5 | 12 | 20,4 | 14 | 25,5 | 16 | 30,7 | 16 | 30,7 | |
| | 18 | 32,0 | 18 | 35,4 | 20 | 39,4 | 22 | 43,9 | 24 | 48,2 | 24 | 48,2 | |
| 8 | 12 | 20,4 | 14 | 25,5 | 16 | 30,7 | 18 | 36,0 | 20 | 41,4 | 20 | 41,4 | |
| | 20 | 40,2 | 22 | 44,4 | 24 | 49,4 | 26 | 55,0 | 28 | 60,7 | 28 | 60,7 | |
| 9 | 16 | 30,7 | 18 | 36,0 | 20 | 41,4 | 22 | 46,8 | 26 | 57,5 | 26 | 57,5 | |
| | 24 | 49,1 | 26 | 54,1 | 28 | 60,2 | 30 | 66,9 | 34 | 74,1 | 34 | 74,2 | |
| 10 | 20 | 41,4 | 22 | 46,8 | 24 | 52,1 | 28 | 62,9 | 30 | 68,2 | 30 | 68,2 | |
| | 28 | 58,4 | 30 | 64,3 | 32 | 71,5 | 36 | 79,4 | 38 | 87,9 | 38 | 88,5 | |
| 11 | 22 | 46,8 | 26 | 57,5 | 28 | 62,9 | 32 | 73,5 | 36 | 84,1 | 36 | 84,1 | |
| | 30 | 68,2 | 34 | 75,0 | 36 | 83,3 | 40 | 92,5 | 44 | 102,4 | 44 | 103,5 | |
| 12 | 26 | 57,5 | 30 | 68,2 | 34 | 78,8 | 38 | 89,3 | 42 | 99,8 | 42 | 99,8 | |
| | 34 | 78,4 | 38 | 86,1 | 42 | 95,6 | 46 | 106,1 | 50 | 117,3 | 50 | 119,2 | |



2-row



| R _{1,k} | | CSA 5,0x50 | | 2-row | | The header is free to rotate, b _{HT} = 180mm | | | | | | table | 20 |
|------------------|---|------------|-----|-------|-----|---|-----|------|-----|-------|-----|-------|----|
| Length SD [mm] | width of timber = length of the dowels [mm] | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Anzahl SD | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | n | [kN] | |
| 3 | 10 | 6,2 | 10 | 6,9 | 10 | 7,7 | 10 | 8,6 | 10 | 9,3 | 10 | 9,3 | |
| | 10 | 10,2 | 10 | 11,3 | 12 | 12,7 | 12 | 14,1 | 12 | 15,3 | 12 | 15,3 | |
| 4 | 12 | 15,1 | 14 | 16,8 | 14 | 18,7 | 16 | 20,9 | 16 | 22,7 | 16 | 22,7 | |
| | 16 | 20,9 | 16 | 23,1 | 18 | 25,8 | 18 | 28,8 | 20 | 31,3 | 20 | 31,3 | |
| 7 | 10 | 11,6 | 12 | 15,7 | 12 | 15,7 | 14 | 20,2 | 16 | 24,9 | 16 | 24,9 | |
| | 18 | 27,4 | 20 | 30,4 | 20 | 33,9 | 22 | 37,7 | 24 | 41,2 | 24 | 41,2 | |
| 8 | 12 | 15,7 | 14 | 20,2 | 16 | 24,9 | 18 | 29,9 | 20 | 35,0 | 20 | 35,0 | |
| | 20 | 34,7 | 22 | 38,3 | 24 | 42,7 | 26 | 47,6 | 28 | 52,1 | 28 | 52,1 | |
| 9 | 16 | 24,9 | 18 | 29,9 | 20 | 35,0 | 22 | 40,2 | 24 | 45,5 | 24 | 45,5 | |
| | 24 | 42,6 | 26 | 47,0 | 28 | 52,3 | 30 | 58,3 | 32 | 64,1 | 32 | 64,1 | |
| 10 | 20 | 35,0 | 20 | 35,0 | 24 | 45,5 | 26 | 50,8 | 28 | 56,2 | 28 | 56,2 | |
| | 28 | 51,0 | 28 | 56,2 | 32 | 62,6 | 34 | 69,7 | 36 | 76,9 | 36 | 76,9 | |
| 11 | 22 | 40,2 | 24 | 45,5 | 28 | 56,2 | 30 | 61,6 | 34 | 72,4 | 34 | 72,4 | |
| | 30 | 59,9 | 32 | 66,0 | 36 | 73,5 | 38 | 81,7 | 42 | 90,4 | 42 | 90,6 | |
| 12 | 26 | 50,8 | 28 | 56,2 | 32 | 67,0 | 36 | 77,8 | 38 | 83,2 | 40 | 88,6 | |
| | 34 | 69,3 | 36 | 76,3 | 40 | 84,8 | 44 | 94,3 | 46 | 104,3 | 48 | 104,9 | |





R_{3,k} beam to beam

| R _{3,k} | CNA 4,0x50 | | | with screws * | | | | | | | table |
|------------------|------------|------------|----------------------|---------------|------|------|------|------|------|------|-------|
| | number of | joist min. | width of timber [mm] | | | | | | | | 21 |
| Type | SD | nails | b / h [mm] | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 90-2 | 4 | 8 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,7 | 5,7 | 5,7 | 5,7 | |
| 120-2 | 3 | 10 | ... / 160 | 2,0 | 3,1 | 4,8 | 4,8 | 4,8 | 4,8 | 4,8 | |
| 160-2 | 4 | 14 | ... / 200 | 2,7 | 4,2 | 6,5 | 6,5 | 6,5 | 6,5 | 6,5 | |
| 200-2 | 5 | 18 | ... / 240 | 3,3 | 4,7 | 7,3 | 8,3 | 8,3 | 8,3 | 8,3 | |
| 240-2 | 6 | 22 | ... / 280 | 4,0 | 5,0 | 7,7 | 10,0 | 10,0 | 10,0 | 10,0 | |
| 280-2 | 7 | 26 | ... / 320 | 4,6 | 5,8 | 8,1 | 11,7 | 11,8 | 11,8 | 11,8 | |
| 320-2 | 8 | 30 | ... / 360 | 5,2 | 6,5 | 8,6 | 12,4 | 13,6 | 13,6 | 13,6 | |
| 360-2 | 9 | 34 | ... / 400 | 5,8 | 7,2 | 9,1 | 13,0 | 15,4 | 15,4 | 15,4 | |
| 400-2 | 10 | 38 | ... / 440 | 6,5 | 7,9 | 9,7 | 13,7 | 17,2 | 17,2 | 17,2 | |
| 440-2 | 11 | 42 | ... / 480 | 7,2 | 8,7 | 10,6 | 14,4 | 18,8 | 19,1 | 19,1 | |
| 480-2 | 12 | 46 | ... / 520 | 7,8 | 9,6 | 11,4 | 14,4 | 19,7 | 20,9 | 20,9 | |
| 520-2 | 12 | 50 | ... / 560 | 8,5 | 10,4 | 12,3 | 15,2 | 20,2 | 22,7 | 22,7 | |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,2 | 15,4 | 21,1 | 24,5 | 24,5 | |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,1 | 16,6 | 21,5 | 26,4 | 26,4 | |
| 90-4 | 4 | 16 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,8 | 6,8 | 7,8 | 8,9 | |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 10,5 | |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 4,7 | 7,3 | 9,9 | 12,5 | 13,7 | 13,7 | |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 5,0 | 8,1 | 13,0 | 16,7 | 17,1 | 17,1 | |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,4 | 8,6 | 13,7 | 19,7 | 20,5 | 20,5 | |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 21,1 | 24,0 | 24,0 | |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 9,6 | 14,4 | 21,1 | 27,6 | 27,6 | |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,7 | 14,5 | 21,8 | 30,0 | 31,2 | |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,3 | 15,2 | 22,2 | 32,0 | 34,8 | |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 32,0 | 38,4 | |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 32,0 | 41,6 | |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 32,0 | 44,0 | |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,9 | 23,4 | 33,6 | 45,1 | |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 33,6 | 46,1 | |



screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel



| R _{3,k} | CNA 4,0x50 | | | without screws * | | | | | | | table |
|------------------|------------|-------|----------------------|------------------|------|------|------|------|------|------|-------|
| | number of | joist | width of timber [mm] | | | | | | | | 22 |
| Type | SD | nails | b / h [mm] | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 90-2 | 4 | 8 | ... / 100 | 1,4 | 1,8 | 2,2 | 2,6 | 3,0 | 3,4 | 3,8 | |
| 120-2 | 3 | 10 | ... / 160 | 2,0 | 2,6 | 3,2 | 3,8 | 4,4 | 4,9 | 4,8 | |
| 160-2 | 4 | 14 | ... / 200 | 2,7 | 3,4 | 4,1 | 4,8 | 5,6 | 6,2 | 6,5 | |
| 200-2 | 5 | 18 | ... / 240 | 3,3 | 4,1 | 5,1 | 5,9 | 6,7 | 7,7 | 8,3 | |
| 240-2 | 6 | 22 | ... / 280 | 4,0 | 4,9 | 5,9 | 6,9 | 8,1 | 8,9 | 9,9 | |
| 280-2 | 7 | 26 | ... / 320 | 4,6 | 5,8 | 6,8 | 8,2 | 9,2 | 10,5 | 11,4 | |
| 320-2 | 8 | 30 | ... / 360 | 5,2 | 6,5 | 7,9 | 9,2 | 10,4 | 11,8 | 12,9 | |
| 360-2 | 9 | 34 | ... / 400 | 5,8 | 7,2 | 8,8 | 10,2 | 11,6 | 13,1 | 14,6 | |
| 400-2 | 10 | 38 | ... / 440 | 6,5 | 7,9 | 9,7 | 11,3 | 12,9 | 14,5 | 16,1 | |
| 440-2 | 11 | 42 | ... / 480 | 7,2 | 8,7 | 10,6 | 12,3 | 14,3 | 15,8 | 17,6 | |
| 480-2 | 12 | 46 | ... / 520 | 7,8 | 9,6 | 11,4 | 13,3 | 15,5 | 17,1 | 19,0 | |
| 520-2 | 12 | 50 | ... / 560 | 8,5 | 10,4 | 12,3 | 14,3 | 16,7 | 18,6 | 20,5 | |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,2 | 15,4 | 17,9 | 20,0 | 22,0 | |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,1 | 16,6 | 19,1 | 21,6 | 23,4 | |
| 90-4 | 4 | 16 | ... / 100 | 1,5 | 1,9 | 2,3 | 2,7 | 3,1 | 3,6 | 4,0 | |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 | |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 | |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 | |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 | |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 | |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | |



Type: the first number gives the size of the concealed joist hangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2



R_{3,k} beam to beam

| R _{3,k} | CNA 4,0x60 | | joist min. b / h [mm] | with screws * | | | | | | table 23 |
|------------------|------------|-------|--------------------------|----------------------|------|------|------|------|------|----------|
| | number of | | | width of timber [mm] | | | | | | |
| Type | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| 90-2 | 4 | 8 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,8 | 6,8 | 6,9 | 6,9 |
| 120-2 | 3 | 10 | ... / 160 | 2,2 | 3,1 | 4,8 | 5,8 | 5,8 | 5,8 | 5,8 |
| 160-2 | 4 | 14 | ... / 200 | 2,9 | 4,7 | 7,1 | 7,9 | 7,9 | 7,9 | 7,9 |
| 200-2 | 5 | 18 | ... / 240 | 3,5 | 5,0 | 7,8 | 10,0 | 10,0 | 10,0 | 10,0 |
| 240-2 | 6 | 22 | ... / 280 | 4,2 | 5,4 | 8,6 | 11,9 | 12,1 | 12,1 | 12,1 |
| 280-2 | 7 | 26 | ... / 320 | 4,8 | 6,1 | 9,1 | 12,9 | 14,3 | 14,3 | 14,3 |
| 320-2 | 8 | 30 | ... / 360 | 5,5 | 6,8 | 9,6 | 13,7 | 16,5 | 16,5 | 16,5 |
| 360-2 | 9 | 34 | ... / 400 | 6,1 | 7,6 | 9,7 | 14,4 | 18,6 | 18,6 | 18,6 |
| 400-2 | 10 | 38 | ... / 440 | 6,7 | 8,3 | 10,3 | 15,0 | 19,9 | 20,8 | 20,8 |
| 440-2 | 11 | 42 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 20,8 | 23,0 | 23,0 |
| 480-2 | 12 | 46 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 21,3 | 25,2 | 25,2 |
| 520-2 | 12 | 50 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 22,2 | 27,4 | 27,4 |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,9 | 23,4 | 29,2 | 29,6 |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 23,4 | 30,6 | 31,8 |
| 90-4 | 4 | 16 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,8 | 6,8 | 7,8 | 8,9 |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 4,7 | 7,3 | 9,9 | 12,5 | 15,1 | 16,5 |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 5,0 | 8,1 | 13,0 | 16,7 | 20,2 | 20,6 |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,4 | 8,6 | 13,7 | 20,2 | 23,5 | 24,8 |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 21,1 | 26,7 | 29,0 |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 9,6 | 14,4 | 21,1 | 29,9 | 33,3 |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,7 | 14,5 | 21,8 | 30,6 | 37,5 |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,3 | 15,2 | 22,2 | 32,0 | 41,2 |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 32,0 | 44,0 |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 32,0 | 44,0 |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 32,0 | 44,0 |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,9 | 23,4 | 33,6 | 45,1 |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 33,6 | 46,1 |



screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel



| R _{3,k} | CNA 4,0x60 | | joist min. b / h [mm] | without screws * | | | | | | table 24 |
|------------------|------------|-------|--------------------------|----------------------|------|------|------|------|------|----------|
| | number of | | | width of timber [mm] | | | | | | |
| Type | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| 90-2 | 4 | 8 | ... / 100 | 1,5 | 1,9 | 2,3 | 2,7 | 3,1 | 3,6 | 4,0 |
| 120-2 | 3 | 10 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,1 | 4,6 | 5,2 | 5,7 |
| 160-2 | 4 | 14 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,2 | 6,0 | 6,6 | 7,3 |
| 200-2 | 5 | 18 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,2 | 8,1 | 9,0 |
| 240-2 | 6 | 22 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,5 | 10,5 |
| 280-2 | 7 | 26 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,1 | 12,0 |
| 320-2 | 8 | 30 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,5 | 13,9 |
| 360-2 | 9 | 34 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 13,9 | 15,4 |
| 400-2 | 10 | 38 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,3 | 17,0 |
| 440-2 | 11 | 42 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 16,7 | 18,5 |
| 480-2 | 12 | 46 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,5 | 18,2 | 20,1 |
| 520-2 | 12 | 50 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 19,8 | 21,6 |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,2 |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 24,9 |
| 90-4 | 4 | 16 | ... / 100 | 1,5 | 1,9 | 2,3 | 2,7 | 3,1 | 3,6 | 4,0 |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 |



Type: the first number gives the size of the concealed joisthangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2



R_{3,k} beam to beam

| R _{3,k} CSA 5,0x50 | | | with screws * | | | | | | | | table 25 |
|-----------------------------|-----------|-------|--------------------------|----------------------|------|------|------|------|------|------|----------|
| Type | number of | | joist min. b / h [mm] | width of timber [mm] | | | | | | | |
| | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 90-2 | 4 | 8 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,8 | 6,8 | 7,3 | 7,3 | |
| 120-2 | 3 | 10 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,2 | 6,2 | 6,2 | 6,2 | |
| 160-2 | 4 | 14 | ... / 200 | 2,9 | 4,7 | 7,3 | 8,4 | 8,4 | 8,4 | 8,4 | |
| 200-2 | 5 | 18 | ... / 240 | 3,5 | 5,0 | 8,1 | 10,6 | 10,6 | 10,6 | 10,6 | |
| 240-2 | 6 | 22 | ... / 280 | 4,2 | 5,4 | 8,6 | 12,4 | 12,9 | 12,9 | 12,9 | |
| 280-2 | 7 | 26 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,4 | 15,2 | 15,2 | 15,2 | |
| 320-2 | 8 | 30 | ... / 360 | 5,5 | 6,8 | 9,6 | 14,4 | 17,6 | 17,6 | 17,6 | |
| 360-2 | 9 | 34 | ... / 400 | 6,1 | 7,6 | 9,7 | 14,5 | 19,3 | 19,9 | 19,9 | |
| 400-2 | 10 | 38 | ... / 440 | 6,7 | 8,3 | 10,3 | 15,2 | 20,6 | 22,2 | 22,2 | |
| 440-2 | 11 | 42 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 21,6 | 24,6 | 24,6 | |
| 480-2 | 12 | 46 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 22,2 | 26,9 | 26,9 | |
| 520-2 | 12 | 50 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 29,2 | 29,3 | |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,9 | 23,4 | 30,6 | 31,6 | |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 31,4 | 34,0 | |
| 90-4 | 4 | 16 | ... / 100 | 1,9 | 3,7 | 4,7 | 5,8 | 6,8 | 7,8 | 8,9 | |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 | |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 4,7 | 7,3 | 9,9 | 12,5 | 15,1 | 17,6 | |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 5,0 | 8,1 | 13,0 | 16,7 | 20,2 | 22,0 | |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,4 | 8,6 | 13,7 | 20,2 | 23,5 | 26,4 | |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 21,1 | 26,7 | 30,2 | |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 9,6 | 14,4 | 21,1 | 29,9 | 33,9 | |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,7 | 14,5 | 21,8 | 30,6 | 37,5 | |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,3 | 15,2 | 22,2 | 32,0 | 41,2 | |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 32,0 | 44,0 | |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 32,0 | 44,0 | |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 32,0 | 44,0 | |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,9 | 23,4 | 33,6 | 45,1 | |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 33,6 | 46,1 | |



screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel



| R _{3,k} CSA 5,0x50 | | | without screws * | | | | | | | | table 26 |
|-----------------------------|-----------|-------|--------------------------|----------------------|------|------|------|------|------|------|----------|
| Type | number of | | joist min. b / h [mm] | width of timber [mm] | | | | | | | |
| | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 90-2 | 4 | 8 | ... / 100 | 1,5 | 1,9 | 2,3 | 2,7 | 3,1 | 3,6 | 4,0 | |
| 120-2 | 3 | 10 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,4 | 5,9 | |
| 160-2 | 4 | 14 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 6,9 | 7,5 | |
| 200-2 | 5 | 18 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,3 | |
| 240-2 | 6 | 22 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 10,8 | |
| 280-2 | 7 | 26 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,6 | |
| 320-2 | 8 | 30 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | |
| 360-2 | 9 | 34 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | |
| 400-2 | 10 | 38 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | |
| 440-2 | 11 | 42 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | |
| 480-2 | 12 | 46 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | |
| 520-2 | 12 | 50 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | |
| 560-2 | 12 | 54 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | |
| 600-2 | 12 | 58 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | |
| 90-4 | 4 | 16 | ... / 100 | 1,5 | 1,9 | 2,3 | 2,7 | 3,1 | 3,6 | 4,0 | |
| 120-4 | 3 | 20 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 | |
| 160-4 | 4 | 28 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 | |
| 200-4 | 5 | 36 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 | |
| 240-4 | 6 | 44 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 | |
| 280-4 | 7 | 52 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 | |
| 320-4 | 8 | 60 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | |
| 360-4 | 9 | 68 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | |
| 400-4 | 10 | 76 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | |
| 440-4 | 11 | 84 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | |
| 480-4 | 12 | 92 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | |
| 520-4 | 12 | 100 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | |
| 560-4 | 12 | 108 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | |
| 600-4 | 12 | 116 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | |



Type: the first number gives the size of the concealed joisthangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2


R_{3,k} beam to column

| R _{3,k} | | CNA 4,0x50 | | | with screws * | | | | | | table | 27 |
|------------------|--------------|------------|-----------------------|----------------------|---------------|------|------|------|------|------|-------|----|
| Type | number of SD | nails | joist min. b / h [mm] | width of timber [mm] | | | | | | | | |
| | | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | | |
| 120-2 | 3 | 6 | ... / 160 | 1,8 | 3,1 | 4,1 | 4,1 | 4,1 | 4,1 | 4,1 | | |
| 160-2 | 4 | 8 | ... / 200 | 2,4 | 3,8 | 5,3 | 5,3 | 5,3 | 5,3 | 5,3 | | |
| 200-2 | 5 | 10 | ... / 240 | 2,9 | 4,2 | 6,3 | 6,3 | 6,3 | 6,3 | 6,3 | | |
| 240-2 | 6 | 12 | ... / 280 | 3,4 | 4,4 | 7,0 | 7,4 | 7,4 | 7,4 | 7,4 | | |
| 280-2 | 7 | 14 | ... / 320 | 3,9 | 5,0 | 7,3 | 8,5 | 8,5 | 8,5 | 8,5 | | |
| 320-2 | 8 | 16 | ... / 360 | 4,4 | 5,7 | 7,7 | 9,6 | 9,6 | 9,6 | 9,6 | | |
| 360-2 | 9 | 18 | ... / 400 | 5,0 | 6,3 | 8,1 | 10,7 | 10,7 | 10,7 | 10,7 | | |
| 400-2 | 10 | 20 | ... / 440 | 5,5 | 6,9 | 8,6 | 11,6 | 11,8 | 11,8 | 11,8 | | |
| 440-2 | 11 | 22 | ... / 480 | 6,1 | 7,6 | 9,4 | 12,2 | 12,9 | 12,9 | 12,9 | | |
| 480-2 | 12 | 24 | ... / 520 | 6,6 | 8,3 | 10,2 | 12,5 | 14,0 | 14,0 | 14,0 | | |
| 520-2 | 12 | 26 | ... / 560 | 7,1 | 9,0 | 11,0 | 13,0 | 15,1 | 15,1 | 15,1 | | |
| 560-2 | 12 | 28 | ... / 600 | 7,6 | 9,6 | 11,8 | 13,9 | 16,2 | 16,2 | 16,2 | | |
| 600-2 | 12 | 30 | ... / 640 | 8,1 | 10,3 | 12,6 | 14,8 | 17,3 | 17,3 | 17,3 | | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 8,8 | 8,8 | | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 4,4 | 7,3 | 9,9 | 11,1 | 11,1 | 11,1 | | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 8,1 | 12,4 | 12,9 | 12,9 | 12,9 | | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 8,6 | 13,1 | 15,1 | 15,1 | 15,1 | | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 17,2 | 17,2 | 17,2 | | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 9,1 | 14,4 | 19,3 | 19,4 | 19,4 | | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 14,5 | 20,2 | 21,5 | 21,5 | | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 15,2 | 21,1 | 23,7 | 23,7 | | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 25,9 | 25,9 | | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 28,1 | 28,1 | | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 29,2 | 30,3 | | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 23,4 | 30,6 | 32,5 | | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 32,0 | 34,7 | | |


screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel

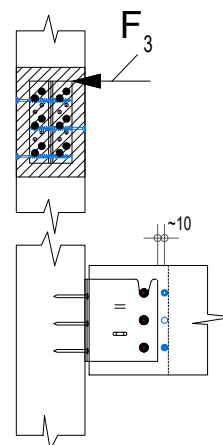

| R _{3,k} | | CNA 4,0x50 | | | without screws * | | | | | | table | 28 |
|------------------|--------------|------------|-----------------------|----------------------|------------------|------|------|------|------|------|-------|----|
| Type | number of SD | nails | joist min. b / h [mm] | width of timber [mm] | | | | | | | | |
| | | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | | |
| 120-2 | 3 | 6 | ... / 160 | 1,8 | 2,4 | 3,0 | 3,6 | 4,1 | 4,1 | 4,1 | | |
| 160-2 | 4 | 8 | ... / 200 | 2,4 | 3,1 | 3,8 | 4,6 | 5,2 | 5,3 | 5,3 | | |
| 200-2 | 5 | 10 | ... / 240 | 2,9 | 3,8 | 4,6 | 5,5 | 6,2 | 6,3 | 6,3 | | |
| 240-2 | 6 | 12 | ... / 280 | 3,4 | 4,4 | 5,5 | 6,5 | 7,3 | 7,4 | 7,4 | | |
| 280-2 | 7 | 14 | ... / 320 | 3,9 | 5,0 | 6,3 | 7,4 | 8,3 | 8,5 | 8,5 | | |
| 320-2 | 8 | 16 | ... / 360 | 4,4 | 5,7 | 7,1 | 8,3 | 9,5 | 9,6 | 9,6 | | |
| 360-2 | 9 | 18 | ... / 400 | 5,0 | 6,3 | 7,8 | 9,3 | 10,6 | 10,7 | 10,7 | | |
| 400-2 | 10 | 20 | ... / 440 | 5,5 | 6,9 | 8,6 | 10,2 | 11,6 | 11,8 | 11,8 | | |
| 440-2 | 11 | 22 | ... / 480 | 6,1 | 7,6 | 9,4 | 11,1 | 12,7 | 12,9 | 12,9 | | |
| 480-2 | 12 | 24 | ... / 520 | 6,6 | 8,3 | 10,2 | 12,1 | 13,8 | 14,0 | 14,0 | | |
| 520-2 | 12 | 26 | ... / 560 | 7,1 | 9,0 | 11,0 | 13,0 | 14,8 | 15,1 | 15,1 | | |
| 560-2 | 12 | 28 | ... / 600 | 7,6 | 9,6 | 11,8 | 13,9 | 15,9 | 16,2 | 16,2 | | |
| 600-2 | 12 | 30 | ... / 640 | 8,1 | 10,3 | 12,6 | 14,8 | 16,9 | 17,3 | 17,3 | | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 | | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 | | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 | | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 | | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 | | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | | |

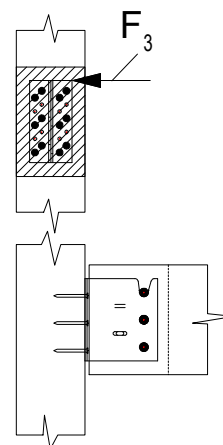

Type: the first number gives the size of the concealed joisthangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2


R_{3,k} beam to column

| R _{3,k} | CNA 4,0x60 | | | with screws * | | | | | | | table 29 |
|------------------|------------|-------|--------------------------|----------------------|------|------|------|------|------|------|----------|
| | number of | | joist min. b / h [mm] | width of timber [mm] | | | | | | | |
| Type | SD | nails | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| 120-2 | 3 | 6 | ... / 160 | 2,0 | 3,1 | 4,4 | 4,4 | 4,4 | 4,4 | 4,4 | |
| 160-2 | 4 | 8 | ... / 200 | 2,5 | 4,0 | 5,6 | 5,6 | 5,6 | 5,6 | 5,6 | |
| 200-2 | 5 | 10 | ... / 240 | 3,2 | 4,4 | 6,6 | 6,7 | 6,7 | 6,7 | 6,7 | |
| 240-2 | 6 | 12 | ... / 280 | 3,8 | 4,6 | 7,2 | 7,9 | 7,9 | 7,9 | 7,9 | |
| 280-2 | 7 | 14 | ... / 320 | 4,3 | 5,4 | 7,7 | 9,0 | 9,0 | 9,0 | 9,0 | |
| 320-2 | 8 | 16 | ... / 360 | 4,9 | 6,1 | 8,1 | 10,2 | 10,2 | 10,2 | 10,2 | |
| 360-2 | 9 | 18 | ... / 400 | 5,4 | 6,9 | 8,6 | 11,4 | 11,4 | 11,4 | 11,4 | |
| 400-2 | 10 | 20 | ... / 440 | 5,9 | 7,6 | 9,0 | 12,1 | 12,6 | 12,6 | 12,6 | |
| 440-2 | 11 | 22 | ... / 480 | 6,5 | 8,2 | 9,8 | 12,6 | 13,7 | 13,7 | 13,7 | |
| 480-2 | 12 | 24 | ... / 520 | 7,0 | 8,9 | 10,6 | 13,0 | 14,9 | 14,9 | 14,9 | |
| 520-2 | 12 | 26 | ... / 560 | 7,6 | 9,6 | 11,4 | 13,7 | 16,1 | 16,1 | 16,1 | |
| 560-2 | 12 | 28 | ... / 600 | 8,1 | 10,3 | 12,2 | 14,4 | 17,3 | 17,3 | 17,3 | |
| 600-2 | 12 | 30 | ... / 640 | 8,7 | 11,0 | 13,0 | 15,3 | 18,4 | 18,4 | 18,4 | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 9,4 | 9,4 | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 4,4 | 7,3 | 9,9 | 11,8 | 11,8 | 11,8 | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 8,1 | 12,8 | 13,7 | 13,7 | 13,7 | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 8,6 | 13,7 | 16,1 | 16,1 | 16,1 | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 18,3 | 18,3 | 18,3 | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 9,1 | 14,4 | 20,2 | 20,7 | 20,7 | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 14,5 | 21,1 | 22,9 | 22,9 | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 15,2 | 22,2 | 25,3 | 25,3 | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 27,6 | 27,6 | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 29,2 | 30,0 | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 30,6 | 32,3 | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 23,4 | 32,0 | 34,6 | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 33,6 | 37,0 | |


screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel

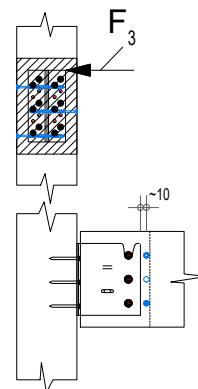

| R _{3,k} | CNA 4,0x60 | | | without screws * | | | | | | | table 30 |
|------------------|------------|-------|--------------------------|----------------------|------|------|------|------|------|------|----------|
| | number of | | joist min. b / h [mm] | width of timber [mm] | | | | | | | |
| Type | SD | nails | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| 120-2 | 3 | 6 | ... / 160 | 2,0 | 2,6 | 3,1 | 3,7 | 4,2 | 4,4 | 4,4 | |
| 160-2 | 4 | 8 | ... / 200 | 2,5 | 3,3 | 4,0 | 4,7 | 5,3 | 5,6 | 5,6 | |
| 200-2 | 5 | 10 | ... / 240 | 3,2 | 3,9 | 4,9 | 5,7 | 6,4 | 6,7 | 6,7 | |
| 240-2 | 6 | 12 | ... / 280 | 3,8 | 4,6 | 5,7 | 6,7 | 7,5 | 7,9 | 7,9 | |
| 280-2 | 7 | 14 | ... / 320 | 4,3 | 5,4 | 6,5 | 7,7 | 8,7 | 9,0 | 9,0 | |
| 320-2 | 8 | 16 | ... / 360 | 4,9 | 6,1 | 7,3 | 8,6 | 9,8 | 10,2 | 10,2 | |
| 360-2 | 9 | 18 | ... / 400 | 5,4 | 6,9 | 8,1 | 9,6 | 10,9 | 11,4 | 11,4 | |
| 400-2 | 10 | 20 | ... / 440 | 5,9 | 7,6 | 9,0 | 10,5 | 12,0 | 12,6 | 12,6 | |
| 440-2 | 11 | 22 | ... / 480 | 6,5 | 8,2 | 9,8 | 11,5 | 13,1 | 13,7 | 13,7 | |
| 480-2 | 12 | 24 | ... / 520 | 7,0 | 8,9 | 10,6 | 12,4 | 14,2 | 14,9 | 14,9 | |
| 520-2 | 12 | 26 | ... / 560 | 7,6 | 9,6 | 11,4 | 13,4 | 15,3 | 16,1 | 16,1 | |
| 560-2 | 12 | 28 | ... / 600 | 8,1 | 10,3 | 12,2 | 14,4 | 16,3 | 17,3 | 17,3 | |
| 600-2 | 12 | 30 | ... / 640 | 8,7 | 11,0 | 13,0 | 15,3 | 17,4 | 18,4 | 18,4 | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | |

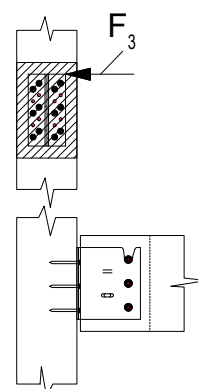

Type: the first number gives the size of the concealed joisthangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2


R_{3,k} beam to column

| R _{3,k} | CSA 5,0x50 | | joist min. | with screws * | | | | | | | table 31 |
|------------------|------------|-------|------------|---------------------------------|------|------|------|------|------|------|----------|
| | number of | | | R ₂ , k [kN] bei b = | | | | | | | |
| Type | SD | nails | b / h [mm] | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 120-2 | 3 | 6 | ... / 160 | 2,2 | 3,1 | 4,7 | 4,7 | 4,7 | 4,7 | 4,7 | |
| 160-2 | 4 | 8 | ... / 200 | 2,9 | 4,4 | 6,0 | 6,0 | 6,0 | 6,0 | 6,0 | |
| 200-2 | 5 | 10 | ... / 240 | 3,5 | 4,4 | 7,0 | 7,1 | 7,1 | 7,1 | 7,1 | |
| 240-2 | 6 | 12 | ... / 280 | 4,2 | 5,3 | 8,0 | 8,4 | 8,4 | 8,4 | 8,4 | |
| 280-2 | 7 | 14 | ... / 320 | 4,8 | 6,1 | 8,8 | 9,6 | 9,6 | 9,6 | 9,6 | |
| 320-2 | 8 | 16 | ... / 360 | 5,5 | 6,8 | 9,1 | 10,9 | 10,9 | 10,9 | 10,9 | |
| 360-2 | 9 | 18 | ... / 400 | 6,1 | 7,6 | 9,2 | 12,0 | 12,1 | 12,1 | 12,1 | |
| 400-2 | 10 | 20 | ... / 440 | 6,7 | 8,3 | 10,1 | 13,0 | 13,3 | 13,3 | 13,3 | |
| 440-2 | 11 | 22 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,9 | 14,6 | 14,6 | 14,6 | |
| 480-2 | 12 | 24 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,9 | 15,8 | 15,8 | 15,8 | |
| 520-2 | 12 | 26 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,7 | 17,1 | 17,1 | 17,1 | |
| 560-2 | 12 | 28 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 18,3 | 18,3 | 18,3 | |
| 600-2 | 12 | 30 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 19,4 | 19,6 | 19,6 | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 3,1 | 4,8 | 6,6 | 8,3 | 9,9 | 9,9 | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 4,4 | 7,3 | 9,9 | 12,5 | 12,5 | 12,5 | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 8,1 | 13,0 | 14,6 | 14,6 | 14,6 | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 8,6 | 13,7 | 17,1 | 17,1 | 17,1 | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 9,1 | 13,7 | 19,3 | 19,4 | 19,4 | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 9,1 | 14,4 | 21,1 | 22,0 | 22,0 | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 14,5 | 21,8 | 24,4 | 24,4 | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 15,2 | 22,2 | 26,9 | 26,9 | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 15,2 | 22,2 | 29,2 | 29,3 | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 16,1 | 23,2 | 31,5 | 31,8 | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 16,1 | 23,4 | 32,0 | 34,3 | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 23,4 | 33,6 | 36,8 | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 24,2 | 33,6 | 39,3 | |


screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel

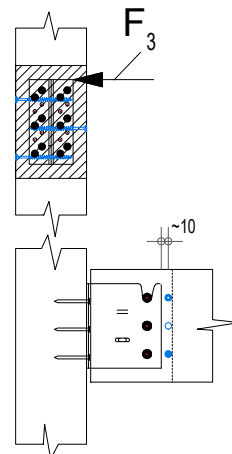

| R _{3,k} | CSA 5,0x50 | | joist min. | without screws * | | | | | | | table 32 |
|------------------|------------|-------|------------|----------------------|------|------|------|------|------|------|----------|
| | number of | | | width of timber [mm] | | | | | | | |
| Type | SD | nails | b / h [mm] | 60 | 80 | 100 | 120 | 140 | 160 | 180 | |
| 120-2 | 3 | 6 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,5 | 4,7 | 4,7 | |
| 160-2 | 4 | 8 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 5,8 | 6,0 | 6,0 | |
| 200-2 | 5 | 10 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 6,9 | 7,1 | 7,1 | |
| 240-2 | 6 | 12 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,1 | 8,4 | 8,4 | |
| 280-2 | 7 | 14 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,2 | 9,6 | 9,6 | |
| 320-2 | 8 | 16 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 10,4 | 10,9 | 10,9 | |
| 360-2 | 9 | 18 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,8 | 11,6 | 12,2 | 12,1 | |
| 400-2 | 10 | 20 | ... / 440 | 6,7 | 8,3 | 10,1 | 11,9 | 12,7 | 13,4 | 13,3 | |
| 440-2 | 11 | 22 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,1 | 13,9 | 14,6 | 14,6 | |
| 480-2 | 12 | 24 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 15,1 | 15,8 | 15,8 | |
| 520-2 | 12 | 26 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 16,3 | 17,1 | 17,1 | |
| 560-2 | 12 | 28 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 17,5 | 18,3 | 18,3 | |
| 600-2 | 12 | 30 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 18,7 | 19,5 | 19,6 | |
| 120-4 | 3 | 12 | ... / 160 | 2,2 | 2,9 | 3,5 | 4,2 | 4,8 | 5,6 | 6,2 | |
| 160-4 | 4 | 16 | ... / 200 | 2,9 | 3,6 | 4,4 | 5,3 | 6,2 | 7,0 | 7,7 | |
| 200-4 | 5 | 20 | ... / 240 | 3,5 | 4,4 | 5,4 | 6,4 | 7,4 | 8,4 | 9,5 | |
| 240-4 | 6 | 24 | ... / 280 | 4,2 | 5,3 | 6,4 | 7,4 | 8,6 | 9,8 | 11,1 | |
| 280-4 | 7 | 28 | ... / 320 | 4,8 | 6,1 | 7,3 | 8,5 | 9,9 | 11,3 | 12,7 | |
| 320-4 | 8 | 32 | ... / 360 | 5,5 | 6,8 | 8,3 | 9,7 | 11,1 | 12,9 | 14,3 | |
| 360-4 | 9 | 36 | ... / 400 | 6,1 | 7,6 | 9,2 | 10,9 | 12,4 | 14,4 | 15,9 | |
| 400-4 | 10 | 40 | ... / 440 | 6,7 | 8,3 | 10,1 | 12,1 | 13,8 | 15,8 | 17,5 | |
| 440-4 | 11 | 44 | ... / 480 | 7,3 | 9,1 | 11,0 | 13,2 | 15,2 | 17,2 | 19,1 | |
| 480-4 | 12 | 48 | ... / 520 | 7,9 | 9,8 | 11,9 | 14,3 | 16,6 | 18,7 | 20,7 | |
| 520-4 | 12 | 52 | ... / 560 | 8,6 | 10,6 | 12,8 | 15,4 | 17,8 | 20,1 | 22,2 | |
| 560-4 | 12 | 56 | ... / 600 | 9,2 | 11,3 | 13,8 | 16,5 | 19,1 | 21,5 | 23,8 | |
| 600-4 | 12 | 60 | ... / 640 | 9,8 | 12,1 | 14,7 | 17,6 | 20,4 | 23,0 | 25,4 | |

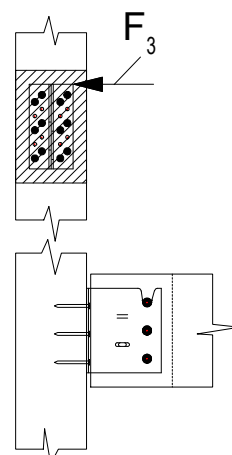


Type: the first number gives the size of the concealed joisthangers, the second number is given for the nailing - means 2-row or 4-row

* - with / without screws: for reinforcement of the joist, see Annex C2

R₄ beam to beam

| R _{4,k} | number of | | joist min. | CNA4,0x40 | CNA4,0x50 | CNA4,0x60 | CSA5,0x40 | CSA5,0x50 |
|------------------|-----------|-------|------------|-----------|-----------|-----------|-----------|-----------|
| Type | SD | nails | b / h [mm] | | | | | |
| BTN90-c | 4 | 8 | .../100 | 5,9 | 7,8 | 9,8 | 14,3 | 14,3 |
| BTN120-c | 3 | 10 | .../160 | 7,4 | 9,8 | 12,2 | 17,6 | 19,1 |
| BTN160-c | 4 | 14 | .../200 | 10,3 | 13,7 | 16,7 | 24,4 | 25,2 |
| BTN200-c | 5 | 18 | .../240 | 13,2 | 17,6 | 21,2 | 31,1 | 31,2 |
| BTN240-c | 6 | 22 | .../280 | 16,2 | 21,6 | 25,8 | 37,3 | 37,3 |
| BT4-90 | 4 | 16 | .../100 | 5,9 | 7,8 | 9,8 | 14,3 | 14,3 |
| BT4-120 | 3 | 20 | .../160 | 7,4 | 9,8 | 12,2 | 17,6 | 19,1 |
| BT4-160 | 4 | 28 | .../200 | 10,3 | 13,7 | 16,7 | 24,4 | 25,2 |
| BT4-200 | 5 | 36 | .../240 | 13,2 | 17,6 | 21,2 | 31,1 | 31,2 |
| BT4-240 | 6 | 44 | .../280 | 16,2 | 21,6 | 25,8 | 37,3 | 37,3 |
| BT4-280 | 7 | 52 | .../320 | 19,1 | 25,5 | 30,3 | 44,5 | 44,5 |
| BT4-320 | 8 | 60 | .../360 | 22,0 | 29,4 | 34,8 | 51,2 | 56,9 |
| BT4-360 | 9 | 68 | .../400 | 25,0 | 33,3 | 39,3 | 57,9 | 64,0 |
| BT4-400 | 10 | 76 | .../440 | 27,9 | 37,2 | 43,9 | 64,6 | 71,0 |
| BT4-440 | 11 | 84 | .../480 | 30,9 | 41,2 | 48,4 | 71,3 | 78,1 |
| BT4-480 | 12 | 92 | .../520 | 33,8 | 45,1 | 52,9 | 78,0 | 85,1 |
| BT4-520 | 12 | 100 | .../560 | 36,8 | 49,0 | 57,4 | 84,7 | 92,2 |
| BT4-560 | 12 | 108 | .../600 | 39,7 | 52,9 | 62,0 | 91,4 | 99,2 |
| BT4-600 | 12 | 116 | .../640 | 42,6 | 56,8 | 66,5 | 98,2 | 106,3 |
| BTALU120 | 3 | 20 | .../160 | 7,4 | 9,8 | 12,2 | 21,8 | 30,6 |
| BTALU160 | 4 | 28 | .../200 | 10,3 | 13,7 | 17,2 | 30,5 | 42,8 |
| BTALU200 | 5 | 36 | .../240 | 13,2 | 17,6 | 22,0 | 39,2 | 55,1 |
| BTALU240 | 6 | 44 | .../280 | 16,2 | 21,6 | 27,0 | 48,0 | 67,3 |
| BTALU280 | 7 | 52 | .../320 | 19,1 | 25,5 | 31,8 | 56,7 | 79,6 |
| BTALU320 | 8 | 60 | .../360 | 22,0 | 29,4 | 36,8 | 65,4 | 91,8 |
| BTALU360 | 9 | 68 | .../400 | 25,0 | 33,3 | 41,6 | 74,1 | 104,0 |
| BTALU400 | 10 | 76 | .../440 | 27,9 | 37,2 | 46,6 | 82,8 | 116,3 |
| BTALU440 | 11 | 84 | .../480 | 30,9 | 41,2 | 51,4 | 91,6 | 128,5 |
| BTALU480 | 12 | 92 | .../520 | 33,8 | 45,1 | 56,4 | 100,3 | 140,8 |
| BTALU520 | 12 | 100 | .../560 | 36,8 | 49,0 | 61,2 | 109,0 | 153,0 |
| BTALU560 | 12 | 108 | .../600 | 39,7 | 52,9 | 66,2 | 117,7 | 165,2 |
| BTALU600 | 12 | 116 | .../640 | 42,6 | 56,8 | 71,0 | 126,4 | 177,5 |

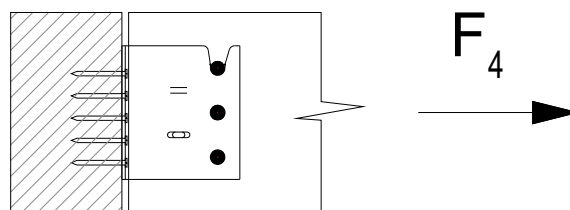


See also the comment below table 34

R₄ beam to column

| R _{4,k} | | | | | | | table | 34 |
|------------------|-----------|-------|------------|-----------|-----------|-----------|-----------|-----------|
| Type | number of | | joist min. | CNA4,0x40 | CNA4,0x50 | CNA4,0x60 | CSA5,0x40 | CSA5,0x50 |
| | SD | nails | b / h [mm] | | | | | |
| BTN90-c | 4 | 4 | .../100 | 2,9 | 3,9 | 4,9 | 8,7 | 8,7 |
| BTN120-c | 3 | 6 | .../160 | 4,4 | 5,9 | 7,4 | 12,7 | 15,7 |
| BTN160-c | 4 | 8 | .../200 | 5,9 | 7,8 | 9,8 | 16,9 | 20,9 |
| BTN200-c | 5 | 10 | .../240 | 7,4 | 9,8 | 12,3 | 21,1 | 26,1 |
| BTN240-c | 6 | 12 | .../280 | 8,8 | 11,8 | 14,7 | 25,3 | 31,3 |
| BT4-90-c | 4 | 8 | .../100 | 2,9 | 3,9 | 4,9 | 8,7 | 8,7 |
| BT4-120-c | 3 | 12 | .../160 | 4,4 | 5,9 | 7,4 | 12,7 | 15,7 |
| BT4-160-c | 4 | 16 | .../200 | 5,9 | 7,8 | 9,8 | 16,9 | 20,9 |
| BT4-200-c | 5 | 20 | .../240 | 7,4 | 9,8 | 12,3 | 21,1 | 26,1 |
| BT4-240-c | 6 | 24 | .../280 | 8,8 | 11,8 | 14,7 | 25,3 | 31,3 |
| BT4-280-c | 7 | 28 | .../320 | 10,3 | 13,7 | 17,2 | 29,5 | 29,5 |
| BT4-320-c | 8 | 32 | .../360 | 11,8 | 15,7 | 19,6 | 33,7 | 41,8 |
| BT4-360-c | 9 | 36 | .../400 | 13,2 | 17,6 | 22,1 | 38,0 | 47,0 |
| BT4-400-c | 10 | 40 | .../440 | 14,7 | 19,6 | 24,5 | 42,2 | 52,2 |
| BT4-440-c | 11 | 44 | .../480 | 16,2 | 21,6 | 27,0 | 46,4 | 57,5 |
| BT4-480-c | 12 | 48 | .../520 | 17,6 | 23,5 | 29,4 | 50,6 | 62,7 |
| BT4-520-c | 12 | 52 | .../560 | 19,1 | 25,5 | 31,9 | 54,8 | 67,9 |
| BT4-560-c | 12 | 56 | .../600 | 20,6 | 27,4 | 34,3 | 59,1 | 73,1 |
| BT4-600-c | 12 | 60 | .../640 | 22,1 | 29,4 | 36,8 | 63,3 | 78,4 |
| BTALU120-c | 3 | 12 | .../160 | 4,4 | 5,9 | 7,4 | 13,1 | 18,4 |
| BTALU160-c | 4 | 16 | .../200 | 5,9 | 7,8 | 9,8 | 17,4 | 24,5 |
| BTALU200-c | 5 | 20 | .../240 | 7,4 | 9,8 | 12,3 | 21,8 | 30,6 |
| BTALU240-c | 6 | 24 | .../280 | 8,8 | 11,8 | 14,7 | 26,2 | 36,7 |
| BTALU280-c | 7 | 28 | .../320 | 10,3 | 13,7 | 17,2 | 30,5 | 42,8 |
| BTALU320-c | 8 | 32 | .../360 | 11,8 | 15,7 | 19,6 | 34,9 | 49,0 |
| BTALU360-c | 9 | 36 | .../400 | 13,2 | 17,6 | 22,1 | 39,2 | 55,1 |
| BTALU400-c | 10 | 40 | .../440 | 14,7 | 19,6 | 24,5 | 43,6 | 61,2 |
| BTALU440-c | 11 | 44 | .../480 | 16,2 | 21,6 | 27,0 | 48,0 | 67,3 |
| BTALU480-c | 12 | 48 | .../520 | 17,6 | 23,5 | 29,4 | 52,3 | 73,4 |
| BTALU520-c | 12 | 52 | .../560 | 19,1 | 25,5 | 31,9 | 56,7 | 79,6 |
| BTALU560-c | 12 | 56 | .../600 | 20,6 | 27,4 | 34,3 | 61,0 | 85,7 |
| BTALU600-c | 12 | 60 | .../640 | 22,1 | 29,4 | 36,8 | 65,4 | 91,8 |

C= index for column nailing


Basis of the values for force direction F_4 is, that the force is acting in the middle of the steel dowel and in the middle of the nail group. In case of a asymmetric placing of steel dowel and nails, calculate with the number of fasteners in the overlapping area – see picture below

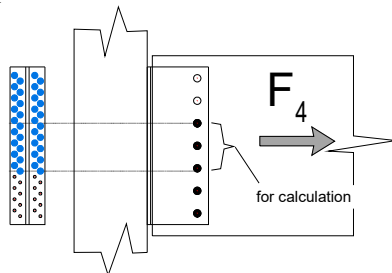

Force direction F4

Additional information:

- The BTALU can be used with CNA nails of a diameter of $\varnothing 4$ mm with a length from 35 to 100mm and CSA screws of a diameter of $\varnothing 5$ mm and a length from 35 to 50mm. Capacity of these fasteners can be found in ETA-04/0013.
- The load is located on the centre of gravity of the dowels
- The dowels must be distributed equally across the whole height of the hanger.
- The nails must be distributed equally across all around the dowels
- For solid timber: The spacing and edge distance to the timber must respect rules given by EUROCODE 5 (EN1995-1-1 §8.6 Table 8.5)
- For CLT: the spacing and edge distance to the timber must respect rules from ETA of the CLT manufacturer.
- The minimum distance between the edge of the hangers and the dowels is equal to $1,5 \times d$ (d is the diameter of the dowels)
- All dowels must have the same diameter, length and yield capacity.

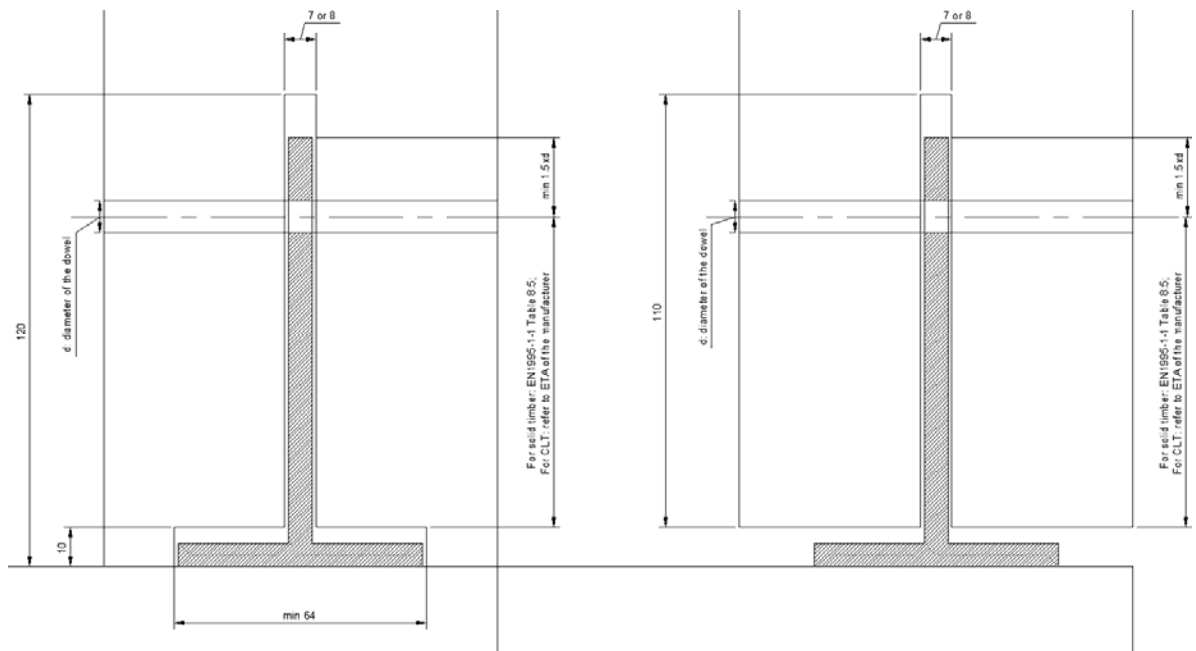

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø7 | | C24 | | Column | | Table 46 | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 8,3 | 8 | 9,4 | 12 | 12,4 | 12 | 12,4 | 12 | 12,4 | 12 | 12,4 |
| | 24 | 18,0 | 24 | 20,5 | 28 | 23,3 | 28 | 25,7 | 28 | 25,7 | 28 | 25,7 |
| 4 SD | 12 | 14,1 | 16 | 18,3 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 |
| | 28 | 24,2 | 32 | 27,5 | 32 | 31,5 | 32 | 33,9 | 32 | 33,9 | 32 | 33,9 |
| 5 SD | 16 | 20,6 | 16 | 22,8 | 20 | 28,0 | 20 | 28,0 | 20 | 28,0 | 20 | 28,0 |
| | 32 | 30,3 | 32 | 34,5 | 36 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 |
| 6 SD | 20 | 27,6 | 20 | 30,4 | 24 | 36,6 | 28 | 40,4 | 28 | 40,4 | 28 | 40,4 |
| | 36 | 36,4 | 36 | 41,6 | 40 | 47,4 | 44 | 50,9 | 44 | 50,9 | 44 | 50,9 |
| 7 SD | 20 | 32,0 | 24 | 38,4 | 28 | 45,3 | 28 | 45,8 | 28 | 45,8 | 28 | 45,8 |
| | 36 | 42,5 | 40 | 48,6 | 44 | 55,3 | 44 | 59,5 | 44 | 59,5 | 44 | 59,5 |
| 8 SD | 24 | 39,3 | 28 | 46,4 | 32 | 54,1 | 32 | 55,0 | 32 | 55,0 | 32 | 55,0 |
| | 40 | 48,8 | 44 | 55,6 | 48 | 63,1 | 48 | 68,1 | 48 | 68,1 | 48 | 68,1 |
| 9 SD | 28 | 46,7 | 32 | 54,5 | 36 | 62,9 | 36 | 64,2 | 36 | 64,2 | 36 | 64,2 |
| | 44 | 54,9 | 48 | 62,4 | 52 | 71,0 | 52 | 76,8 | 52 | 76,8 | 52 | 76,8 |
| 10 SD | 32 | 54,0 | 36 | 62,5 | 40 | 71,7 | 40 | 73,5 | 40 | 73,5 | 40 | 73,5 |
| | 48 | 60,9 | 52 | 69,3 | 56 | 78,8 | 56 | 85,4 | 56 | 85,4 | 56 | 85,4 |
| 11 SD | 32 | 58,7 | 36 | 67,7 | 44 | 80,4 | 44 | 82,8 | 44 | 82,8 | 44 | 82,8 |
| | 48 | 67,1 | 52 | 76,3 | 60 | 86,8 | 60 | 94,0 | 60 | 94,0 | 60 | 94,0 |
| 12 SD | 36 | 66,0 | 40 | 75,7 | 44 | 86,1 | 44 | 88,3 | 44 | 88,3 | 44 | 88,3 |
| | 52 | 73,3 | 56 | 83,4 | 60 | 94,7 | 60 | 101,3 | 60 | 101,3 | 60 | 101,3 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø7 | | C24 | | Column | | Table 47 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 8,8 | 8 | 9,8 | 8 | 10,5 | 12 | 13,4 | 12 | 13,4 | 12 | 13,4 |
| | 20 | 18,0 | 24 | 20,5 | 24 | 23,7 | 28 | 25,1 | 28 | 25,1 | 28 | 25,1 |
| 4 SD | 8 | 12,3 | 12 | 16,5 | 12 | 17,8 | 16 | 21,2 | 16 | 21,2 | 16 | 21,2 |
| | 24 | 24,3 | 28 | 27,5 | 28 | 31,6 | 32 | 33,7 | 32 | 33,7 | 32 | 33,7 |
| 5 SD | 12 | 18,8 | 16 | 24,0 | 16 | 26,0 | 20 | 29,9 | 20 | 29,9 | 20 | 29,9 |
| | 28 | 30,5 | 32 | 34,5 | 32 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 |
| 6 SD | 16 | 25,9 | 20 | 32,0 | 20 | 34,9 | 24 | 39,0 | 24 | 39,0 | 24 | 39,0 |
| | 32 | 36,4 | 36 | 41,5 | 36 | 47,4 | 40 | 50,9 | 40 | 50,9 | 40 | 50,9 |
| 7 SD | 20 | 33,4 | 20 | 36,8 | 24 | 44,0 | 24 | 44,2 | 24 | 44,2 | 24 | 44,2 |
| | 36 | 42,5 | 36 | 48,6 | 40 | 55,2 | 40 | 59,6 | 40 | 59,6 | 40 | 59,6 |
| 8 SD | 20 | 37,8 | 24 | 45,1 | 28 | 53,0 | 28 | 53,7 | 28 | 53,7 | 28 | 53,7 |
| | 36 | 48,8 | 40 | 55,5 | 44 | 63,0 | 44 | 68,3 | 44 | 68,3 | 44 | 68,3 |
| 9 SD | 24 | 45,4 | 28 | 53,4 | 32 | 62,1 | 32 | 63,2 | 32 | 63,2 | 32 | 63,2 |
| | 40 | 54,9 | 44 | 62,4 | 48 | 70,9 | 48 | 77,0 | 48 | 77,0 | 48 | 77,0 |
| 10 SD | 28 | 53,1 | 28 | 58,4 | 32 | 67,5 | 36 | 72,8 | 36 | 72,8 | 36 | 72,8 |
| | 44 | 60,9 | 44 | 69,3 | 48 | 78,9 | 52 | 85,5 | 52 | 85,5 | 52 | 85,5 |
| 11 SD | 28 | 57,6 | 32 | 66,7 | 36 | 76,6 | 40 | 82,4 | 40 | 82,4 | 40 | 82,4 |
| | 44 | 67,1 | 48 | 76,4 | 52 | 86,9 | 56 | 94,0 | 56 | 94,0 | 56 | 94,0 |
| 12 SD | 32 | 65,3 | 36 | 75,1 | 40 | 85,6 | 44 | 91,9 | 44 | 91,9 | 44 | 91,9 |
| | 48 | 73,2 | 52 | 83,3 | 56 | 94,8 | 60 | 102,4 | 60 | 102,4 | 60 | 102,4 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø7 | | C24 | | Column | | Table 48 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 11,5 | 8 | 12,4 | 8 | 13,1 | 8 | 13,1 | 8 | 13,1 | 8 | 13,1 |
| | 16 | 18,0 | 16 | 20,5 | 16 | 23,7 | 20 | 25,1 | 20 | 25,1 | 20 | 25,1 |
| 4 SD | 8 | 14,5 | 8 | 15,8 | 8 | 16,9 | 8 | 16,9 | 8 | 16,9 | 8 | 16,9 |
| | 16 | 24,3 | 20 | 27,5 | 20 | 31,3 | 20 | 34,1 | 20 | 34,1 | 20 | 34,1 |
| 5 SD | 8 | 17,8 | 8 | 19,3 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 |
| | 20 | 30,3 | 20 | 34,6 | 24 | 39,2 | 24 | 42,3 | 24 | 42,3 | 24 | 42,3 |
| 6 SD | 8 | 20,1 | 8 | 20,1 | 12 | 29,3 | 12 | 29,3 | 12 | 29,3 | 12 | 29,3 |
| | 24 | 36,4 | 24 | 41,5 | 28 | 47,2 | 28 | 50,9 | 28 | 50,9 | 28 | 50,9 |
| 7 SD | 8 | 20,1 | 12 | 30,1 | 12 | 30,1 | 16 | 38,9 | 16 | 38,9 | 16 | 38,9 |
| | 24 | 42,6 | 28 | 48,4 | 28 | 55,3 | 32 | 59,5 | 32 | 59,5 | 32 | 59,5 |
| 8 SD | 12 | 30,1 | 12 | 30,1 | 16 | 40,2 | 20 | 48,7 | 20 | 48,7 | 20 | 48,7 |
| | 28 | 48,7 | 28 | 55,5 | 32 | 63,0 | 36 | 68,1 | 36 | 68,1 | 36 | 68,1 |
| 9 SD | 12 | 30,1 | 16 | 40,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 |
| | 28 | 54,9 | 32 | 62,4 | 36 | 70,9 | 36 | 77,0 | 36 | 77,0 | 36 | 77,0 |
| 10 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 24 | 60,2 | 24 | 60,2 | 24 | 60,2 |
| | 32 | 60,9 | 36 | 69,3 | 40 | 78,8 | 40 | 85,3 | 40 | 85,3 | 40 | 85,3 |
| 11 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 28 | 70,2 | 28 | 70,2 | 28 | 70,2 |
| | 32 | 67,1 | 36 | 76,4 | 40 | 86,9 | 44 | 93,9 | 44 | 93,9 | 44 | 93,9 |
| 12 SD | 20 | 50,2 | 24 | 60,2 | 28 | 70,3 | 32 | 80,1 | 32 | 80,1 | 32 | 80,1 |
| | 36 | 73,1 | 40 | 83,2 | 44 | 94,7 | 48 | 102,4 | 48 | 102,4 | 48 | 102,4 |

| R1,k | CNA4.0x50 | | 2-Row | | SD: Ø7 | | C24 | | Column | | Table 49 | |
|---|-----------|------|-------|------|--------|------|-------|------|--------|------|----------|------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 100 120 140 160 180 | | | | | | | | | | | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 10 | 11,6 | 10 | 12,5 | 12 | 15,5 | 12 | 15,5 | 12 | 15,5 | 12 | 15,5 |
| | 18 | 18,0 | 18 | 20,7 | 20 | 23,7 | 20 | 25,2 | 20 | 25,2 | 20 | 25,2 |
| 4 SD | 12 | 16,7 | 14 | 20,2 | 16 | 24,0 | 16 | 24,0 | 16 | 24,0 | 16 | 24,0 |
| | 20 | 24,4 | 22 | 27,8 | 24 | 31,5 | 24 | 33,8 | 24 | 33,8 | 24 | 33,8 |
| 5 SD | 16 | 24,2 | 18 | 28,4 | 20 | 32,8 | 20 | 33,1 | 20 | 33,1 | 20 | 33,1 |
| | 24 | 30,3 | 26 | 34,5 | 28 | 39,2 | 28 | 42,6 | 28 | 42,6 | 28 | 42,6 |
| 6 SD | 18 | 29,8 | 20 | 34,5 | 22 | 39,4 | 22 | 39,7 | 22 | 39,7 | 22 | 39,7 |
| | 26 | 36,6 | 28 | 41,7 | 30 | 47,3 | 30 | 49,8 | 30 | 49,8 | 30 | 49,8 |
| 7 SD | 20 | 35,5 | 22 | 40,6 | 22 | 43,6 | 22 | 43,7 | 22 | 43,7 | 22 | 43,7 |
| | 28 | 42,6 | 30 | 48,3 | 30 | 52,8 | 30 | 54,3 | 30 | 54,3 | 30 | 54,3 |
| 8 SD | 22 | 41,2 | 22 | 44,4 | 22 | 47,2 | 22 | 47,2 | 22 | 47,2 | 22 | 47,2 |
| | 30 | 48,5 | 30 | 53,2 | 30 | 57,3 | 30 | 58,4 | 30 | 58,4 | 30 | 58,4 |
| 9 SD | 22 | 44,7 | 22 | 47,7 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 |
| | 30 | 52,9 | 30 | 57,4 | 30 | 61,5 | 30 | 62,1 | 30 | 62,1 | 30 | 62,1 |
| 10 SD | 22 | 47,7 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 |
| | 30 | 56,9 | 30 | 61,3 | 30 | 64,9 | 30 | 65,2 | 30 | 65,2 | 30 | 65,2 |
| 11 SD | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 |
| | 30 | 60,5 | 30 | 64,6 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 |
| 12 SD | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 |
| | 30 | 63,8 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 |
| R1,k | CNA4.0x60 | | 2-Row | | SD: Ø7 | | C24 | | Column | | Table 50 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 100 120 140 160 180 | | | | | | | | | | | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 10,6 | 8 | 11,5 | 10 | 14,5 | 10 | 14,5 | 10 | 14,5 | 10 | 14,5 |
| | 16 | 18,0 | 16 | 20,6 | 18 | 23,7 | 18 | 25,1 | 18 | 25,1 | 18 | 25,1 |
| 4 SD | 10 | 15,7 | 12 | 19,4 | 14 | 23,3 | 14 | 23,3 | 14 | 23,3 | 14 | 23,3 |
| | 18 | 24,4 | 20 | 27,7 | 22 | 31,3 | 22 | 34,0 | 22 | 34,0 | 22 | 34,0 |
| 5 SD | 14 | 23,6 | 14 | 25,4 | 16 | 29,9 | 18 | 32,7 | 18 | 32,7 | 18 | 32,7 |
| | 22 | 30,3 | 22 | 34,5 | 24 | 39,3 | 26 | 42,8 | 26 | 42,8 | 26 | 42,8 |
| 6 SD | 16 | 29,3 | 18 | 34,1 | 20 | 39,2 | 22 | 42,4 | 22 | 42,4 | 22 | 42,4 |
| | 24 | 36,4 | 26 | 41,5 | 28 | 47,4 | 30 | 50,9 | 30 | 50,9 | 30 | 50,9 |
| 7 SD | 18 | 35,1 | 20 | 40,4 | 22 | 45,9 | 22 | 46,2 | 22 | 46,2 | 22 | 46,2 |
| | 26 | 42,7 | 28 | 48,6 | 30 | 55,0 | 30 | 57,6 | 30 | 57,6 | 30 | 57,6 |
| 8 SD | 20 | 41,0 | 22 | 46,6 | 22 | 49,5 | 22 | 49,6 | 22 | 49,6 | 22 | 49,6 |
| | 28 | 48,8 | 30 | 55,3 | 30 | 60,2 | 30 | 61,8 | 30 | 61,8 | 30 | 61,8 |
| 9 SD | 22 | 46,8 | 22 | 49,9 | 22 | 51,9 | 22 | 51,9 | 22 | 51,9 | 22 | 51,9 |
| | 30 | 54,8 | 30 | 60,1 | 30 | 64,5 | 30 | 65,5 | 30 | 65,5 | 30 | 65,5 |
| 10 SD | 22 | 49,9 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 |
| | 30 | 59,3 | 30 | 64,1 | 30 | 68,1 | 30 | 68,7 | 30 | 68,7 | 30 | 68,7 |
| 11 SD | 22 | 51,9 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 |
| | 30 | 63,1 | 30 | 67,6 | 30 | 70,6 | 30 | 70,7 | 30 | 70,7 | 30 | 70,7 |
| 12 SD | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 |
| | 30 | 66,5 | 30 | 70,2 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 |
| R1,k | CSA5.0x50 | | 2-Row | | SD: Ø7 | | C24 | | Column | | Table 51 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 100 120 140 160 180 | | | | | | | | | | | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 4 | 8,3 | 4 | 9,0 | 6 | 12,4 | 6 | 12,4 | 6 | 12,4 | 6 | 12,4 |
| | 12 | 18,0 | 12 | 20,5 | 14 | 23,3 | 14 | 25,1 | 14 | 25,1 | 14 | 25,1 |
| 4 SD | 6 | 13,5 | 6 | 14,3 | 8 | 18,4 | 8 | 18,4 | 8 | 18,4 | 8 | 18,4 |
| | 14 | 24,1 | 14 | 27,7 | 16 | 31,3 | 16 | 33,7 | 16 | 33,7 | 16 | 33,7 |
| 5 SD | 8 | 18,9 | 10 | 23,4 | 10 | 24,2 | 12 | 28,2 | 12 | 28,2 | 12 | 28,2 |
| | 16 | 30,3 | 18 | 34,5 | 18 | 39,2 | 20 | 42,3 | 20 | 42,3 | 20 | 42,3 |
| 6 SD | 10 | 24,3 | 12 | 29,1 | 14 | 34,1 | 16 | 38,2 | 16 | 38,2 | 16 | 38,2 |
| | 18 | 36,4 | 20 | 41,5 | 22 | 47,2 | 24 | 50,9 | 24 | 50,9 | 24 | 50,9 |
| 7 SD | 12 | 29,6 | 14 | 34,6 | 16 | 39,7 | 18 | 44,1 | 18 | 44,1 | 18 | 44,1 |
| | 20 | 42,5 | 22 | 48,5 | 24 | 55,1 | 26 | 59,9 | 26 | 59,9 | 26 | 59,9 |
| 8 SD | 14 | 34,9 | 18 | 44,3 | 20 | 49,6 | 22 | 54,1 | 22 | 54,1 | 22 | 54,1 |
| | 22 | 48,8 | 26 | 55,4 | 28 | 63,0 | 30 | 68,1 | 30 | 68,1 | 30 | 68,1 |
| 9 SD | 16 | 40,1 | 20 | 49,8 | 22 | 55,0 | 22 | 55,1 | 22 | 55,1 | 22 | 55,1 |
| | 24 | 54,9 | 28 | 62,4 | 30 | 71,0 | 30 | 72,8 | 30 | 72,8 | 30 | 72,8 |
| 10 SD | 20 | 49,7 | 22 | 55,1 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 |
| | 28 | 60,9 | 30 | 69,3 | 30 | 73,7 | 30 | 74,2 | 30 | 74,2 | 30 | 74,2 |
| 11 SD | 22 | 55,0 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 |
| | 30 | 67,0 | 30 | 73,2 | 30 | 74,9 | 30 | 75,1 | 30 | 75,1 | 30 | 75,1 |
| 12 SD | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 |
| | 30 | 72,2 | 30 | 74,7 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø7 | | CLT | | Column | | Table 52 | | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|--|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 7,0 | 8 | 7,7 | 12 | 10,8 | 12 | 11,3 | 12 | 11,3 | 12 | 11,3 | |
| | 24 | 18,0 | 24 | 20,5 | 28 | 23,3 | 28 | 25,7 | 28 | 25,7 | 28 | 25,7 | |
| 4 SD | 12 | 12,2 | 16 | 16,3 | 16 | 17,5 | 16 | 18,3 | 16 | 18,3 | 16 | 18,3 | |
| | 28 | 24,1 | 32 | 27,5 | 32 | 31,4 | 32 | 33,8 | 32 | 33,8 | 32 | 33,8 | |
| 5 SD | 16 | 18,4 | 16 | 19,9 | 20 | 25,0 | 20 | 26,1 | 20 | 26,1 | 20 | 26,1 | |
| | 32 | 30,3 | 32 | 34,5 | 36 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 | |
| 6 SD | 20 | 25,2 | 20 | 27,2 | 24 | 33,1 | 28 | 38,7 | 28 | 38,7 | 28 | 38,7 | |
| | 36 | 36,4 | 36 | 41,5 | 40 | 47,4 | 44 | 50,9 | 44 | 50,9 | 44 | 50,9 | |
| 7 SD | 24 | 32,4 | 24 | 34,9 | 28 | 41,6 | 32 | 47,7 | 32 | 47,7 | 32 | 47,7 | |
| | 40 | 42,5 | 40 | 48,6 | 44 | 55,3 | 48 | 59,5 | 48 | 59,5 | 48 | 59,5 | |
| 8 SD | 24 | 36,2 | 28 | 42,9 | 32 | 50,3 | 36 | 56,9 | 36 | 56,9 | 36 | 56,9 | |
| | 40 | 48,8 | 44 | 55,6 | 48 | 63,1 | 52 | 68,1 | 52 | 68,1 | 52 | 68,1 | |
| 9 SD | 28 | 43,7 | 32 | 51,1 | 36 | 59,2 | 36 | 61,9 | 36 | 61,9 | 36 | 61,9 | |
| | 44 | 54,9 | 48 | 62,4 | 52 | 70,9 | 52 | 76,7 | 52 | 76,7 | 52 | 76,7 | |
| 10 SD | 32 | 51,3 | 36 | 59,3 | 40 | 68,1 | 40 | 71,2 | 40 | 71,2 | 40 | 71,2 | |
| | 48 | 60,9 | 52 | 69,3 | 56 | 78,8 | 56 | 85,3 | 56 | 85,3 | 56 | 85,3 | |
| 11 SD | 32 | 55,4 | 36 | 63,8 | 44 | 77,0 | 44 | 80,6 | 44 | 80,6 | 44 | 80,6 | |
| | 48 | 67,0 | 52 | 76,3 | 60 | 86,8 | 60 | 94,0 | 60 | 94,0 | 60 | 94,0 | |
| 12 SD | 36 | 63,0 | 40 | 72,1 | 44 | 81,9 | 44 | 85,6 | 44 | 85,6 | 44 | 85,6 | |
| | 52 | 73,3 | 56 | 83,4 | 60 | 94,7 | 60 | 100,9 | 60 | 100,9 | 60 | 100,9 | |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø7 | | CLT | | Column | | Table 53 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 7,5 | 8 | 8,1 | 8 | 8,9 | 12 | 12,3 | 12 | 12,3 | 12 | 12,3 | |
| | 24 | 18,0 | 24 | 20,5 | 24 | 23,7 | 28 | 25,1 | 28 | 25,1 | 28 | 25,1 | |
| 4 SD | 8 | 10,6 | 12 | 14,2 | 12 | 15,4 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 | |
| | 24 | 24,3 | 28 | 27,5 | 28 | 31,5 | 32 | 33,7 | 32 | 33,7 | 32 | 33,7 | |
| 5 SD | 12 | 16,4 | 16 | 21,3 | 16 | 23,0 | 20 | 28,2 | 20 | 28,2 | 20 | 28,2 | |
| | 28 | 30,5 | 32 | 34,5 | 32 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 | |
| 6 SD | 16 | 23,3 | 20 | 29,1 | 20 | 31,3 | 24 | 37,2 | 24 | 37,2 | 24 | 37,2 | |
| | 32 | 36,4 | 36 | 41,5 | 36 | 47,4 | 40 | 50,9 | 40 | 50,9 | 40 | 50,9 | |
| 7 SD | 20 | 30,7 | 20 | 33,2 | 24 | 40,1 | 24 | 41,9 | 24 | 41,9 | 24 | 41,9 | |
| | 36 | 42,5 | 36 | 48,6 | 40 | 55,1 | 40 | 59,5 | 40 | 59,5 | 40 | 59,5 | |
| 8 SD | 20 | 34,5 | 24 | 41,5 | 28 | 49,1 | 28 | 51,3 | 28 | 51,3 | 28 | 51,3 | |
| | 36 | 48,8 | 40 | 55,5 | 44 | 63,0 | 44 | 68,2 | 44 | 68,2 | 44 | 68,2 | |
| 9 SD | 24 | 42,3 | 28 | 49,9 | 32 | 58,3 | 32 | 60,9 | 32 | 60,9 | 32 | 60,9 | |
| | 40 | 54,8 | 44 | 62,4 | 48 | 70,9 | 48 | 76,9 | 48 | 76,9 | 48 | 76,9 | |
| 10 SD | 28 | 50,2 | 28 | 54,2 | 32 | 62,9 | 36 | 70,5 | 36 | 70,5 | 36 | 70,5 | |
| | 44 | 60,9 | 44 | 69,3 | 48 | 78,8 | 52 | 85,5 | 52 | 85,5 | 52 | 85,5 | |
| 11 SD | 28 | 54,2 | 32 | 62,8 | 36 | 72,2 | 40 | 80,1 | 40 | 80,1 | 40 | 80,1 | |
| | 44 | 67,1 | 48 | 76,4 | 52 | 86,9 | 56 | 94,0 | 56 | 94,0 | 56 | 94,0 | |
| 12 SD | 32 | 62,1 | 36 | 71,4 | 40 | 81,4 | 44 | 89,8 | 44 | 89,8 | 44 | 89,8 | |
| | 48 | 73,1 | 52 | 83,2 | 56 | 94,8 | 60 | 102,4 | 60 | 102,4 | 60 | 102,4 | |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø7 | | CLT | | Column | | Table 54 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 10,5 | 8 | 11,1 | 8 | 11,8 | 8 | 12,2 | 8 | 12,2 | 8 | 12,2 | |
| | 16 | 18,0 | 16 | 20,5 | 16 | 23,7 | 20 | 25,1 | 20 | 25,1 | 20 | 25,1 | |
| 4 SD | 8 | 13,0 | 8 | 13,9 | 8 | 14,9 | 8 | 15,5 | 8 | 15,5 | 8 | 15,5 | |
| | 16 | 24,2 | 20 | 27,5 | 20 | 31,3 | 20 | 34,1 | 20 | 34,1 | 20 | 34,1 | |
| 5 SD | 8 | 15,7 | 8 | 17,8 | 8 | 19,8 | 8 | 19,8 | 8 | 19,8 | 8 | 19,8 | |
| | 20 | 30,3 | 20 | 34,5 | 24 | 39,2 | 24 | 42,3 | 24 | 42,3 | 24 | 42,3 | |
| 6 SD | 8 | 20,1 | 8 | 20,1 | 12 | 26,9 | 12 | 27,8 | 12 | 27,8 | 12 | 27,8 | |
| | 24 | 36,4 | 24 | 41,5 | 28 | 47,2 | 28 | 50,9 | 28 | 50,9 | 28 | 50,9 | |
| 7 SD | 8 | 20,1 | 12 | 30,1 | 12 | 30,1 | 16 | 37,4 | 16 | 37,4 | 16 | 37,4 | |
| | 24 | 42,5 | 28 | 48,4 | 28 | 55,3 | 32 | 59,5 | 32 | 59,5 | 32 | 59,5 | |
| 8 SD | 12 | 30,1 | 12 | 30,1 | 16 | 40,2 | 20 | 47,2 | 20 | 47,2 | 20 | 47,2 | |
| | 28 | 48,7 | 28 | 55,5 | 32 | 63,0 | 36 | 68,1 | 36 | 68,1 | 36 | 68,1 | |
| 9 SD | 12 | 30,1 | 16 | 40,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | |
| | 28 | 54,9 | 32 | 62,4 | 36 | 70,9 | 36 | 77,0 | 36 | 77,0 | 36 | 77,0 | |
| 10 SD | 16 | 40,2 | 20 | 50,2 | 24 | 59,1 | 24 | 59,4 | 24 | 59,4 | 24 | 59,4 | |
| | 32 | 60,9 | 36 | 69,3 | 40 | 78,8 | 40 | 85,3 | 40 | 85,3 | 40 | 85,3 | |
| 11 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 28 | 69,3 | 28 | 69,3 | 28 | 69,3 | |
| | 32 | 67,0 | 36 | 76,4 | 40 | 86,9 | 44 | 93,9 | 44 | 93,9 | 44 | 93,9 | |
| 12 SD | 20 | 50,2 | 24 | 60,2 | 28 | 70,3 | 32 | 79,3 | 32 | 79,3 | 32 | 79,3 | |
| | 36 | 73,1 | 40 | 83,2 | 44 | 94,7 | 48 | 102,4 | 48 | 102,4 | 48 | 102,4 | |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø8 | | C24 | | Header | | Table 55 | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 12,3 | 20 | 13,4 | 20 | 14,4 | 24 | 16,8 | 24 | 16,8 | 24 | 16,8 |
| | 32 | 18,3 | 36 | 20,5 | 36 | 23,5 | 40 | 25,1 | 40 | 25,1 | 40 | 25,1 |
| 4 SD | 20 | 15,9 | 24 | 19,6 | 28 | 23,8 | 28 | 23,8 | 28 | 23,8 | 28 | 23,8 |
| | 36 | 24,1 | 40 | 27,8 | 44 | 31,5 | 44 | 34,1 | 44 | 34,1 | 44 | 34,1 |
| 5 SD | 28 | 24,1 | 28 | 26,5 | 32 | 31,4 | 36 | 34,4 | 36 | 34,4 | 36 | 34,4 |
| | 44 | 30,3 | 44 | 34,6 | 48 | 39,5 | 52 | 42,5 | 52 | 42,5 | 52 | 42,5 |
| 6 SD | 32 | 30,5 | 36 | 35,9 | 36 | 39,4 | 40 | 42,6 | 40 | 42,6 | 40 | 42,6 |
| | 48 | 36,5 | 52 | 41,5 | 52 | 47,2 | 56 | 51,3 | 56 | 51,3 | 56 | 51,3 |
| 7 SD | 36 | 37,2 | 40 | 43,2 | 44 | 49,9 | 44 | 51,2 | 44 | 51,2 | 44 | 51,2 |
| | 52 | 42,6 | 56 | 48,5 | 60 | 55,2 | 60 | 59,8 | 60 | 59,8 | 60 | 59,8 |
| 8 SD | 40 | 43,9 | 44 | 50,7 | 48 | 58,1 | 48 | 59,9 | 48 | 59,9 | 48 | 59,9 |
| | 56 | 48,7 | 60 | 55,5 | 64 | 63,2 | 64 | 68,2 | 64 | 68,2 | 64 | 68,2 |
| 9 SD | 40 | 48,8 | 48 | 58,1 | 52 | 66,4 | 56 | 71,3 | 56 | 71,3 | 56 | 71,3 |
| | 56 | 54,8 | 64 | 62,4 | 68 | 71,1 | 72 | 76,9 | 72 | 76,9 | 72 | 76,9 |
| 10 SD | 44 | 55,6 | 52 | 65,6 | 56 | 74,7 | 60 | 80,1 | 60 | 80,1 | 60 | 80,1 |
| | 60 | 61,0 | 68 | 69,4 | 72 | 79,0 | 76 | 85,5 | 76 | 85,5 | 76 | 85,5 |
| 11 SD | 48 | 62,4 | 52 | 71,4 | 60 | 83,0 | 64 | 88,9 | 64 | 88,9 | 64 | 88,9 |
| | 64 | 67,1 | 68 | 76,3 | 76 | 86,9 | 80 | 94,1 | 80 | 94,1 | 80 | 94,1 |
| 12 SD | 52 | 69,2 | 56 | 78,9 | 64 | 91,3 | 68 | 97,8 | 68 | 97,8 | 68 | 97,8 |
| | 68 | 73,3 | 72 | 83,3 | 80 | 94,8 | 84 | 102,6 | 84 | 102,6 | 84 | 102,6 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø8 | | C24 | | Header | | Table 56 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 13,6 | 20 | 14,7 | 20 | 15,7 | 20 | 15,7 | 20 | 15,7 | 20 | 15,7 |
| | 28 | 18,1 | 32 | 20,5 | 32 | 23,5 | 36 | 25,1 | 36 | 25,1 | 36 | 25,1 |
| 4 SD | 20 | 17,1 | 20 | 18,7 | 24 | 23,0 | 24 | 23,0 | 24 | 23,0 | 24 | 23,0 |
| | 32 | 24,1 | 36 | 27,8 | 40 | 31,3 | 40 | 34,2 | 40 | 34,2 | 40 | 34,2 |
| 5 SD | 24 | 23,4 | 24 | 25,8 | 28 | 30,9 | 28 | 31,1 | 28 | 31,1 | 28 | 31,1 |
| | 40 | 30,3 | 40 | 34,7 | 44 | 39,5 | 44 | 42,4 | 44 | 42,4 | 44 | 42,4 |
| 6 SD | 24 | 27,7 | 28 | 33,2 | 32 | 39,2 | 36 | 42,7 | 36 | 42,7 | 36 | 42,7 |
| | 40 | 36,4 | 44 | 41,6 | 48 | 47,4 | 52 | 50,9 | 52 | 50,9 | 52 | 50,9 |
| 7 SD | 28 | 34,6 | 32 | 40,8 | 36 | 47,6 | 40 | 51,5 | 40 | 51,5 | 40 | 51,5 |
| | 44 | 42,6 | 48 | 48,6 | 52 | 55,3 | 56 | 59,8 | 56 | 59,8 | 56 | 59,8 |
| 8 SD | 32 | 41,7 | 36 | 48,6 | 40 | 56,2 | 44 | 60,5 | 44 | 60,5 | 44 | 60,5 |
| | 48 | 48,8 | 52 | 55,5 | 56 | 63,2 | 60 | 68,4 | 60 | 68,4 | 60 | 68,4 |
| 9 SD | 36 | 48,7 | 40 | 56,4 | 44 | 64,8 | 48 | 69,5 | 48 | 69,5 | 48 | 69,5 |
| | 52 | 54,9 | 56 | 62,5 | 60 | 71,1 | 64 | 77,0 | 64 | 77,0 | 64 | 77,0 |
| 10 SD | 40 | 55,8 | 44 | 64,1 | 48 | 73,3 | 52 | 78,7 | 52 | 78,7 | 52 | 78,7 |
| | 56 | 61,0 | 60 | 69,5 | 64 | 79,0 | 68 | 85,5 | 68 | 85,5 | 68 | 85,5 |
| 11 SD | 44 | 62,7 | 48 | 71,8 | 52 | 81,9 | 56 | 87,8 | 56 | 87,8 | 56 | 87,8 |
| | 60 | 67,1 | 64 | 76,4 | 68 | 86,9 | 72 | 94,1 | 72 | 94,1 | 72 | 94,1 |
| 12 SD | 44 | 67,9 | 52 | 79,5 | 56 | 90,4 | 60 | 96,9 | 60 | 96,9 | 60 | 96,9 |
| | 60 | 73,2 | 68 | 83,3 | 72 | 94,8 | 76 | 102,6 | 76 | 102,6 | 76 | 102,6 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø8 | | C24 | | Header | | Table 57 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 18,0 | 20 | 20,8 | 20 | 23,0 | 20 | 23,7 | 20 | 23,7 | 20 | 23,7 |
| | 20 | 18,0 | 20 | 20,8 | 24 | 23,3 | 24 | 25,1 | 24 | 25,1 | 24 | 25,1 |
| 4 SD | 20 | 23,5 | 20 | 25,5 | 20 | 27,4 | 20 | 27,8 | 20 | 27,8 | 20 | 27,8 |
| | 24 | 24,1 | 24 | 27,6 | 28 | 31,3 | 28 | 33,7 | 28 | 33,7 | 28 | 33,7 |
| 5 SD | 20 | 27,3 | 20 | 29,6 | 20 | 32,1 | 20 | 32,3 | 20 | 32,3 | 20 | 32,3 |
| | 24 | 30,4 | 28 | 34,5 | 28 | 39,3 | 32 | 42,3 | 32 | 42,3 | 32 | 42,3 |
| 6 SD | 20 | 31,2 | 20 | 34,0 | 20 | 37,0 | 20 | 37,1 | 20 | 37,1 | 20 | 37,1 |
| | 28 | 36,6 | 32 | 41,5 | 32 | 47,4 | 36 | 50,9 | 36 | 50,9 | 36 | 50,9 |
| 7 SD | 20 | 35,2 | 20 | 38,6 | 20 | 42,1 | 20 | 42,1 | 20 | 42,1 | 20 | 42,1 |
| | 32 | 42,5 | 32 | 48,5 | 36 | 55,2 | 36 | 59,5 | 36 | 59,5 | 36 | 59,5 |
| 8 SD | 20 | 39,4 | 20 | 43,3 | 24 | 51,4 | 24 | 51,8 | 24 | 51,8 | 24 | 51,8 |
| | 32 | 48,7 | 36 | 55,5 | 40 | 63,0 | 40 | 68,4 | 40 | 68,4 | 40 | 68,4 |
| 9 SD | 20 | 43,7 | 24 | 51,9 | 28 | 60,8 | 28 | 61,6 | 28 | 61,6 | 28 | 61,6 |
| | 36 | 54,9 | 40 | 62,4 | 44 | 70,9 | 44 | 77,0 | 44 | 77,0 | 44 | 77,0 |
| 10 SD | 24 | 51,7 | 24 | 56,4 | 28 | 65,7 | 32 | 71,4 | 32 | 71,4 | 32 | 71,4 |
| | 40 | 60,9 | 40 | 69,4 | 44 | 79,0 | 48 | 85,3 | 48 | 85,3 | 48 | 85,3 |
| 11 SD | 24 | 55,9 | 28 | 65,2 | 32 | 75,1 | 36 | 81,3 | 36 | 81,3 | 36 | 81,3 |
| | 40 | 67,2 | 44 | 76,4 | 48 | 86,9 | 52 | 93,9 | 52 | 93,9 | 52 | 93,9 |
| 12 SD | 28 | 63,9 | 32 | 73,8 | 36 | 84,4 | 36 | 86,0 | 36 | 86,0 | 36 | 86,0 |
| | 44 | 73,1 | 48 | 83,2 | 52 | 94,7 | 52 | 102,4 | 52 | 102,4 | 52 | 102,4 |

| R1,k | CNA4.0x50 | | 2-Row | | SD: Ø8 | | C24 | | Header | | Table 58 | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 16 | 13,4 | 16 | 14,5 | 18 | 17,2 | 20 | 19,0 | 20 | 19,0 | 20 | 19,0 |
| | 24 | 18,0 | 24 | 20,5 | 26 | 23,5 | 28 | 25,7 | 28 | 25,7 | 28 | 25,7 |
| 4 SD | 20 | 19,8 | 22 | 23,1 | 24 | 26,7 | 24 | 27,0 | 24 | 27,0 | 24 | 27,0 |
| | 28 | 24,2 | 30 | 27,6 | 32 | 31,5 | 32 | 33,9 | 32 | 33,9 | 32 | 33,9 |
| 5 SD | 22 | 25,1 | 26 | 30,6 | 28 | 34,8 | 30 | 37,4 | 30 | 37,4 | 30 | 37,4 |
| | 30 | 30,4 | 34 | 34,6 | 36 | 39,5 | 38 | 42,7 | 38 | 42,7 | 38 | 42,7 |
| 6 SD | 26 | 32,1 | 28 | 36,7 | 32 | 43,2 | 34 | 46,2 | 34 | 46,2 | 34 | 46,2 |
| | 34 | 36,6 | 36 | 41,6 | 40 | 47,4 | 42 | 51,3 | 42 | 51,3 | 42 | 51,3 |
| 7 SD | 30 | 39,2 | 32 | 44,5 | 36 | 51,7 | 38 | 55,1 | 38 | 55,1 | 38 | 55,1 |
| | 38 | 42,7 | 40 | 48,6 | 44 | 55,3 | 46 | 59,9 | 46 | 59,9 | 46 | 59,9 |
| 8 SD | 32 | 45,0 | 36 | 52,3 | 38 | 58,8 | 42 | 64,1 | 42 | 64,1 | 42 | 64,1 |
| | 40 | 48,8 | 44 | 55,6 | 46 | 63,1 | 50 | 68,4 | 50 | 68,4 | 50 | 68,4 |
| 9 SD | 36 | 52,1 | 38 | 58,7 | 42 | 67,3 | 46 | 73,2 | 46 | 73,2 | 46 | 73,2 |
| | 44 | 54,9 | 46 | 62,4 | 50 | 71,1 | 54 | 77,0 | 54 | 77,0 | 54 | 77,0 |
| 10 SD | 38 | 58,0 | 42 | 66,5 | 46 | 75,9 | 50 | 82,2 | 50 | 82,2 | 50 | 82,2 |
| | 46 | 61,1 | 50 | 69,5 | 54 | 79,0 | 58 | 85,5 | 58 | 85,5 | 58 | 85,5 |
| 11 SD | 40 | 63,9 | 46 | 74,2 | 50 | 84,3 | 50 | 88,1 | 50 | 88,1 | 50 | 88,1 |
| | 48 | 67,1 | 54 | 76,4 | 58 | 86,9 | 58 | 93,4 | 58 | 93,4 | 58 | 93,4 |
| 12 SD | 44 | 70,9 | 48 | 80,8 | 50 | 90,4 | 50 | 93,9 | 50 | 93,9 | 50 | 93,9 |
| | 52 | 73,3 | 56 | 83,4 | 58 | 94,3 | 58 | 100,2 | 58 | 100,2 | 58 | 100,2 |
| R1,k | CNA4.0x60 | | 2-Row | | SD: Ø8 | | C24 | | Header | | Table 59 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 12 | 11,5 | 14 | 14,2 | 16 | 17,0 | 16 | 17,0 | 16 | 17,0 | 16 | 17,0 |
| | 20 | 18,0 | 22 | 20,7 | 24 | 23,7 | 24 | 25,1 | 24 | 25,1 | 24 | 25,1 |
| 4 SD | 16 | 18,1 | 18 | 21,5 | 20 | 25,1 | 22 | 27,4 | 22 | 27,4 | 22 | 27,4 |
| | 24 | 24,3 | 26 | 27,7 | 28 | 31,6 | 30 | 34,1 | 30 | 34,1 | 30 | 34,1 |
| 5 SD | 20 | 25,2 | 22 | 29,3 | 24 | 33,7 | 26 | 36,3 | 26 | 36,3 | 26 | 36,3 |
| | 28 | 30,5 | 30 | 34,7 | 32 | 39,5 | 34 | 42,7 | 34 | 42,7 | 34 | 42,7 |
| 6 SD | 22 | 30,9 | 26 | 37,3 | 28 | 42,4 | 30 | 45,4 | 30 | 45,4 | 30 | 45,4 |
| | 30 | 36,5 | 34 | 41,5 | 36 | 47,4 | 38 | 51,3 | 38 | 51,3 | 38 | 51,3 |
| 7 SD | 26 | 38,3 | 28 | 43,7 | 32 | 51,2 | 34 | 54,7 | 34 | 54,7 | 34 | 54,7 |
| | 34 | 42,7 | 36 | 48,6 | 40 | 55,2 | 42 | 59,7 | 42 | 59,7 | 42 | 59,7 |
| 8 SD | 28 | 44,2 | 32 | 51,8 | 34 | 58,3 | 36 | 62,1 | 36 | 62,1 | 36 | 62,1 |
| | 36 | 48,8 | 40 | 55,5 | 42 | 63,1 | 44 | 68,3 | 44 | 68,3 | 44 | 68,3 |
| 9 SD | 32 | 51,7 | 34 | 58,3 | 38 | 67,2 | 40 | 71,5 | 40 | 71,5 | 40 | 71,5 |
| | 40 | 54,9 | 42 | 62,5 | 46 | 71,1 | 48 | 77,0 | 48 | 77,0 | 48 | 77,0 |
| 10 SD | 34 | 57,6 | 38 | 66,4 | 40 | 74,4 | 44 | 80,8 | 44 | 80,8 | 44 | 80,8 |
| | 42 | 61,1 | 46 | 69,4 | 48 | 78,9 | 52 | 85,5 | 52 | 85,5 | 52 | 85,5 |
| 11 SD | 36 | 63,6 | 40 | 73,0 | 44 | 83,2 | 48 | 90,2 | 48 | 90,2 | 48 | 90,2 |
| | 44 | 67,1 | 48 | 76,4 | 52 | 86,9 | 56 | 94,0 | 56 | 94,0 | 56 | 94,0 |
| 12 SD | 38 | 69,6 | 42 | 79,6 | 48 | 91,9 | 50 | 97,7 | 50 | 97,7 | 50 | 97,7 |
| | 46 | 73,2 | 50 | 83,3 | 56 | 94,8 | 58 | 102,6 | 58 | 102,6 | 58 | 102,6 |
| R1,k | CSA5.0x50 | | 2-Row | | SD: Ø8 | | C24 | | Header | | Table 60 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 10 | 14,1 | 10 | 15,0 | 10 | 15,9 | 10 | 15,9 | 10 | 15,9 | 10 | 15,9 |
| | 14 | 18,2 | 16 | 20,5 | 16 | 23,7 | 18 | 25,1 | 18 | 25,1 | 18 | 25,1 |
| 4 SD | 10 | 17,0 | 10 | 18,3 | 12 | 22,3 | 12 | 22,3 | 12 | 22,3 | 12 | 22,3 |
| | 16 | 24,3 | 18 | 27,7 | 20 | 31,3 | 20 | 34,1 | 20 | 34,1 | 20 | 34,1 |
| 5 SD | 12 | 22,7 | 12 | 24,4 | 14 | 29,0 | 16 | 32,1 | 16 | 32,1 | 16 | 32,1 |
| | 20 | 30,3 | 20 | 34,6 | 22 | 39,4 | 24 | 42,3 | 24 | 42,3 | 24 | 42,3 |
| 6 SD | 14 | 28,6 | 16 | 33,5 | 18 | 38,7 | 18 | 38,9 | 18 | 38,9 | 18 | 38,9 |
| | 22 | 36,4 | 24 | 41,5 | 26 | 47,2 | 26 | 51,0 | 26 | 51,0 | 26 | 51,0 |
| 7 SD | 16 | 34,5 | 18 | 39,8 | 20 | 45,4 | 22 | 49,0 | 22 | 49,0 | 22 | 49,0 |
| | 24 | 42,6 | 26 | 48,6 | 28 | 55,3 | 30 | 59,9 | 30 | 59,9 | 30 | 59,9 |
| 8 SD | 18 | 40,4 | 20 | 46,1 | 24 | 55,1 | 26 | 59,1 | 26 | 59,1 | 26 | 59,1 |
| | 26 | 48,8 | 28 | 55,5 | 32 | 63,0 | 34 | 68,1 | 34 | 68,1 | 34 | 68,1 |
| 9 SD | 20 | 46,3 | 24 | 55,3 | 26 | 61,6 | 28 | 65,7 | 28 | 65,7 | 28 | 65,7 |
| | 28 | 54,9 | 32 | 62,4 | 34 | 71,1 | 36 | 77,0 | 36 | 77,0 | 36 | 77,0 |
| 10 SD | 22 | 52,1 | 26 | 61,5 | 30 | 71,3 | 32 | 75,8 | 32 | 75,8 | 32 | 75,8 |
| | 30 | 61,0 | 34 | 69,3 | 38 | 78,8 | 40 | 85,3 | 40 | 85,3 | 40 | 85,3 |
| 11 SD | 24 | 57,8 | 28 | 67,6 | 32 | 77,7 | 34 | 82,2 | 34 | 82,2 | 34 | 82,2 |
| | 32 | 67,1 | 36 | 76,4 | 40 | 86,9 | 42 | 94,0 | 42 | 94,0 | 42 | 94,0 |
| 12 SD | 26 | 63,5 | 30 | 73,5 | 36 | 87,3 | 38 | 92,2 | 38 | 92,2 | 38 | 92,2 |
| | 34 | 73,1 | 38 | 83,3 | 44 | 94,7 | 46 | 102,6 | 46 | 102,6 | 46 | 102,6 |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø8 | | C24 | | Column | | Table 61 | | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|--|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 8,3 | 8 | 9,4 | 12 | 12,4 | 12 | 12,4 | 12 | 12,4 | 12 | 12,4 | |
| | 24 | 18,0 | 24 | 20,5 | 28 | 23,3 | 28 | 25,7 | 28 | 25,7 | 28 | 25,7 | |
| 4 SD | 12 | 14,1 | 16 | 18,3 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 | |
| | 28 | 24,2 | 32 | 27,5 | 32 | 31,5 | 32 | 33,9 | 32 | 33,9 | 32 | 33,9 | |
| 5 SD | 16 | 20,6 | 16 | 22,8 | 20 | 28,0 | 20 | 28,0 | 20 | 28,0 | 20 | 28,0 | |
| | 32 | 30,3 | 32 | 34,5 | 36 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 | |
| 6 SD | 20 | 27,6 | 20 | 30,4 | 24 | 36,6 | 28 | 40,4 | 28 | 40,4 | 28 | 40,4 | |
| | 36 | 36,4 | 36 | 41,6 | 40 | 47,4 | 44 | 50,9 | 44 | 50,9 | 44 | 50,9 | |
| 7 SD | 20 | 32,0 | 24 | 38,4 | 28 | 45,3 | 28 | 45,8 | 28 | 45,8 | 28 | 45,8 | |
| | 36 | 42,5 | 40 | 48,6 | 44 | 55,3 | 44 | 59,5 | 44 | 59,5 | 44 | 59,5 | |
| 8 SD | 24 | 39,3 | 28 | 46,4 | 32 | 54,1 | 32 | 55,0 | 32 | 55,0 | 32 | 55,0 | |
| | 40 | 48,8 | 44 | 55,6 | 48 | 63,1 | 48 | 68,1 | 48 | 68,1 | 48 | 68,1 | |
| 9 SD | 28 | 46,7 | 32 | 54,5 | 36 | 62,9 | 36 | 64,2 | 36 | 64,2 | 36 | 64,2 | |
| | 44 | 54,9 | 48 | 62,4 | 52 | 71,0 | 52 | 76,8 | 52 | 76,8 | 52 | 76,8 | |
| 10 SD | 32 | 54,0 | 36 | 62,5 | 40 | 71,7 | 40 | 73,5 | 40 | 73,5 | 40 | 73,5 | |
| | 48 | 60,9 | 52 | 69,3 | 56 | 78,8 | 56 | 85,4 | 56 | 85,4 | 56 | 85,4 | |
| 11 SD | 32 | 58,7 | 36 | 67,7 | 44 | 80,4 | 44 | 82,8 | 44 | 82,8 | 44 | 82,8 | |
| | 48 | 67,1 | 52 | 76,3 | 60 | 86,8 | 60 | 94,0 | 60 | 94,0 | 60 | 94,0 | |
| 12 SD | 36 | 66,0 | 40 | 75,7 | 44 | 86,1 | 44 | 88,3 | 44 | 88,3 | 44 | 88,3 | |
| | 52 | 73,3 | 56 | 83,4 | 60 | 94,7 | 60 | 101,3 | 60 | 101,3 | 60 | 101,3 | |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø8 | | C24 | | Column | | Table 62 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 8,8 | 8 | 9,8 | 8 | 10,5 | 12 | 13,4 | 12 | 13,4 | 12 | 13,4 | |
| | 20 | 18,0 | 24 | 20,5 | 24 | 23,7 | 28 | 25,1 | 28 | 25,1 | 28 | 25,1 | |
| 4 SD | 8 | 12,3 | 12 | 16,5 | 12 | 17,8 | 16 | 21,2 | 16 | 21,2 | 16 | 21,2 | |
| | 24 | 24,3 | 28 | 27,5 | 28 | 31,6 | 32 | 33,7 | 32 | 33,7 | 32 | 33,7 | |
| 5 SD | 12 | 18,8 | 16 | 24,0 | 16 | 26,0 | 20 | 29,9 | 20 | 29,9 | 20 | 29,9 | |
| | 28 | 30,5 | 32 | 34,5 | 32 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 | |
| 6 SD | 16 | 25,9 | 20 | 32,0 | 20 | 34,9 | 24 | 39,0 | 24 | 39,0 | 24 | 39,0 | |
| | 32 | 36,4 | 36 | 41,5 | 36 | 47,4 | 40 | 50,9 | 40 | 50,9 | 40 | 50,9 | |
| 7 SD | 20 | 33,4 | 20 | 36,8 | 24 | 44,0 | 24 | 44,2 | 24 | 44,2 | 24 | 44,2 | |
| | 36 | 42,5 | 36 | 48,6 | 40 | 55,2 | 40 | 59,6 | 40 | 59,6 | 40 | 59,6 | |
| 8 SD | 20 | 37,8 | 24 | 45,1 | 28 | 53,0 | 28 | 53,7 | 28 | 53,7 | 28 | 53,7 | |
| | 36 | 48,8 | 40 | 55,5 | 44 | 63,0 | 44 | 68,3 | 44 | 68,3 | 44 | 68,3 | |
| 9 SD | 24 | 45,4 | 28 | 53,4 | 32 | 62,1 | 32 | 63,2 | 32 | 63,2 | 32 | 63,2 | |
| | 40 | 54,9 | 44 | 62,4 | 48 | 70,9 | 48 | 77,0 | 48 | 77,0 | 48 | 77,0 | |
| 10 SD | 28 | 53,1 | 28 | 58,4 | 32 | 67,5 | 36 | 72,8 | 36 | 72,8 | 36 | 72,8 | |
| | 44 | 60,9 | 44 | 69,3 | 48 | 78,9 | 52 | 85,5 | 52 | 85,5 | 52 | 85,5 | |
| 11 SD | 28 | 57,6 | 32 | 66,7 | 36 | 76,6 | 40 | 82,4 | 40 | 82,4 | 40 | 82,4 | |
| | 44 | 67,1 | 48 | 76,4 | 52 | 86,9 | 56 | 94,0 | 56 | 94,0 | 56 | 94,0 | |
| 12 SD | 32 | 65,3 | 36 | 75,1 | 40 | 85,6 | 44 | 91,9 | 44 | 91,9 | 44 | 91,9 | |
| | 48 | 73,2 | 52 | 83,3 | 56 | 94,8 | 60 | 102,4 | 60 | 102,4 | 60 | 102,4 | |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø8 | | C24 | | Column | | Table 63 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 11,5 | 8 | 12,4 | 8 | 13,1 | 8 | 13,1 | 8 | 13,1 | 8 | 13,1 | |
| | 16 | 18,0 | 16 | 20,5 | 16 | 23,7 | 20 | 25,1 | 20 | 25,1 | 20 | 25,1 | |
| 4 SD | 8 | 14,5 | 8 | 15,8 | 8 | 16,9 | 8 | 16,9 | 8 | 16,9 | 8 | 16,9 | |
| | 16 | 24,3 | 20 | 27,5 | 20 | 31,3 | 20 | 34,1 | 20 | 34,1 | 20 | 34,1 | |
| 5 SD | 8 | 17,8 | 8 | 19,3 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | 8 | 20,1 | |
| | 20 | 30,3 | 20 | 34,6 | 24 | 39,2 | 24 | 42,3 | 24 | 42,3 | 24 | 42,3 | |
| 6 SD | 8 | 20,1 | 8 | 20,1 | 12 | 29,3 | 12 | 29,3 | 12 | 29,3 | 12 | 29,3 | |
| | 24 | 36,4 | 24 | 41,5 | 28 | 47,2 | 28 | 50,9 | 28 | 50,9 | 28 | 50,9 | |
| 7 SD | 8 | 20,1 | 12 | 30,1 | 12 | 30,1 | 16 | 38,9 | 16 | 38,9 | 16 | 38,9 | |
| | 24 | 42,6 | 28 | 48,4 | 28 | 55,3 | 32 | 59,5 | 32 | 59,5 | 32 | 59,5 | |
| 8 SD | 12 | 30,1 | 12 | 30,1 | 16 | 40,2 | 20 | 48,7 | 20 | 48,7 | 20 | 48,7 | |
| | 28 | 48,7 | 28 | 55,5 | 32 | 63,0 | 36 | 68,1 | 36 | 68,1 | 36 | 68,1 | |
| 9 SD | 12 | 30,1 | 16 | 40,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | |
| | 28 | 54,9 | 32 | 62,4 | 36 | 70,9 | 36 | 77,0 | 36 | 77,0 | 36 | 77,0 | |
| 10 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 24 | 60,2 | 24 | 60,2 | 24 | 60,2 | |
| | 32 | 60,9 | 36 | 69,3 | 40 | 78,8 | 40 | 85,3 | 40 | 85,3 | 40 | 85,3 | |
| 11 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 28 | 70,2 | 28 | 70,2 | 28 | 70,2 | |
| | 32 | 67,1 | 36 | 76,4 | 40 | 86,9 | 44 | 93,9 | 44 | 93,9 | 44 | 93,9 | |
| 12 SD | 20 | 50,2 | 24 | 60,2 | 28 | 70,3 | 32 | 80,1 | 32 | 80,1 | 32 | 80,1 | |
| | 36 | 73,1 | 40 | 83,2 | 44 | 94,7 | 48 | 102,4 | 48 | 102,4 | 48 | 102,4 | |

| R1,k | CNA4.0x50 | | 2-Row | | SD: Ø8 | | C24 | | Column | | Table 64 | | |
|---|-----------|------|-------|------|--------|------|-------|------|--------|------|----------|------|--|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 10 | 11,6 | 10 | 12,5 | 12 | 15,5 | 12 | 15,5 | 12 | 15,5 | 12 | 15,5 | |
| | 18 | 18,0 | 18 | 20,7 | 20 | 23,7 | 20 | 25,2 | 20 | 25,2 | 20 | 25,2 | |
| 4 SD | 12 | 16,7 | 14 | 20,2 | 16 | 24,0 | 16 | 24,0 | 16 | 24,0 | 16 | 24,0 | |
| | 20 | 24,4 | 22 | 27,8 | 24 | 31,5 | 24 | 33,8 | 24 | 33,8 | 24 | 33,8 | |
| 5 SD | 16 | 24,2 | 18 | 28,4 | 20 | 32,8 | 20 | 33,1 | 20 | 33,1 | 20 | 33,1 | |
| | 24 | 30,3 | 26 | 34,5 | 28 | 39,2 | 28 | 42,6 | 28 | 42,6 | 28 | 42,6 | |
| 6 SD | 18 | 29,8 | 20 | 34,5 | 22 | 39,4 | 22 | 39,7 | 22 | 39,7 | 22 | 39,7 | |
| | 26 | 36,6 | 28 | 41,7 | 30 | 47,3 | 30 | 49,8 | 30 | 49,8 | 30 | 49,8 | |
| 7 SD | 20 | 35,5 | 22 | 40,6 | 22 | 43,6 | 22 | 43,7 | 22 | 43,7 | 22 | 43,7 | |
| | 28 | 42,6 | 30 | 48,3 | 30 | 52,8 | 30 | 54,3 | 30 | 54,3 | 30 | 54,3 | |
| 8 SD | 22 | 41,2 | 22 | 44,4 | 22 | 47,2 | 22 | 47,2 | 22 | 47,2 | 22 | 47,2 | |
| | 30 | 48,5 | 30 | 53,2 | 30 | 57,3 | 30 | 58,4 | 30 | 58,4 | 30 | 58,4 | |
| 9 SD | 22 | 44,7 | 22 | 47,7 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | |
| | 30 | 52,9 | 30 | 57,4 | 30 | 61,5 | 30 | 62,1 | 30 | 62,1 | 30 | 62,1 | |
| 10 SD | 22 | 47,7 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | |
| | 30 | 56,9 | 30 | 61,3 | 30 | 64,9 | 30 | 65,2 | 30 | 65,2 | 30 | 65,2 | |
| 11 SD | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | |
| | 30 | 60,5 | 30 | 64,6 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | |
| 12 SD | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | 22 | 48,8 | |
| | 30 | 63,8 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | 30 | 66,5 | |
| R1,k | CNA4.0x60 | | 2-Row | | SD: Ø8 | | C24 | | Column | | Table 65 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 8 | 10,6 | 8 | 11,5 | 10 | 14,5 | 10 | 14,5 | 10 | 14,5 | 10 | 14,5 | |
| | 16 | 18,0 | 16 | 20,6 | 18 | 23,7 | 18 | 25,1 | 18 | 25,1 | 18 | 25,1 | |
| 4 SD | 10 | 15,7 | 12 | 19,4 | 14 | 23,3 | 14 | 23,3 | 14 | 23,3 | 14 | 23,3 | |
| | 18 | 24,4 | 20 | 27,7 | 22 | 31,3 | 22 | 34,0 | 22 | 34,0 | 22 | 34,0 | |
| 5 SD | 14 | 23,6 | 14 | 25,4 | 16 | 29,9 | 18 | 32,7 | 18 | 32,7 | 18 | 32,7 | |
| | 22 | 30,3 | 22 | 34,5 | 24 | 39,3 | 26 | 42,8 | 26 | 42,8 | 26 | 42,8 | |
| 6 SD | 16 | 29,3 | 18 | 34,1 | 20 | 39,2 | 22 | 42,4 | 22 | 42,4 | 22 | 42,4 | |
| | 24 | 36,4 | 26 | 41,5 | 28 | 47,4 | 30 | 50,9 | 30 | 50,9 | 30 | 50,9 | |
| 7 SD | 18 | 35,1 | 20 | 40,4 | 22 | 45,9 | 22 | 46,2 | 22 | 46,2 | 22 | 46,2 | |
| | 26 | 42,7 | 28 | 48,6 | 30 | 55,0 | 30 | 57,6 | 30 | 57,6 | 30 | 57,6 | |
| 8 SD | 20 | 41,0 | 22 | 46,6 | 22 | 49,5 | 22 | 49,6 | 22 | 49,6 | 22 | 49,6 | |
| | 28 | 48,8 | 30 | 55,3 | 30 | 60,2 | 30 | 61,8 | 30 | 61,8 | 30 | 61,8 | |
| 9 SD | 22 | 46,8 | 22 | 49,9 | 22 | 51,9 | 22 | 51,9 | 22 | 51,9 | 22 | 51,9 | |
| | 30 | 54,8 | 30 | 60,1 | 30 | 64,5 | 30 | 65,5 | 30 | 65,5 | 30 | 65,5 | |
| 10 SD | 22 | 49,9 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | |
| | 30 | 59,3 | 30 | 64,1 | 30 | 68,1 | 30 | 68,7 | 30 | 68,7 | 30 | 68,7 | |
| 11 SD | 22 | 51,9 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | |
| | 30 | 63,1 | 30 | 67,6 | 30 | 70,6 | 30 | 70,7 | 30 | 70,7 | 30 | 70,7 | |
| 12 SD | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | 22 | 52,0 | |
| | 30 | 66,5 | 30 | 70,2 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | 30 | 70,9 | |
| R1,k | CSA5.0x50 | | 2-Row | | SD: Ø8 | | C24 | | Column | | Table 66 | | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | | |
| | | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | |
| 3 SD | 4 | 8,3 | 4 | 9,0 | 6 | 12,4 | 6 | 12,4 | 6 | 12,4 | 6 | 12,4 | |
| | 12 | 18,0 | 12 | 20,5 | 14 | 23,3 | 14 | 25,1 | 14 | 25,1 | 14 | 25,1 | |
| 4 SD | 6 | 13,5 | 6 | 14,3 | 8 | 18,4 | 8 | 18,4 | 8 | 18,4 | 8 | 18,4 | |
| | 14 | 24,1 | 14 | 27,7 | 16 | 31,3 | 16 | 33,7 | 16 | 33,7 | 16 | 33,7 | |
| 5 SD | 8 | 18,9 | 10 | 23,4 | 10 | 24,2 | 12 | 28,2 | 12 | 28,2 | 12 | 28,2 | |
| | 16 | 30,3 | 18 | 34,5 | 18 | 39,2 | 20 | 42,3 | 20 | 42,3 | 20 | 42,3 | |
| 6 SD | 10 | 24,3 | 12 | 29,1 | 14 | 34,1 | 16 | 38,2 | 16 | 38,2 | 16 | 38,2 | |
| | 18 | 36,4 | 20 | 41,5 | 22 | 47,2 | 24 | 50,9 | 24 | 50,9 | 24 | 50,9 | |
| 7 SD | 12 | 29,6 | 14 | 34,6 | 16 | 39,7 | 18 | 44,1 | 18 | 44,1 | 18 | 44,1 | |
| | 20 | 42,5 | 22 | 48,5 | 24 | 55,1 | 26 | 59,9 | 26 | 59,9 | 26 | 59,9 | |
| 8 SD | 14 | 34,9 | 18 | 44,3 | 20 | 49,6 | 22 | 54,1 | 22 | 54,1 | 22 | 54,1 | |
| | 22 | 48,8 | 26 | 55,4 | 28 | 63,0 | 30 | 68,1 | 30 | 68,1 | 30 | 68,1 | |
| 9 SD | 16 | 40,1 | 20 | 49,8 | 22 | 55,0 | 22 | 55,1 | 22 | 55,1 | 22 | 55,1 | |
| | 24 | 54,9 | 28 | 62,4 | 30 | 71,0 | 30 | 72,8 | 30 | 72,8 | 30 | 72,8 | |
| 10 SD | 20 | 49,7 | 22 | 55,1 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | |
| | 28 | 60,9 | 30 | 69,3 | 30 | 73,7 | 30 | 74,2 | 30 | 74,2 | 30 | 74,2 | |
| 11 SD | 22 | 55,0 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | |
| | 30 | 67,0 | 30 | 73,2 | 30 | 74,9 | 30 | 75,1 | 30 | 75,1 | 30 | 75,1 | |
| 12 SD | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | 22 | 55,2 | |
| | 30 | 72,2 | 30 | 74,7 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | 30 | 75,3 | |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø8 | | CLT | | Column | | Table 67 | |
|---|-----------|------|-------|------|--------|------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 7,0 | 8 | 7,7 | 12 | 10,8 | 12 | 11,3 | 12 | 11,3 | 12 | 11,3 |
| | 24 | 18,0 | 24 | 20,5 | 28 | 23,3 | 28 | 25,7 | 28 | 25,7 | 28 | 25,7 |
| 4 SD | 12 | 12,2 | 16 | 16,3 | 16 | 17,5 | 16 | 18,3 | 16 | 18,3 | 16 | 18,3 |
| | 28 | 24,1 | 32 | 27,5 | 32 | 31,4 | 32 | 33,8 | 32 | 33,8 | 32 | 33,8 |
| 5 SD | 16 | 18,4 | 16 | 19,9 | 20 | 25,0 | 20 | 26,1 | 20 | 26,1 | 20 | 26,1 |
| | 32 | 30,3 | 32 | 34,5 | 36 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 |
| 6 SD | 20 | 25,2 | 20 | 27,2 | 24 | 33,1 | 28 | 38,7 | 28 | 38,7 | 28 | 38,7 |
| | 36 | 36,4 | 36 | 41,5 | 40 | 47,4 | 44 | 50,9 | 44 | 50,9 | 44 | 50,9 |
| 7 SD | 24 | 32,4 | 24 | 34,9 | 28 | 41,6 | 32 | 47,7 | 32 | 47,7 | 32 | 47,7 |
| | 40 | 42,5 | 40 | 48,6 | 44 | 55,3 | 48 | 59,5 | 48 | 59,5 | 48 | 59,5 |
| 8 SD | 24 | 36,2 | 28 | 42,9 | 32 | 50,3 | 36 | 56,9 | 36 | 56,9 | 36 | 56,9 |
| | 40 | 48,8 | 44 | 55,6 | 48 | 63,1 | 52 | 68,1 | 52 | 68,1 | 52 | 68,1 |
| 9 SD | 28 | 43,7 | 32 | 51,1 | 36 | 59,2 | 36 | 61,9 | 36 | 61,9 | 36 | 61,9 |
| | 44 | 54,9 | 48 | 62,4 | 52 | 70,9 | 52 | 76,7 | 52 | 76,7 | 52 | 76,7 |
| 10 SD | 32 | 51,3 | 36 | 59,3 | 40 | 68,1 | 40 | 71,2 | 40 | 71,2 | 40 | 71,2 |
| | 48 | 60,9 | 52 | 69,3 | 56 | 78,8 | 56 | 85,3 | 56 | 85,3 | 56 | 85,3 |
| 11 SD | 32 | 55,4 | 36 | 63,8 | 44 | 77,0 | 44 | 80,6 | 44 | 80,6 | 44 | 80,6 |
| | 48 | 67,0 | 52 | 76,3 | 60 | 86,8 | 60 | 94,0 | 60 | 94,0 | 60 | 94,0 |
| 12 SD | 36 | 63,0 | 40 | 72,1 | 44 | 81,9 | 44 | 85,6 | 44 | 85,6 | 44 | 85,6 |
| | 52 | 73,3 | 56 | 83,4 | 60 | 94,7 | 60 | 100,9 | 60 | 100,9 | 60 | 100,9 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø8 | | CLT | | Column | | Table 68 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 7,5 | 8 | 8,1 | 8 | 8,9 | 12 | 12,3 | 12 | 12,3 | 12 | 12,3 |
| | 24 | 18,0 | 24 | 20,5 | 24 | 23,7 | 28 | 25,1 | 28 | 25,1 | 28 | 25,1 |
| 4 SD | 8 | 10,6 | 12 | 14,2 | 12 | 15,4 | 16 | 19,8 | 16 | 19,8 | 16 | 19,8 |
| | 24 | 24,3 | 28 | 27,5 | 28 | 31,5 | 32 | 33,7 | 32 | 33,7 | 32 | 33,7 |
| 5 SD | 12 | 16,4 | 16 | 21,3 | 16 | 23,0 | 20 | 28,2 | 20 | 28,2 | 20 | 28,2 |
| | 28 | 30,5 | 32 | 34,5 | 32 | 39,5 | 36 | 42,3 | 36 | 42,3 | 36 | 42,3 |
| 6 SD | 16 | 23,3 | 20 | 29,1 | 20 | 31,3 | 24 | 37,2 | 24 | 37,2 | 24 | 37,2 |
| | 32 | 36,4 | 36 | 41,5 | 36 | 47,4 | 40 | 50,9 | 40 | 50,9 | 40 | 50,9 |
| 7 SD | 20 | 30,7 | 20 | 33,2 | 24 | 40,1 | 24 | 41,9 | 24 | 41,9 | 24 | 41,9 |
| | 36 | 42,5 | 36 | 48,6 | 40 | 55,1 | 40 | 59,5 | 40 | 59,5 | 40 | 59,5 |
| 8 SD | 20 | 34,5 | 24 | 41,5 | 28 | 49,1 | 28 | 51,3 | 28 | 51,3 | 28 | 51,3 |
| | 36 | 48,8 | 40 | 55,5 | 44 | 63,0 | 44 | 68,2 | 44 | 68,2 | 44 | 68,2 |
| 9 SD | 24 | 42,3 | 28 | 49,9 | 32 | 58,3 | 32 | 60,9 | 32 | 60,9 | 32 | 60,9 |
| | 40 | 54,8 | 44 | 62,4 | 48 | 70,9 | 48 | 76,9 | 48 | 76,9 | 48 | 76,9 |
| 10 SD | 28 | 50,2 | 28 | 54,2 | 32 | 62,9 | 36 | 70,5 | 36 | 70,5 | 36 | 70,5 |
| | 44 | 60,9 | 44 | 69,3 | 48 | 78,8 | 52 | 85,5 | 52 | 85,5 | 52 | 85,5 |
| 11 SD | 28 | 54,2 | 32 | 62,8 | 36 | 72,2 | 40 | 80,1 | 40 | 80,1 | 40 | 80,1 |
| | 44 | 67,1 | 48 | 76,4 | 52 | 86,9 | 56 | 94,0 | 56 | 94,0 | 56 | 94,0 |
| 12 SD | 32 | 62,1 | 36 | 71,4 | 40 | 81,4 | 44 | 89,8 | 44 | 89,8 | 44 | 89,8 |
| | 48 | 73,1 | 52 | 83,2 | 56 | 94,8 | 60 | 102,4 | 60 | 102,4 | 60 | 102,4 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø8 | | CLT | | Column | | Table 69 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 10,5 | 8 | 11,1 | 8 | 11,8 | 8 | 12,2 | 8 | 12,2 | 8 | 12,2 |
| | 16 | 18,0 | 16 | 20,5 | 16 | 23,7 | 20 | 25,1 | 20 | 25,1 | 20 | 25,1 |
| 4 SD | 8 | 13,0 | 8 | 13,9 | 8 | 14,9 | 8 | 15,5 | 8 | 15,5 | 8 | 15,5 |
| | 16 | 24,2 | 20 | 27,5 | 20 | 31,3 | 20 | 34,1 | 20 | 34,1 | 20 | 34,1 |
| 5 SD | 8 | 15,7 | 8 | 17,8 | 8 | 19,8 | 8 | 19,8 | 8 | 19,8 | 8 | 19,8 |
| | 20 | 30,3 | 20 | 34,5 | 24 | 39,2 | 24 | 42,3 | 24 | 42,3 | 24 | 42,3 |
| 6 SD | 8 | 20,1 | 8 | 20,1 | 12 | 26,9 | 12 | 27,8 | 12 | 27,8 | 12 | 27,8 |
| | 24 | 36,4 | 24 | 41,5 | 28 | 47,2 | 28 | 50,9 | 28 | 50,9 | 28 | 50,9 |
| 7 SD | 8 | 20,1 | 12 | 30,1 | 12 | 30,1 | 16 | 37,4 | 16 | 37,4 | 16 | 37,4 |
| | 24 | 42,5 | 28 | 48,4 | 28 | 55,3 | 32 | 59,5 | 32 | 59,5 | 32 | 59,5 |
| 8 SD | 12 | 30,1 | 12 | 30,1 | 16 | 40,2 | 20 | 47,2 | 20 | 47,2 | 20 | 47,2 |
| | 28 | 48,7 | 28 | 55,5 | 32 | 63,0 | 36 | 68,1 | 36 | 68,1 | 36 | 68,1 |
| 9 SD | 12 | 30,1 | 16 | 40,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 | 20 | 50,2 |
| | 28 | 54,9 | 32 | 62,4 | 36 | 70,9 | 36 | 77,0 | 36 | 77,0 | 36 | 77,0 |
| 10 SD | 16 | 40,2 | 20 | 50,2 | 24 | 59,1 | 24 | 59,4 | 24 | 59,4 | 24 | 59,4 |
| | 32 | 60,9 | 36 | 69,3 | 40 | 78,8 | 40 | 85,3 | 40 | 85,3 | 40 | 85,3 |
| 11 SD | 16 | 40,2 | 20 | 50,2 | 24 | 60,2 | 28 | 69,3 | 28 | 69,3 | 28 | 69,3 |
| | 32 | 67,0 | 36 | 76,4 | 40 | 86,9 | 44 | 93,9 | 44 | 93,9 | 44 | 93,9 |
| 12 SD | 20 | 50,2 | 24 | 60,2 | 28 | 70,3 | 32 | 79,3 | 32 | 79,3 | 32 | 79,3 |
| | 36 | 73,1 | 40 | 83,2 | 44 | 94,7 | 48 | 102,4 | 48 | 102,4 | 48 | 102,4 |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø10 | | C24 | | Header | | Table 70 | |
|---|-----------|------|-------|-------|---------|-------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 24 | 17,4 | 24 | 18,6 | 28 | 22,6 | 28 | 24,1 | 32 | 27,3 | 32 | 27,3 |
| | 40 | 24,7 | 40 | 27,3 | 44 | 30,3 | 44 | 33,8 | 48 | 37,3 | 48 | 37,4 |
| 4 SD | 28 | 24,7 | 32 | 29,1 | 32 | 31,2 | 36 | 36,4 | 40 | 40,4 | 40 | 40,4 |
| | 44 | 33,0 | 48 | 36,4 | 48 | 40,5 | 52 | 45,0 | 56 | 49,8 | 56 | 49,9 |
| 5 SD | 32 | 32,5 | 36 | 37,6 | 40 | 43,3 | 44 | 49,4 | 48 | 54,3 | 48 | 54,3 |
| | 48 | 41,3 | 52 | 45,5 | 56 | 50,6 | 60 | 56,3 | 64 | 62,3 | 64 | 62,5 |
| 6 SD | 40 | 43,3 | 40 | 46,6 | 44 | 53,0 | 48 | 59,9 | 52 | 65,4 | 52 | 65,4 |
| | 56 | 49,6 | 56 | 54,6 | 60 | 60,8 | 64 | 67,6 | 68 | 74,8 | 68 | 75,1 |
| 7 SD | 44 | 51,7 | 48 | 58,1 | 52 | 65,4 | 56 | 73,3 | 60 | 80,0 | 60 | 80,0 |
| | 60 | 57,9 | 64 | 63,7 | 68 | 70,9 | 72 | 78,8 | 76 | 87,2 | 76 | 87,5 |
| 8 SD | 48 | 60,2 | 52 | 67,3 | 56 | 75,5 | 60 | 84,2 | 64 | 91,6 | 64 | 91,6 |
| | 64 | 66,2 | 68 | 72,9 | 72 | 81,0 | 76 | 90,1 | 80 | 99,8 | 80 | 100,1 |
| 9 SD | 52 | 68,9 | 56 | 76,7 | 60 | 85,6 | 68 | 97,4 | 72 | 106,3 | 72 | 106,3 |
| | 68 | 74,5 | 72 | 82,0 | 76 | 91,2 | 84 | 101,4 | 88 | 112,2 | 88 | 112,6 |
| 10 SD | 56 | 77,5 | 60 | 86,0 | 64 | 95,8 | 72 | 108,5 | 76 | 118,2 | 76 | 118,2 |
| | 72 | 82,7 | 76 | 91,1 | 80 | 101,3 | 88 | 112,6 | 92 | 124,7 | 92 | 125,2 |
| 11 SD | 60 | 86,2 | 64 | 95,4 | 68 | 106,1 | 76 | 119,6 | 80 | 130,2 | 84 | 132,6 |
| | 76 | 91,0 | 80 | 100,2 | 84 | 111,4 | 92 | 123,9 | 96 | 137,1 | 100 | 137,6 |
| 12 SD | 64 | 94,9 | 68 | 104,8 | 76 | 118,1 | 80 | 130,7 | 88 | 144,6 | 88 | 144,6 |
| | 80 | 99,3 | 84 | 109,3 | 92 | 121,6 | 96 | 135,2 | 104 | 149,6 | 104 | 150,2 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø10 | | C24 | | Header | | Table 71 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 16,4 | 20 | 17,6 | 24 | 21,8 | 24 | 23,2 | 28 | 26,7 | 28 | 26,7 |
| | 36 | 24,7 | 36 | 27,3 | 40 | 30,3 | 40 | 33,7 | 44 | 37,3 | 44 | 37,4 |
| 4 SD | 24 | 23,9 | 28 | 28,6 | 28 | 30,7 | 32 | 36,1 | 32 | 36,8 | 32 | 36,8 |
| | 40 | 33,0 | 44 | 36,4 | 44 | 40,5 | 48 | 45,0 | 48 | 49,8 | 48 | 50,0 |
| 5 SD | 28 | 32,0 | 32 | 37,4 | 32 | 40,3 | 36 | 46,5 | 40 | 51,3 | 40 | 51,3 |
| | 44 | 41,4 | 48 | 45,5 | 48 | 50,6 | 52 | 56,3 | 56 | 62,3 | 56 | 62,5 |
| 6 SD | 32 | 40,5 | 36 | 46,5 | 40 | 53,3 | 44 | 60,5 | 48 | 66,4 | 48 | 66,4 |
| | 48 | 49,6 | 52 | 54,6 | 56 | 60,7 | 60 | 67,5 | 64 | 74,8 | 64 | 75,0 |
| 7 SD | 36 | 49,2 | 40 | 55,9 | 44 | 63,5 | 48 | 71,5 | 52 | 78,0 | 52 | 78,0 |
| | 52 | 57,9 | 56 | 63,8 | 60 | 70,9 | 64 | 78,8 | 68 | 87,2 | 68 | 87,5 |
| 8 SD | 40 | 58,1 | 44 | 65,5 | 48 | 73,8 | 52 | 82,7 | 56 | 90,0 | 56 | 90,0 |
| | 56 | 66,1 | 60 | 72,9 | 64 | 81,1 | 68 | 90,1 | 72 | 99,7 | 72 | 100,1 |
| 9 SD | 44 | 67,0 | 48 | 75,1 | 52 | 84,2 | 60 | 96,5 | 64 | 105,3 | 64 | 105,3 |
| | 60 | 74,4 | 64 | 82,0 | 68 | 91,2 | 76 | 101,4 | 80 | 112,2 | 80 | 112,6 |
| 10 SD | 48 | 76,0 | 52 | 84,7 | 56 | 94,6 | 64 | 107,7 | 68 | 117,4 | 68 | 117,4 |
| | 64 | 82,7 | 68 | 91,1 | 72 | 101,3 | 80 | 112,6 | 84 | 124,7 | 84 | 125,2 |
| 11 SD | 52 | 84,9 | 56 | 94,3 | 60 | 105,1 | 68 | 119,0 | 72 | 129,5 | 72 | 129,5 |
| | 68 | 91,0 | 72 | 100,2 | 76 | 111,4 | 84 | 123,9 | 88 | 137,2 | 88 | 137,7 |
| 12 SD | 56 | 93,8 | 60 | 103,9 | 68 | 117,6 | 72 | 130,3 | 76 | 141,7 | 80 | 144,5 |
| | 72 | 99,3 | 76 | 109,3 | 84 | 121,6 | 88 | 135,2 | 92 | 149,6 | 96 | 150,1 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø10 | | C24 | | Header | | Table 72 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 23,9 | 20 | 25,2 | 20 | 26,7 | 20 | 28,2 | 20 | 28,7 | 20 | 28,7 |
| | 24 | 24,7 | 24 | 27,3 | 24 | 30,4 | 28 | 33,7 | 28 | 37,3 | 28 | 37,4 |
| 4 SD | 20 | 28,4 | 20 | 30,0 | 20 | 31,9 | 20 | 33,9 | 20 | 34,3 | 20 | 34,3 |
| | 28 | 33,0 | 28 | 36,4 | 32 | 40,5 | 32 | 45,0 | 36 | 49,8 | 36 | 49,9 |
| 5 SD | 20 | 33,0 | 20 | 35,2 | 20 | 37,7 | 20 | 40,2 | 24 | 45,8 | 24 | 45,8 |
| | 32 | 41,3 | 32 | 45,5 | 36 | 50,6 | 36 | 56,3 | 40 | 62,3 | 40 | 62,5 |
| 6 SD | 20 | 38,0 | 20 | 40,7 | 24 | 48,3 | 24 | 51,4 | 28 | 57,6 | 28 | 57,6 |
| | 32 | 49,6 | 36 | 54,6 | 40 | 60,7 | 40 | 67,6 | 44 | 74,8 | 44 | 75,0 |
| 7 SD | 20 | 43,1 | 24 | 50,7 | 28 | 59,1 | 28 | 62,8 | 32 | 69,5 | 32 | 69,5 |
| | 36 | 57,9 | 40 | 63,7 | 44 | 70,9 | 44 | 78,9 | 48 | 87,2 | 48 | 87,5 |
| 8 SD | 24 | 52,7 | 28 | 60,9 | 28 | 64,9 | 32 | 74,1 | 36 | 81,4 | 36 | 81,4 |
| | 40 | 66,1 | 44 | 72,9 | 44 | 81,0 | 48 | 90,1 | 52 | 99,7 | 52 | 100,1 |
| 9 SD | 28 | 62,3 | 32 | 71,0 | 32 | 75,5 | 36 | 85,4 | 40 | 93,2 | 40 | 93,2 |
| | 44 | 74,4 | 48 | 82,0 | 48 | 91,2 | 52 | 101,4 | 56 | 112,2 | 56 | 112,6 |
| 10 SD | 32 | 71,9 | 32 | 76,2 | 36 | 86,2 | 40 | 96,5 | 48 | 111,0 | 48 | 111,0 |
| | 48 | 82,7 | 48 | 91,1 | 52 | 101,3 | 56 | 112,6 | 64 | 124,7 | 64 | 125,1 |
| 11 SD | 32 | 76,7 | 36 | 86,3 | 40 | 96,8 | 44 | 107,5 | 52 | 122,7 | 52 | 122,7 |
| | 48 | 91,0 | 52 | 100,2 | 56 | 111,5 | 60 | 123,9 | 68 | 137,1 | 68 | 137,6 |
| 12 SD | 36 | 86,3 | 40 | 96,4 | 44 | 107,3 | 52 | 124,4 | 56 | 134,3 | 56 | 134,3 |
| | 52 | 99,3 | 56 | 109,3 | 60 | 121,6 | 68 | 135,2 | 72 | 149,6 | 72 | 150,1 |

| R1,k | CNA4.0x50 | | 2-Row | | SD: Ø10 | | C24 | | Header | | Table 73 | |
|---|-----------|------|-------|-------|---------|-------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 20 | 19,6 | 22 | 22,5 | 22 | 23,9 | 24 | 27,3 | 26 | 29,9 | 26 | 29,9 |
| | 28 | 24,7 | 30 | 27,3 | 30 | 30,4 | 32 | 33,8 | 34 | 37,4 | 34 | 37,5 |
| 4 SD | 24 | 27,6 | 26 | 31,1 | 28 | 35,1 | 30 | 39,3 | 32 | 42,6 | 32 | 42,6 |
| | 32 | 33,1 | 34 | 36,4 | 36 | 40,5 | 38 | 45,1 | 40 | 49,9 | 40 | 50,0 |
| 5 SD | 28 | 36,0 | 30 | 40,2 | 32 | 44,9 | 36 | 51,7 | 38 | 55,8 | 38 | 55,8 |
| | 36 | 41,4 | 38 | 45,6 | 40 | 50,6 | 44 | 56,3 | 46 | 62,4 | 46 | 62,6 |
| 6 SD | 32 | 44,7 | 34 | 49,5 | 38 | 56,6 | 40 | 62,4 | 44 | 69,3 | 44 | 69,3 |
| | 40 | 49,6 | 42 | 54,6 | 46 | 60,7 | 48 | 67,6 | 52 | 74,8 | 52 | 75,1 |
| 7 SD | 36 | 53,5 | 38 | 58,9 | 42 | 66,7 | 46 | 75,0 | 48 | 80,7 | 50 | 82,8 |
| | 44 | 57,9 | 46 | 63,7 | 50 | 70,9 | 54 | 78,8 | 56 | 87,2 | 58 | 87,5 |
| 8 SD | 40 | 62,3 | 44 | 69,9 | 46 | 76,9 | 50 | 85,9 | 50 | 90,1 | 50 | 90,1 |
| | 48 | 66,2 | 52 | 72,9 | 54 | 81,1 | 58 | 90,1 | 58 | 97,9 | 58 | 97,9 |
| 9 SD | 44 | 71,1 | 46 | 77,8 | 50 | 87,0 | 50 | 93,5 | 50 | 97,1 | 50 | 97,1 |
| | 52 | 74,4 | 54 | 82,0 | 58 | 91,2 | 58 | 99,7 | 58 | 105,9 | 58 | 105,9 |
| 10 SD | 48 | 79,9 | 50 | 87,3 | 50 | 94,1 | 50 | 100,6 | 50 | 103,6 | 50 | 103,6 |
| | 56 | 82,7 | 58 | 91,1 | 58 | 99,8 | 58 | 107,9 | 58 | 113,1 | 58 | 113,1 |
| 11 SD | 50 | 87,4 | 50 | 93,8 | 50 | 100,7 | 50 | 107,0 | 50 | 109,0 | 50 | 109,0 |
| | 58 | 91,0 | 58 | 99,0 | 58 | 107,4 | 58 | 115,4 | 58 | 119,8 | 58 | 119,8 |
| 12 SD | 50 | 93,4 | 50 | 100,0 | 50 | 106,7 | 50 | 110,8 | 50 | 110,8 | 50 | 110,8 |
| | 58 | 98,3 | 58 | 106,1 | 58 | 114,5 | 58 | 122,2 | 58 | 125,5 | 58 | 125,5 |
| R1,k | CNA4.0x60 | | 2-Row | | SD: Ø10 | | C24 | | Header | | Table 74 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 16 | 17,7 | 18 | 20,7 | 20 | 24,1 | 22 | 27,7 | 22 | 28,2 | 24 | 30,7 |
| | 24 | 24,8 | 26 | 27,3 | 28 | 30,3 | 30 | 33,7 | 30 | 37,3 | 32 | 37,4 |
| 4 SD | 20 | 26,0 | 22 | 29,7 | 24 | 33,8 | 26 | 38,1 | 28 | 41,4 | 28 | 41,4 |
| | 28 | 33,0 | 30 | 36,4 | 32 | 40,5 | 34 | 45,1 | 36 | 49,9 | 36 | 50,0 |
| 5 SD | 24 | 34,8 | 26 | 39,1 | 28 | 43,9 | 32 | 51,1 | 34 | 55,3 | 34 | 55,3 |
| | 32 | 41,3 | 34 | 45,5 | 36 | 50,6 | 40 | 56,3 | 42 | 62,3 | 42 | 62,6 |
| 6 SD | 28 | 43,8 | 30 | 48,7 | 34 | 56,2 | 36 | 62,1 | 40 | 69,2 | 40 | 69,2 |
| | 36 | 49,6 | 38 | 54,6 | 42 | 60,7 | 44 | 67,6 | 48 | 74,8 | 48 | 75,0 |
| 7 SD | 32 | 52,9 | 34 | 58,4 | 38 | 66,5 | 40 | 73,2 | 44 | 81,0 | 44 | 81,0 |
| | 40 | 57,9 | 42 | 63,8 | 46 | 70,9 | 48 | 78,8 | 52 | 87,3 | 52 | 87,6 |
| 8 SD | 36 | 62,0 | 38 | 68,1 | 42 | 76,9 | 46 | 86,2 | 48 | 92,7 | 48 | 92,7 |
| | 44 | 66,1 | 46 | 72,9 | 50 | 81,0 | 54 | 90,1 | 56 | 99,7 | 56 | 100,0 |
| 9 SD | 38 | 69,4 | 42 | 77,9 | 46 | 87,3 | 50 | 97,4 | 50 | 102,1 | 50 | 102,1 |
| | 46 | 74,4 | 50 | 82,0 | 54 | 91,2 | 58 | 101,4 | 58 | 110,7 | 58 | 110,7 |
| 10 SD | 42 | 78,6 | 46 | 87,5 | 50 | 97,7 | 50 | 104,7 | 50 | 108,6 | 50 | 108,6 |
| | 50 | 82,7 | 54 | 91,1 | 58 | 101,3 | 58 | 111,4 | 58 | 118,6 | 58 | 118,6 |
| 11 SD | 46 | 87,6 | 48 | 95,6 | 50 | 104,5 | 50 | 111,3 | 50 | 114,2 | 50 | 114,2 |
| | 54 | 91,0 | 56 | 100,2 | 58 | 110,6 | 58 | 119,6 | 58 | 125,4 | 58 | 125,4 |
| 12 SD | 48 | 95,1 | 50 | 103,6 | 50 | 110,8 | 50 | 116,6 | 50 | 117,9 | 50 | 117,9 |
| | 56 | 99,3 | 58 | 108,9 | 58 | 118,3 | 58 | 126,9 | 58 | 131,3 | 58 | 131,3 |
| R1,k | CSA5.0x50 | | 2-Row | | SD: Ø10 | | C24 | | Header | | Table 75 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 10 | 16,5 | 10 | 17,4 | 12 | 21,4 | 12 | 22,4 | 14 | 25,8 | 14 | 25,8 |
| | 16 | 24,7 | 18 | 27,3 | 20 | 30,3 | 20 | 33,7 | 22 | 37,3 | 22 | 37,4 |
| 4 SD | 12 | 23,0 | 14 | 27,3 | 16 | 31,9 | 16 | 33,4 | 18 | 37,1 | 18 | 37,1 |
| | 20 | 33,0 | 22 | 36,4 | 24 | 40,5 | 24 | 45,1 | 26 | 49,8 | 26 | 50,0 |
| 5 SD | 16 | 32,7 | 16 | 34,3 | 18 | 39,3 | 20 | 44,5 | 24 | 52,3 | 24 | 52,3 |
| | 24 | 41,3 | 24 | 45,5 | 26 | 50,7 | 28 | 56,3 | 32 | 62,3 | 32 | 62,5 |
| 6 SD | 18 | 39,5 | 20 | 44,6 | 22 | 50,0 | 24 | 55,6 | 28 | 63,8 | 28 | 63,8 |
| | 26 | 49,6 | 28 | 54,6 | 30 | 60,8 | 32 | 67,5 | 36 | 74,8 | 36 | 75,0 |
| 7 SD | 22 | 49,4 | 24 | 54,9 | 26 | 60,7 | 30 | 70,1 | 32 | 75,1 | 32 | 75,1 |
| | 30 | 57,9 | 32 | 63,7 | 34 | 70,9 | 38 | 78,8 | 40 | 87,2 | 40 | 87,5 |
| 8 SD | 24 | 56,1 | 28 | 65,1 | 30 | 71,3 | 34 | 81,1 | 36 | 86,3 | 36 | 86,3 |
| | 32 | 66,2 | 36 | 72,9 | 38 | 81,0 | 42 | 90,1 | 44 | 99,7 | 44 | 100,0 |
| 9 SD | 28 | 66,0 | 30 | 72,0 | 34 | 81,8 | 38 | 92,0 | 42 | 101,4 | 42 | 101,4 |
| | 36 | 74,4 | 38 | 82,0 | 42 | 91,2 | 46 | 101,4 | 50 | 112,2 | 50 | 112,6 |
| 10 SD | 30 | 72,4 | 34 | 82,1 | 38 | 92,3 | 42 | 102,7 | 46 | 112,3 | 46 | 112,3 |
| | 38 | 82,7 | 42 | 91,1 | 46 | 101,3 | 50 | 112,6 | 54 | 124,7 | 54 | 125,1 |
| 11 SD | 34 | 82,3 | 38 | 92,2 | 42 | 102,7 | 46 | 113,4 | 50 | 123,2 | 50 | 123,2 |
| | 42 | 91,0 | 46 | 100,2 | 50 | 111,4 | 54 | 123,9 | 58 | 137,1 | 58 | 137,4 |
| 12 SD | 36 | 88,5 | 40 | 98,7 | 46 | 113,1 | 50 | 123,9 | 50 | 125,0 | 50 | 125,0 |
| | 44 | 99,3 | 48 | 109,3 | 54 | 121,6 | 58 | 135,2 | 58 | 142,1 | 58 | 142,1 |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø10 | | C24 | | Column | | Table 76 | |
|---|-----------|------|-------|-------|---------|-------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 12 | 13,1 | 16 | 17,2 | 16 | 18,5 | 16 | 19,7 | 20 | 23,5 | 20 | 23,5 |
| | 28 | 24,7 | 32 | 27,3 | 32 | 30,3 | 32 | 33,8 | 36 | 37,3 | 36 | 37,4 |
| 4 SD | 16 | 20,7 | 20 | 25,6 | 20 | 27,6 | 24 | 33,3 | 24 | 33,7 | 24 | 33,7 |
| | 32 | 33,1 | 36 | 36,4 | 36 | 40,5 | 40 | 45,0 | 40 | 49,9 | 40 | 50,0 |
| 5 SD | 20 | 29,0 | 24 | 34,7 | 24 | 37,3 | 28 | 43,9 | 32 | 49,0 | 32 | 49,0 |
| | 36 | 41,4 | 40 | 45,5 | 40 | 50,6 | 44 | 56,3 | 48 | 62,3 | 48 | 62,5 |
| 6 SD | 24 | 37,7 | 28 | 44,1 | 32 | 51,2 | 32 | 54,7 | 36 | 60,3 | 36 | 60,3 |
| | 40 | 49,6 | 44 | 54,6 | 48 | 60,7 | 48 | 67,6 | 52 | 74,8 | 52 | 75,1 |
| 7 SD | 28 | 46,6 | 32 | 53,7 | 36 | 61,4 | 40 | 69,6 | 40 | 71,8 | 44 | 76,3 |
| | 44 | 57,9 | 48 | 63,7 | 52 | 70,9 | 56 | 78,8 | 56 | 87,2 | 60 | 87,5 |
| 8 SD | 32 | 55,7 | 36 | 63,3 | 40 | 71,7 | 44 | 80,6 | 44 | 83,3 | 44 | 83,3 |
| | 48 | 66,2 | 52 | 72,9 | 56 | 81,0 | 60 | 90,1 | 60 | 99,2 | 60 | 99,3 |
| 9 SD | 36 | 64,8 | 40 | 72,9 | 44 | 82,0 | 44 | 87,7 | 44 | 89,9 | 44 | 89,9 |
| | 52 | 74,4 | 56 | 82,0 | 60 | 91,2 | 60 | 100,7 | 60 | 107,8 | 60 | 107,8 |
| 10 SD | 40 | 73,8 | 44 | 82,6 | 44 | 88,6 | 44 | 94,1 | 44 | 95,6 | 44 | 95,6 |
| | 56 | 82,7 | 60 | 91,1 | 60 | 100,7 | 60 | 109,4 | 60 | 115,3 | 60 | 115,3 |
| 11 SD | 44 | 82,9 | 44 | 88,6 | 44 | 94,4 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 91,0 | 60 | 99,8 | 60 | 108,8 | 60 | 117,2 | 60 | 122,2 | 60 | 122,2 |
| 12 SD | 44 | 88,5 | 44 | 94,1 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 99,0 | 60 | 107,3 | 60 | 116,1 | 60 | 124,3 | 60 | 128,3 | 60 | 128,3 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø10 | | C24 | | Column | | Table 77 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 11,2 | 12 | 15,1 | 12 | 16,4 | 16 | 21,3 | 16 | 21,3 | 16 | 21,3 |
| | 24 | 24,8 | 28 | 27,3 | 28 | 30,3 | 32 | 33,7 | 32 | 37,3 | 32 | 37,4 |
| 4 SD | 12 | 18,7 | 16 | 23,7 | 16 | 25,6 | 20 | 31,5 | 20 | 31,7 | 20 | 31,7 |
| | 28 | 33,0 | 32 | 36,4 | 32 | 40,5 | 36 | 45,0 | 36 | 49,8 | 36 | 50,0 |
| 5 SD | 16 | 27,1 | 20 | 33,0 | 20 | 35,5 | 24 | 42,3 | 28 | 47,7 | 28 | 47,7 |
| | 32 | 41,3 | 36 | 45,5 | 36 | 50,6 | 40 | 56,3 | 44 | 62,3 | 44 | 62,5 |
| 6 SD | 20 | 36,0 | 24 | 42,6 | 28 | 50,0 | 28 | 53,4 | 32 | 59,2 | 32 | 59,2 |
| | 36 | 49,6 | 40 | 54,6 | 44 | 60,7 | 44 | 67,6 | 48 | 74,8 | 48 | 75,0 |
| 7 SD | 24 | 45,2 | 28 | 52,5 | 32 | 60,5 | 32 | 64,6 | 36 | 70,9 | 36 | 70,9 |
| | 40 | 57,9 | 44 | 63,7 | 48 | 70,9 | 48 | 78,8 | 52 | 87,3 | 52 | 87,6 |
| 8 SD | 28 | 54,5 | 32 | 62,4 | 36 | 71,1 | 40 | 80,2 | 40 | 82,7 | 40 | 82,7 |
| | 44 | 66,1 | 48 | 72,9 | 52 | 81,0 | 56 | 90,1 | 56 | 99,7 | 56 | 100,0 |
| 9 SD | 32 | 63,8 | 36 | 72,3 | 40 | 81,6 | 44 | 91,4 | 44 | 94,3 | 44 | 94,3 |
| | 48 | 74,4 | 52 | 82,0 | 56 | 91,2 | 60 | 101,4 | 60 | 111,9 | 60 | 112,1 |
| 10 SD | 36 | 73,2 | 40 | 82,1 | 44 | 92,1 | 44 | 97,9 | 44 | 100,1 | 44 | 100,1 |
| | 52 | 82,7 | 56 | 91,1 | 60 | 101,3 | 60 | 112,3 | 60 | 120,7 | 60 | 120,7 |
| 11 SD | 40 | 82,5 | 40 | 87,9 | 44 | 98,2 | 44 | 103,0 | 44 | 103,9 | 44 | 103,9 |
| | 56 | 91,0 | 56 | 100,2 | 60 | 111,3 | 60 | 121,2 | 60 | 127,9 | 60 | 127,9 |
| 12 SD | 40 | 87,8 | 44 | 97,7 | 44 | 103,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 |
| | 56 | 99,3 | 60 | 109,3 | 60 | 119,7 | 60 | 128,9 | 60 | 134,2 | 60 | 134,2 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø10 | | C24 | | Column | | Table 78 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 13,7 | 8 | 14,7 | 8 | 15,7 | 8 | 16,6 | 8 | 16,6 | 8 | 16,6 |
| | 16 | 24,7 | 20 | 27,3 | 20 | 30,3 | 20 | 33,7 | 24 | 37,3 | 24 | 37,4 |
| 4 SD | 8 | 17,6 | 8 | 18,8 | 8 | 19,8 | 8 | 20,1 | 12 | 26,9 | 12 | 26,9 |
| | 20 | 33,0 | 24 | 36,4 | 24 | 40,5 | 24 | 45,1 | 28 | 49,8 | 28 | 49,9 |
| 5 SD | 8 | 20,1 | 8 | 20,1 | 12 | 29,5 | 12 | 30,1 | 16 | 37,7 | 16 | 37,7 |
| | 24 | 41,3 | 24 | 45,5 | 28 | 50,6 | 28 | 56,3 | 32 | 62,3 | 32 | 62,5 |
| 6 SD | 12 | 29,9 | 12 | 30,1 | 16 | 39,6 | 16 | 40,2 | 20 | 48,6 | 20 | 48,6 |
| | 28 | 49,6 | 28 | 54,6 | 32 | 60,7 | 32 | 67,5 | 36 | 74,8 | 36 | 75,0 |
| 7 SD | 16 | 39,4 | 16 | 40,2 | 20 | 49,7 | 24 | 59,0 | 24 | 59,3 | 24 | 59,3 |
| | 32 | 57,9 | 32 | 63,7 | 36 | 70,9 | 40 | 78,8 | 40 | 87,2 | 40 | 87,5 |
| 8 SD | 16 | 40,2 | 20 | 50,2 | 24 | 59,9 | 28 | 69,6 | 28 | 69,8 | 28 | 69,8 |
| | 32 | 66,2 | 36 | 72,9 | 40 | 81,0 | 44 | 90,1 | 44 | 99,7 | 44 | 100,0 |
| 9 SD | 20 | 50,2 | 24 | 60,2 | 28 | 70,0 | 32 | 79,9 | 36 | 89,0 | 36 | 89,0 |
| | 36 | 74,4 | 40 | 82,0 | 44 | 91,2 | 48 | 101,4 | 52 | 112,2 | 52 | 112,6 |
| 10 SD | 24 | 60,2 | 28 | 70,2 | 32 | 80,2 | 36 | 90,2 | 40 | 99,6 | 40 | 99,6 |
| | 40 | 82,7 | 44 | 91,1 | 48 | 101,3 | 52 | 112,6 | 56 | 124,7 | 56 | 125,1 |
| 11 SD | 28 | 70,3 | 32 | 80,2 | 36 | 90,3 | 40 | 100,4 | 44 | 110,0 | 44 | 110,0 |
| | 44 | 91,0 | 48 | 100,2 | 52 | 111,4 | 56 | 123,9 | 60 | 137,1 | 60 | 137,6 |
| 12 SD | 28 | 70,3 | 32 | 80,3 | 40 | 100,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 |
| | 44 | 99,3 | 48 | 109,3 | 56 | 121,6 | 60 | 135,2 | 60 | 145,9 | 60 | 145,9 |

| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 82 | |
|---|-----------|------|-------|-------|---------|-------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 12 | 11,5 | 16 | 15,4 | 16 | 16,3 | 16 | 17,2 | 20 | 22,1 | 20 | 22,1 |
| | 28 | 24,7 | 32 | 27,3 | 32 | 30,3 | 32 | 33,8 | 36 | 37,3 | 36 | 37,4 |
| 4 SD | 16 | 18,5 | 20 | 23,3 | 20 | 24,6 | 24 | 30,2 | 24 | 31,7 | 24 | 31,8 |
| | 32 | 33,0 | 36 | 36,4 | 36 | 40,5 | 40 | 45,0 | 40 | 49,8 | 40 | 50,0 |
| 5 SD | 20 | 26,4 | 24 | 31,9 | 28 | 38,1 | 28 | 40,1 | 32 | 47,0 | 32 | 47,1 |
| | 36 | 41,4 | 40 | 45,5 | 44 | 50,6 | 44 | 56,3 | 48 | 62,3 | 48 | 62,5 |
| 6 SD | 24 | 34,8 | 28 | 41,0 | 32 | 47,8 | 32 | 50,4 | 36 | 57,9 | 36 | 58,0 |
| | 40 | 49,6 | 44 | 54,6 | 48 | 60,7 | 48 | 67,5 | 52 | 74,8 | 52 | 75,1 |
| 7 SD | 28 | 43,6 | 32 | 50,3 | 36 | 57,8 | 40 | 65,8 | 44 | 74,2 | 44 | 74,3 |
| | 44 | 57,9 | 48 | 63,7 | 52 | 70,9 | 56 | 78,8 | 60 | 87,2 | 60 | 87,5 |
| 8 SD | 32 | 52,6 | 36 | 59,9 | 40 | 68,0 | 44 | 76,6 | 44 | 80,4 | 44 | 80,6 |
| | 48 | 66,2 | 52 | 72,9 | 56 | 81,0 | 60 | 90,1 | 60 | 98,7 | 60 | 99,0 |
| 9 SD | 36 | 61,7 | 40 | 69,5 | 44 | 78,2 | 44 | 82,5 | 44 | 86,6 | 44 | 86,7 |
| | 52 | 74,4 | 56 | 82,0 | 60 | 91,2 | 60 | 100,1 | 60 | 106,4 | 60 | 106,7 |
| 10 SD | 40 | 70,9 | 44 | 79,2 | 44 | 83,8 | 44 | 88,2 | 44 | 92,3 | 44 | 92,4 |
| | 56 | 82,7 | 60 | 91,1 | 60 | 100,2 | 60 | 107,2 | 60 | 113,1 | 60 | 113,4 |
| 11 SD | 44 | 80,0 | 44 | 84,4 | 44 | 89,2 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 91,0 | 60 | 99,5 | 60 | 107,0 | 60 | 113,6 | 60 | 119,4 | 60 | 119,6 |
| 12 SD | 44 | 85,0 | 44 | 89,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 98,8 | 60 | 106,1 | 60 | 113,2 | 60 | 119,6 | 60 | 125,1 | 60 | 125,3 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 83 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 9,5 | 12 | 13,2 | 12 | 14,0 | 16 | 18,8 | 16 | 19,8 | 16 | 19,8 |
| | 24 | 24,8 | 28 | 27,3 | 28 | 30,3 | 32 | 33,7 | 32 | 37,3 | 32 | 37,4 |
| 4 SD | 16 | 20,1 | 16 | 21,1 | 16 | 22,4 | 20 | 28,2 | 20 | 29,6 | 20 | 29,7 |
| | 32 | 33,0 | 32 | 36,4 | 32 | 40,5 | 36 | 45,0 | 36 | 49,8 | 36 | 50,0 |
| 5 SD | 16 | 24,3 | 20 | 29,9 | 24 | 36,4 | 24 | 38,4 | 28 | 45,6 | 28 | 45,7 |
| | 32 | 41,3 | 36 | 45,5 | 40 | 50,6 | 40 | 56,3 | 44 | 62,3 | 44 | 62,5 |
| 6 SD | 20 | 32,9 | 24 | 39,3 | 28 | 46,5 | 28 | 49,0 | 32 | 56,9 | 32 | 57,0 |
| | 36 | 49,6 | 40 | 54,6 | 44 | 60,7 | 44 | 67,6 | 48 | 74,8 | 48 | 75,0 |
| 7 SD | 24 | 42,0 | 28 | 49,0 | 32 | 56,8 | 32 | 59,9 | 36 | 68,4 | 36 | 68,5 |
| | 40 | 57,9 | 44 | 63,7 | 48 | 70,9 | 48 | 78,8 | 52 | 87,3 | 52 | 87,6 |
| 8 SD | 28 | 51,3 | 32 | 58,9 | 36 | 67,3 | 40 | 76,3 | 44 | 85,6 | 44 | 85,7 |
| | 44 | 66,1 | 48 | 72,9 | 52 | 81,0 | 56 | 90,1 | 60 | 99,7 | 60 | 100,0 |
| 9 SD | 32 | 60,7 | 36 | 68,8 | 40 | 77,8 | 44 | 87,3 | 44 | 91,4 | 44 | 91,6 |
| | 48 | 74,4 | 52 | 82,0 | 56 | 91,2 | 60 | 101,4 | 60 | 111,6 | 60 | 111,9 |
| 10 SD | 36 | 70,2 | 40 | 78,8 | 44 | 88,3 | 44 | 92,9 | 44 | 97,0 | 44 | 97,1 |
| | 52 | 82,7 | 56 | 91,1 | 60 | 101,3 | 60 | 112,0 | 60 | 119,4 | 60 | 119,6 |
| 11 SD | 40 | 79,6 | 44 | 88,7 | 44 | 93,6 | 44 | 98,7 | 44 | 101,9 | 44 | 101,9 |
| | 56 | 91,0 | 60 | 100,2 | 60 | 111,1 | 60 | 119,4 | 60 | 125,8 | 60 | 126,0 |
| 12 SD | 40 | 84,4 | 44 | 93,7 | 44 | 98,9 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 |
| | 56 | 99,3 | 60 | 109,3 | 60 | 118,4 | 60 | 125,7 | 60 | 131,5 | 60 | 131,7 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 84 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| 80 | | 100 | | 120 | | 140 | | 160 | | 180 | | |
| Dowels | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 12,4 | 8 | 13,0 | 8 | 13,7 | 8 | 14,4 | 8 | 15,2 | 8 | 15,2 |
| | 20 | 24,7 | 20 | 27,3 | 20 | 30,3 | 20 | 33,7 | 24 | 37,3 | 24 | 37,4 |
| 4 SD | 8 | 15,7 | 8 | 16,7 | 8 | 18,9 | 8 | 20,1 | 12 | 25,3 | 12 | 25,3 |
| | 20 | 33,0 | 24 | 36,4 | 24 | 40,5 | 24 | 45,1 | 28 | 49,8 | 28 | 49,9 |
| 5 SD | 8 | 20,1 | 8 | 20,1 | 12 | 27,2 | 12 | 30,1 | 16 | 36,1 | 16 | 36,1 |
| | 24 | 41,3 | 24 | 45,5 | 28 | 50,6 | 28 | 56,3 | 32 | 62,3 | 32 | 62,5 |
| 6 SD | 12 | 28,4 | 12 | 30,1 | 16 | 37,0 | 20 | 45,6 | 20 | 47,0 | 20 | 47,0 |
| | 28 | 49,6 | 28 | 54,6 | 32 | 60,7 | 36 | 67,5 | 36 | 74,8 | 36 | 75,0 |
| 7 SD | 16 | 37,4 | 16 | 40,2 | 20 | 47,3 | 24 | 56,5 | 24 | 57,9 | 24 | 57,9 |
| | 32 | 57,9 | 32 | 63,7 | 36 | 70,9 | 40 | 78,8 | 40 | 87,2 | 40 | 87,5 |
| 8 SD | 16 | 40,2 | 20 | 49,7 | 24 | 57,7 | 28 | 67,2 | 28 | 68,6 | 32 | 77,0 |
| | 32 | 66,2 | 36 | 72,9 | 40 | 81,0 | 44 | 90,1 | 44 | 99,7 | 48 | 100,0 |
| 9 SD | 20 | 50,2 | 24 | 59,0 | 28 | 68,1 | 32 | 77,9 | 36 | 87,8 | 36 | 87,9 |
| | 36 | 74,4 | 40 | 82,0 | 44 | 91,2 | 48 | 101,4 | 52 | 112,2 | 52 | 112,6 |
| 10 SD | 24 | 60,2 | 28 | 68,7 | 32 | 78,4 | 36 | 88,4 | 40 | 98,5 | 40 | 98,6 |
| | 40 | 82,7 | 44 | 91,1 | 48 | 101,3 | 52 | 112,6 | 56 | 124,7 | 56 | 125,1 |
| 11 SD | 28 | 69,8 | 32 | 78,8 | 36 | 88,8 | 40 | 98,9 | 44 | 109,1 | 44 | 109,2 |
| | 44 | 91,0 | 48 | 100,2 | 52 | 111,4 | 56 | 123,9 | 60 | 137,1 | 60 | 137,6 |
| 12 SD | 28 | 70,3 | 32 | 80,3 | 40 | 99,0 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 |
| | 44 | 99,3 | 48 | 109,3 | 56 | 121,6 | 60 | 135,2 | 60 | 145,2 | 60 | 145,4 |


| R1,k | CNA4.0x50 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 85 | |
|---|-----------|-------|-------|-------|---------|-------|-------|-------|--------|-------|----------|-------|
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 16 | 16,8 | 16 | 17,4 | 20 | 22,1 | 20 | 23,0 | 24 | 28,6 | 24 | 29,6 |
| | 32 | 32,2 | 32 | 34,5 | 36 | 37,6 | 36 | 41,2 | 40 | 45,0 | 40 | 49,2 |
| 4 SD | 24 | 29,6 | 24 | 30,6 | 24 | 31,8 | 28 | 38,0 | 32 | 44,7 | 32 | 46,3 |
| | 40 | 43,0 | 40 | 46,1 | 40 | 50,1 | 44 | 54,9 | 48 | 60,0 | 48 | 65,5 |
| 5 SD | 28 | 39,2 | 28 | 40,6 | 32 | 47,1 | 36 | 54,3 | 36 | 56,4 | 40 | 64,1 |
| | 44 | 53,8 | 44 | 57,7 | 48 | 62,7 | 52 | 68,6 | 52 | 75,2 | 56 | 81,9 |
| 6 SD | 32 | 49,3 | 36 | 55,8 | 36 | 58,1 | 40 | 65,8 | 44 | 73,9 | 44 | 76,7 |
| | 48 | 64,6 | 52 | 69,2 | 52 | 75,3 | 56 | 82,4 | 60 | 90,1 | 60 | 97,5 |
| 7 SD | 36 | 59,7 | 40 | 66,6 | 44 | 74,4 | 44 | 77,6 | 44 | 80,7 | 44 | 83,8 |
| | 52 | 75,5 | 56 | 80,7 | 60 | 87,8 | 60 | 96,0 | 60 | 101,8 | 60 | 106,2 |
| 8 SD | 40 | 70,1 | 44 | 77,5 | 44 | 80,7 | 44 | 84,1 | 44 | 87,4 | 44 | 90,6 |
| | 56 | 86,2 | 60 | 92,2 | 60 | 99,2 | 60 | 104,7 | 60 | 109,4 | 60 | 113,6 |
| 9 SD | 44 | 80,7 | 44 | 83,4 | 44 | 86,8 | 44 | 91,1 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 96,8 | 60 | 101,7 | 60 | 106,9 | 60 | 111,8 | 60 | 116,3 | 60 | 120,4 |
| 10 SD | 44 | 86,4 | 44 | 89,2 | 44 | 95,4 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 104,4 | 60 | 108,7 | 60 | 113,5 | 60 | 118,3 | 60 | 122,7 | 60 | 126,6 |
| 11 SD | 44 | 91,8 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 111,0 | 60 | 115,0 | 60 | 119,8 | 60 | 124,4 | 60 | 132,5 | 60 | 133,0 |
| 12 SD | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 | 44 | 97,5 |
| | 60 | 117,0 | 60 | 121,0 | 60 | 125,4 | 60 | 133,0 | 60 | 133,0 | 60 | 133,0 |
| R1,k | CNA4.0x60 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 86 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 12 | 14,5 | 16 | 19,1 | 16 | 19,8 | 16 | 20,7 | 20 | 26,5 | 20 | 27,5 |
| | 28 | 32,3 | 32 | 34,5 | 32 | 37,6 | 32 | 41,1 | 36 | 45,0 | 36 | 49,2 |
| 4 SD | 20 | 27,6 | 20 | 28,5 | 20 | 29,7 | 24 | 36,2 | 28 | 43,3 | 28 | 44,8 |
| | 36 | 43,0 | 36 | 46,1 | 36 | 50,1 | 40 | 54,9 | 44 | 60,0 | 44 | 65,5 |
| 5 SD | 24 | 37,5 | 24 | 38,8 | 28 | 45,7 | 28 | 47,6 | 32 | 55,3 | 36 | 63,5 |
| | 40 | 53,8 | 40 | 57,6 | 44 | 62,7 | 44 | 68,7 | 48 | 75,1 | 52 | 81,9 |
| 6 SD | 28 | 47,9 | 28 | 49,6 | 32 | 57,1 | 36 | 65,2 | 40 | 73,7 | 40 | 76,3 |
| | 44 | 64,6 | 44 | 69,2 | 48 | 75,3 | 52 | 82,4 | 56 | 90,1 | 56 | 98,4 |
| 7 SD | 32 | 58,6 | 36 | 66,0 | 36 | 68,6 | 40 | 77,2 | 44 | 86,3 | 44 | 89,3 |
| | 48 | 75,4 | 52 | 80,7 | 52 | 87,9 | 56 | 96,1 | 60 | 105,2 | 60 | 113,0 |
| 8 SD | 36 | 69,4 | 40 | 77,1 | 44 | 85,8 | 44 | 89,3 | 44 | 92,6 | 44 | 95,7 |
| | 52 | 86,2 | 56 | 92,2 | 60 | 100,4 | 60 | 109,8 | 60 | 116,2 | 60 | 121,0 |
| 9 SD | 40 | 80,2 | 44 | 88,3 | 44 | 91,7 | 44 | 95,2 | 44 | 100,5 | 44 | 104,0 |
| | 56 | 97,0 | 60 | 103,8 | 60 | 112,2 | 60 | 118,4 | 60 | 123,4 | 60 | 127,7 |
| 10 SD | 44 | 91,0 | 44 | 93,9 | 44 | 97,2 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 |
| | 60 | 107,8 | 60 | 114,0 | 60 | 119,9 | 60 | 125,1 | 60 | 129,7 | 60 | 133,7 |
| 11 SD | 44 | 96,2 | 44 | 99,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 |
| | 60 | 116,3 | 60 | 121,0 | 60 | 126,2 | 60 | 131,1 | 60 | 135,3 | 60 | 139,2 |
| 12 SD | 44 | 101,8 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 | 44 | 104,0 |
| | 60 | 122,8 | 60 | 127,1 | 60 | 131,9 | 60 | 136,3 | 60 | 141,8 | 60 | 141,8 |
| R1,k | CSA5.0x50 | | 4-Row | | SD: Ø10 | | CLT | | Column | | Table 87 | |
| Width of the timber = length of the dowels (mm) | | | | | | | | | | | | |
| Dowels | 80 | | 100 | | 120 | | 140 | | 160 | | 180 | |
| | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk | nails | Fk |
| 3 SD | 8 | 14,1 | 8 | 14,6 | 8 | 15,2 | 8 | 16,2 | 8 | 17,7 | 12 | 23,5 |
| | 20 | 32,2 | 20 | 34,6 | 24 | 37,6 | 24 | 41,1 | 24 | 45,1 | 28 | 49,1 |
| 4 SD | 8 | 19,0 | 12 | 24,5 | 12 | 25,4 | 12 | 26,3 | 16 | 34,2 | 16 | 35,2 |
| | 24 | 43,0 | 28 | 46,1 | 28 | 50,1 | 28 | 54,9 | 32 | 60,0 | 32 | 65,5 |
| 5 SD | 12 | 27,6 | 16 | 35,1 | 16 | 36,2 | 20 | 44,7 | 20 | 45,8 | 24 | 54,9 |
| | 28 | 53,8 | 32 | 57,6 | 32 | 62,7 | 36 | 68,6 | 36 | 75,1 | 40 | 81,9 |
| 6 SD | 16 | 37,8 | 20 | 46,0 | 20 | 47,1 | 24 | 56,1 | 28 | 65,5 | 28 | 66,7 |
| | 32 | 64,6 | 36 | 69,2 | 36 | 75,3 | 40 | 82,4 | 44 | 90,1 | 44 | 98,3 |
| 7 SD | 20 | 48,1 | 24 | 56,8 | 24 | 58,0 | 28 | 67,3 | 32 | 77,0 | 36 | 86,8 |
| | 36 | 75,4 | 40 | 80,7 | 40 | 87,9 | 44 | 96,1 | 48 | 105,2 | 52 | 114,7 |
| 8 SD | 24 | 58,5 | 28 | 67,6 | 32 | 77,1 | 32 | 78,3 | 36 | 88,2 | 40 | 98,1 |
| | 40 | 86,2 | 44 | 92,2 | 48 | 100,4 | 48 | 109,9 | 52 | 120,3 | 56 | 131,2 |
| 9 SD | 28 | 68,9 | 32 | 78,2 | 36 | 87,9 | 40 | 97,9 | 44 | 108,0 | 44 | 109,1 |
| | 44 | 97,0 | 48 | 103,8 | 52 | 113,0 | 56 | 123,6 | 60 | 135,3 | 60 | 144,2 |
| 10 SD | 32 | 79,3 | 36 | 88,8 | 40 | 98,6 | 44 | 108,7 | 44 | 110,4 | 44 | 110,4 |
| | 48 | 107,8 | 52 | 115,3 | 56 | 125,5 | 60 | 137,4 | 60 | 145,0 | 60 | 147,2 |
| 11 SD | 36 | 90,4 | 40 | 99,2 | 44 | 109,2 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 |
| | 52 | 118,5 | 56 | 126,9 | 60 | 138,1 | 60 | 145,4 | 60 | 147,7 | 60 | 149,1 |
| 12 SD | 40 | 100,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 | 44 | 110,4 |
| | 56 | 129,3 | 60 | 138,4 | 60 | 145,5 | 60 | 148,0 | 60 | 149,5 | 60 | 150,6 |

D2 Concealed joist hanger TU, TUB, TUS, TUBS

| Product Name | Alternative names | | | | Previous name |
|--------------|-------------------|----|---------|---------|---------------|
| | France | UK | Denmark | Germany | |
| TU | | TU | | | JANE TU |
| TUB | | | | | |
| TUS | | | | | JANE TUS |
| TUBS | | | | | |


Figure D2-1: drawings ; Table D2-1: size specification

TU




| Model N° | Width W | Height H | Depth | Skew Angle | |
|----------|---------|----------|-------|------------|-----------|
| | (mm) | | | degree | Direction |
| TU12 | 40 | 96 | 101 | 90° | ~ |
| TU16 | 60 | 134 | 108 | 90° | ~ |
| TU20 | 60 | 174 | 108 | 90° | ~ |
| TU24 | 60 | 214 | 108 | 90° | ~ |
| TU28 | 60 | 254 | 108 | 90° | ~ |

TUB




| Model N° | Width W | Height H | Depth | Skew Angle | |
|----------|---------|----------|-------|------------|-----------|
| | (mm) | | | degree | Direction |
| TUB16 | 60 | 134 | 108 | 90° | ~ |
| TUB20 | 60 | 174 | 108 | 90° | ~ |
| TUB24 | 60 | 214 | 108 | 90° | ~ |
| TUB28 | 60 | 254 | 108 | 90° | ~ |

TUS



| Model N° | Width W | Height H | Depth | Angle | |
|----------|---------|----------|-------|-----------|-----------|
| | (mm) | | | degree | Direction |
| TU/SL12 | 40 | 96 | 101 | 30 to 85° | Left |
| TU/SL16 | 60 | 134 | 108 | 30 to 85° | Left |
| TU/SL20 | 60 | 174 | 108 | 30 to 85° | Left |
| TU/SL24 | 60 | 214 | 108 | 30 to 85° | Left |
| TU/SL28 | 60 | 254 | 108 | 30 to 85° | Left |
| TU/SR12 | 40 | 96 | 101 | 30 to 85° | Right |
| TU/SR16 | 60 | 134 | 108 | 30 to 85° | Right |
| TU/SR20 | 60 | 174 | 108 | 30 to 85° | Right |
| TU/SR24 | 60 | 214 | 108 | 30 to 85° | Right |
| TU/SR28 | 60 | 254 | 108 | 30 to 85° | Right |

TUBS

| Model N° | Width W | Height H | Depth | Angle | |
|----------|---------|----------|-------|-----------|-----------|
| | | | | degree | Direction |
| TUBSL16 | 60 | 134 | 108 | 30 to 85° | Left |
| TUBSL20 | 60 | 174 | 108 | 30 to 85° | Left |
| TUBSL24 | 60 | 214 | 108 | 30 to 85° | Left |
| TUBSL28 | 60 | 254 | 108 | 30 to 85° | Left |
| TUBSR16 | 60 | 134 | 108 | 30 to 85° | Right |
| TUBSR20 | 60 | 174 | 108 | 30 to 85° | Right |
| TUBSR24 | 60 | 214 | 108 | 30 to 85° | Right |
| TUBSR28 | 60 | 254 | 108 | 30 to 85° | Right |

| Hanger Type | Header Fasteners | | Joist Fasteners | |
|-------------|----------------------|-------------------------|-----------------|------------|
| | Ø4.0 Connector nails | Bolt M12 Concrete screw | Dowels Ø8 | Dowels Ø12 |
| TU12 | 6 | ~ | 4 | ~ |
| TU16 | 18 | ~ | ~ | 3 |
| TU20 | 22 | ~ | ~ | 4 |
| TU24 | 26 | ~ | ~ | 5 |
| TU28 | 30 | ~ | ~ | 6 |
| TUB16 | 16 | 2 | ~ | 3 |
| TUB20 | 20 | 2 | ~ | 4 |
| TUB24 | 24 | 2 | ~ | 5 |
| TUB28 | 28 | 2 | ~ | 6 |
| TUS 12 | 6 | ~ | 4 | ~ |
| TUS 16 | 18 | ~ | ~ | 3 |
| TUS 20 | 22 | ~ | ~ | 4 |
| TUS 24 | 26 | ~ | ~ | 5 |
| TUS 28 | 30 | ~ | ~ | 6 |
| TUBS16 | 16 | 2 | ~ | 3 |
| TUBS20 | 20 | 2 | ~ | 4 |
| TUBS24 | 24 | 2 | ~ | 5 |
| TUBS28 | 28 | 2 | ~ | 6 |

Table D2-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|------------------------------|-----------------------|
| 3 | S 250 GD | Z275 |
| 3 | stainless steel as described | |

For installation for fire justification, see clause B6.

Table D2-3: Characteristic capacities $R_{1,k}$ [kN] TU and TUS full nailing

| | | Characteristic capacity $R_{1,k}$ [kN] with CNA 4,0x50 full nailing, connection beam to beam | | | | | | | | | | | |
|---------------|------|---|------|------|------|--------------------|------|------|------|--------------------|------|------|-----|
| skew α | | Width of joist = length of dowel [mm] | | | | | | | | | | | |
| | | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 |
| 90° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TU12 | 8,1 | 9,0 | 10,7 | 10,7 | 8,1 | 9,0 | 10,7 | 10,7 | 8,1 | 9,0 | 10,7 | 10,7 | |
| TU16 | 17,5 | 18,1 | 20,5 | 23,5 | 16,6 | 17,0 | 18,8 | 21,2 | 15,9 | 16,4 | 17,9 | 20,0 | |
| TU20 | 26,7 | 27,6 | 31,1 | 35,6 | 25,3 | 25,8 | 28,5 | 32,2 | 24,4 | 25,1 | 27,4 | 30,5 | |
| TU24 | 36,6 | 37,7 | 42,5 | 48,3 | 34,8 | 35,5 | 39,1 | 43,9 | 33,6 | 34,7 | 37,8 | 42,0 | |
| TU28 | 46,9 | 48,3 | 54,1 | 61,1 | 44,5 | 45,6 | 50,0 | 55,9 | 43,4 | 44,9 | 48,7 | 53,9 | |
| 45° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUS12 | 7,4 | 8,2 | 9,5 | 9,5 | 6,9 | 7,6 | 9,1 | 9,1 | 6,6 | 7,1 | 8,5 | 8,7 | |
| TUS16 | 16,3 | 16,9 | 18,9 | 21,4 | 15,6 | 15,9 | 17,4 | 19,5 | 15,0 | 15,4 | 16,6 | 18,4 | |
| TUS20 | 24,9 | 25,6 | 28,7 | 32,3 | 23,7 | 24,1 | 26,5 | 29,5 | 22,9 | 23,5 | 25,4 | 28,0 | |
| TUS24 | 34,2 | 35,2 | 39,2 | 44,1 | 32,6 | 33,2 | 36,3 | 40,4 | 31,5 | 32,5 | 35,0 | 38,6 | |
| TUS28 | 44,0 | 45,2 | 50,3 | 56,1 | 42,0 | 42,8 | 46,7 | 51,7 | 40,8 | 42,0 | 45,3 | 49,7 | |
| 85° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUS12 | 7,6 | 8,4 | 9,7 | 9,7 | 7,1 | 7,7 | 9,3 | 9,3 | 6,7 | 7,3 | 8,7 | 8,9 | |
| TUS16 | 16,7 | 17,3 | 19,5 | 22,1 | 15,9 | 16,2 | 17,9 | 20,1 | 15,3 | 15,7 | 17,1 | 18,9 | |
| TUS20 | 25,6 | 26,4 | 29,6 | 33,4 | 24,3 | 24,8 | 27,2 | 30,5 | 23,4 | 24,1 | 26,1 | 28,9 | |
| TUS24 | 35,1 | 36,2 | 40,4 | 45,3 | 33,5 | 34,1 | 37,3 | 41,6 | 32,3 | 33,3 | 36,1 | 39,8 | |
| TUS28 | 45,2 | 46,5 | 51,6 | 57,0 | 43,0 | 43,9 | 48,0 | 53,1 | 41,8 | 43,2 | 46,6 | 51,2 | |

Intermediary values can be determined by interpolation.

For a skew between 30° and 45° the values for 45° shall be used.

The capacities for $R_{2,k}$ shall be modified in relation to one steel dowel less, mean e.g. for a TU20 with 4 steel dowel, the uplift capacity shall be reduced to: $(4-1)/4 = 0,75$.

The topmost steel dowel in the cut out hole shall not be considered.

Table D2-4: Characteristic capacities $R_{1,k}$ [kN] TUB and TUBS full nailing

| | | Characteristic capacity $R_{1,k}$ [kN] with CNA 4,0x50 full nailing, connection beam to beam | | | | | | | | | | | |
|---------------|--|---|------|------|------|--------------------|------|------|------|--------------------|------|------|------|
| skew α | | Width of joist = length of dowel [mm] | | | | | | | | | | | |
| | | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 |
| 90° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUB16 | | 16,7 | 17,3 | 19,7 | 22,6 | 15,7 | 16,1 | 17,9 | 20,4 | 15,1 | 15,1 | 17,0 | 19,1 |
| TUB20 | | 25,6 | 26,5 | 30,0 | 34,4 | 24,2 | 24,7 | 27,4 | 31,0 | 23,3 | 23,3 | 26,2 | 29,3 |
| TUB24 | | 35,3 | 36,5 | 41,1 | 46,8 | 33,5 | 34,2 | 37,7 | 42,5 | 32,3 | 32,3 | 36,4 | 40,5 |
| TUB28 | | 45,5 | 46,9 | 52,6 | 59,1 | 43,1 | 44,1 | 48,5 | 54,3 | 41,9 | 41,9 | 47,1 | 52,2 |
| 45° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUBS16 | | 15,4 | 15,9 | 17,9 | 20,3 | 14,6 | 14,9 | 16,5 | 18,5 | 14,1 | 14,4 | 15,6 | 17,4 |
| TUBS20 | | 23,6 | 24,4 | 27,3 | 30,9 | 22,4 | 22,9 | 25,2 | 28,2 | 21,6 | 22,2 | 24,1 | 26,7 |
| TUBS24 | | 32,7 | 33,7 | 37,6 | 42,3 | 31,1 | 31,7 | 34,7 | 38,7 | 30,0 | 30,9 | 33,4 | 36,9 |
| TUBS28 | | 42,3 | 43,5 | 48,4 | 53,8 | 40,4 | 41,1 | 44,9 | 49,8 | 39,0 | 40,2 | 43,4 | 47,7 |
| 85° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUBS16 | | 15,8 | 16,4 | 18,5 | 21,0 | 15,0 | 15,3 | 17,0 | 19,1 | 14,4 | 14,8 | 16,1 | 18,0 |
| TUBS20 | | 24,4 | 25,2 | 28,3 | 31,8 | 23,1 | 23,6 | 26,0 | 29,1 | 22,2 | 22,9 | 24,9 | 27,6 |
| TUBS24 | | 33,7 | 34,8 | 38,8 | 43,1 | 32,1 | 32,7 | 35,9 | 39,9 | 30,9 | 31,9 | 34,6 | 38,1 |
| TUBS28 | | 43,6 | 44,8 | 49,7 | 53,8 | 41,5 | 42,3 | 46,3 | 51,0 | 40,2 | 41,5 | 44,9 | 49,2 |

Intermediary values can be determined by interpolation.

For a skew between 30° and 45° the values for 45° shall be used.

The capacities for $R_{2,k}$ shall be modified as described below the table D2-3

Table D2-5: Characteristic capacities $R_{1,k}$ [kN] TU and TUS

with nail pattern as given below

| | | Characteristic capacity $R_{1,k}$ [kN] with CNA 4,0x50 partial nailing, connection beam to post | | | | | | | | | | | |
|---------------|------|--|------|------|------|--------------------|------|------|------|--------------------|------|------|-----|
| skew α | | Width of joist = length of dowel [mm] | | | | | | | | | | | |
| | | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 |
| 90° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TU12 | 8,1 | 9,0 | 10,7 | 10,7 | 8,1 | 9,0 | 10,7 | 10,7 | 8,1 | 9,0 | 10,7 | 10,7 | |
| TU16 | 16,1 | 16,7 | 19,0 | 21,9 | 15,2 | 15,5 | 17,3 | 19,7 | 14,5 | 14,9 | 16,4 | 18,4 | |
| TU20 | 22,9 | 23,7 | 26,8 | 30,1 | 21,6 | 22,1 | 24,6 | 27,7 | 20,7 | 21,3 | 23,4 | 26,1 | |
| TU24 | 31,9 | 33,0 | 36,9 | 39,9 | 30,2 | 30,9 | 34,1 | 37,9 | 29,0 | 30,0 | 32,7 | 36,2 | |
| TU28 | 38,0 | 38,9 | 39,9 | 39,9 | 36,3 | 36,9 | 39,6 | 39,9 | 35,0 | 36,0 | 38,6 | 39,9 | |
| 45° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUS12 | 7,4 | 8,2 | 9,5 | 9,5 | 6,9 | 7,6 | 9,1 | 9,1 | 6,6 | 7,1 | 8,5 | 8,7 | |
| TUS16 | 15,0 | 15,5 | 17,4 | 19,7 | 14,2 | 14,5 | 16,0 | 18,0 | 13,7 | 14,0 | 15,2 | 16,9 | |
| TUS20 | 21,3 | 22,0 | 24,5 | 26,1 | 20,2 | 20,7 | 22,7 | 25,2 | 19,5 | 20,0 | 21,7 | 23,9 | |
| TUS24 | 29,5 | 30,4 | 33,7 | 34,4 | 28,1 | 28,7 | 31,4 | 34,4 | 27,1 | 27,8 | 30,1 | 33,0 | |
| TUS28 | 35,3 | 36,1 | 36,1 | 36,1 | 33,9 | 34,4 | 36,1 | 36,1 | 32,8 | 33,5 | 35,8 | 36,1 | |
| 85° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUS12 | 7,6 | 8,4 | 9,7 | 9,7 | 7,1 | 7,7 | 9,3 | 9,3 | 6,7 | 7,3 | 8,7 | 8,9 | |
| TUS16 | 15,3 | 15,9 | 17,9 | 20,3 | 14,5 | 14,8 | 16,4 | 18,5 | 13,9 | 14,3 | 15,6 | 17,4 | |
| TUS20 | 21,8 | 22,5 | 25,0 | 26,1 | 20,6 | 21,1 | 23,2 | 25,6 | 19,8 | 20,4 | 22,2 | 24,4 | |
| TUS24 | 30,3 | 31,2 | 34,1 | 34,4 | 28,8 | 29,4 | 32,1 | 34,4 | 27,7 | 28,5 | 30,9 | 33,6 | |
| TUS28 | 35,7 | 36,1 | 36,1 | 36,1 | 34,5 | 35,0 | 36,1 | 36,1 | 33,4 | 34,2 | 36,0 | 36,1 | |

Intermediary values shall be determined by interpolation.

For a skew between 30° and 45° the values for 45° shall be used.

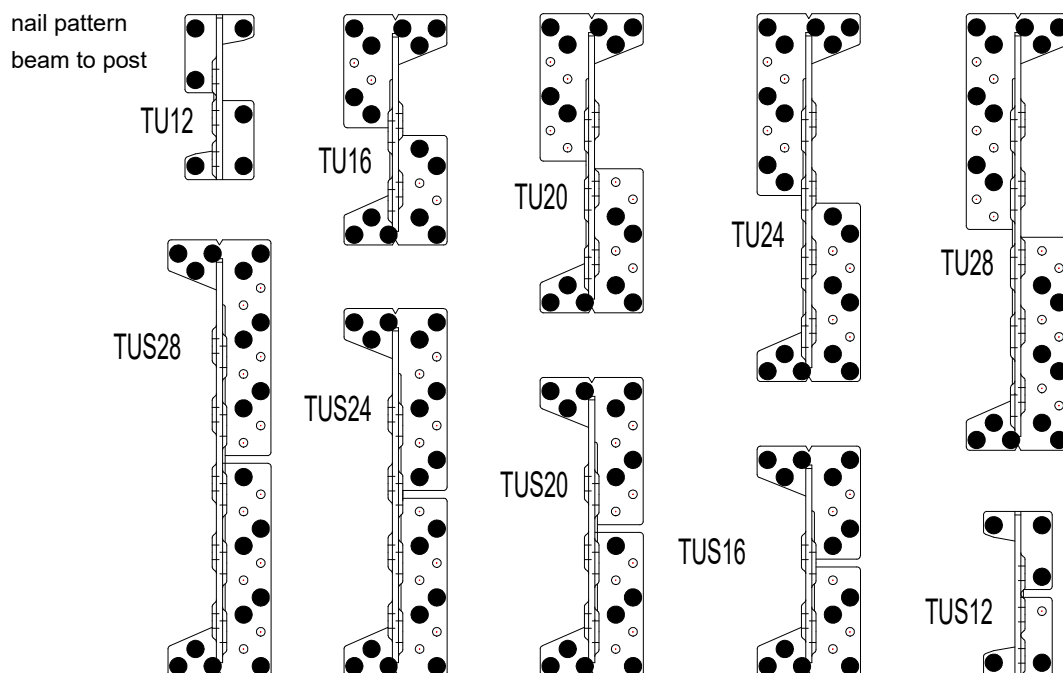
The capacities for $R_{2,k}$ shall be modified as described below the table D2-3

Table D2-6: Characteristic capacities $R_{1,k}$ [kN] TUB and TUBS

with nail pattern as given below

| | | Characteristic capacity $R_{1,k}$ [kN] with CNA 4,0x50 partial nailing, connection beam to post | | | | | | | | | | | |
|---------------|--|--|------|------|------|--------------------|------|------|------|--------------------|------|------|------|
| | | Width of joist = length of dowel [mm] | | | | | | | | | | | |
| skew α | | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 | 60 | 80 | 120 | 160 |
| 90° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUB16 | | 15,2 | 15,8 | 18,1 | 20,8 | 14,3 | 14,7 | 16,4 | 18,8 | 13,7 | 13,7 | 15,5 | 17,5 |
| TUB20 | | 21,5 | 22,3 | 25,1 | 26,6 | 20,3 | 20,8 | 23,2 | 25,8 | 19,5 | 19,5 | 22,0 | 24,5 |
| TUB24 | | 30,4 | 31,4 | 34,8 | 35,5 | 28,7 | 29,4 | 32,4 | 35,4 | 27,5 | 27,5 | 31,0 | 34,1 |
| TUB28 | | 35,3 | 35,5 | 35,5 | 35,5 | 34,1 | 34,6 | 35,5 | 35,5 | 33,0 | 33,0 | 35,4 | 35,5 |
| 45° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUBS16 | | 13,9 | 14,4 | 16,3 | 18,5 | 13,2 | 13,5 | 15,0 | 16,9 | 12,7 | 13,0 | 14,2 | 15,8 |
| TUBS20 | | 19,8 | 20,4 | 22,3 | 22,3 | 18,8 | 19,2 | 21,1 | 22,3 | 18,1 | 18,5 | 20,1 | 22,1 |
| TUBS24 | | 27,7 | 28,6 | 30,3 | 30,3 | 26,4 | 26,9 | 29,5 | 30,3 | 25,4 | 26,1 | 28,2 | 30,3 |
| TUBS28 | | 31,9 | 31,9 | 31,9 | 31,9 | 31,5 | 31,9 | 31,9 | 31,9 | 30,6 | 31,2 | 31,9 | 31,9 |
| 85° | | $\beta = 0^\circ$ | | | | $\beta = 25^\circ$ | | | | $\beta = 45^\circ$ | | | |
| TUBS16 | | 14,3 | 14,9 | 16,8 | 18,9 | 13,6 | 13,9 | 15,5 | 17,4 | 13,0 | 13,3 | 14,6 | 16,3 |
| TUBS20 | | 20,2 | 20,9 | 22,3 | 22,3 | 19,2 | 19,7 | 21,5 | 22,3 | 18,5 | 18,9 | 20,6 | 22,2 |
| TUBS24 | | 28,4 | 29,2 | 30,3 | 30,3 | 27,1 | 27,7 | 29,9 | 30,3 | 26,1 | 26,8 | 28,9 | 30,3 |
| TUBS28 | | 31,9 | 31,9 | 31,9 | 31,9 | 31,8 | 31,9 | 31,9 | 31,9 | 31,1 | 31,6 | 31,9 | 31,9 |

Intermediary values can be determined by interpolation.

For a skew between 30° and 45° the values for 45° shall be used.

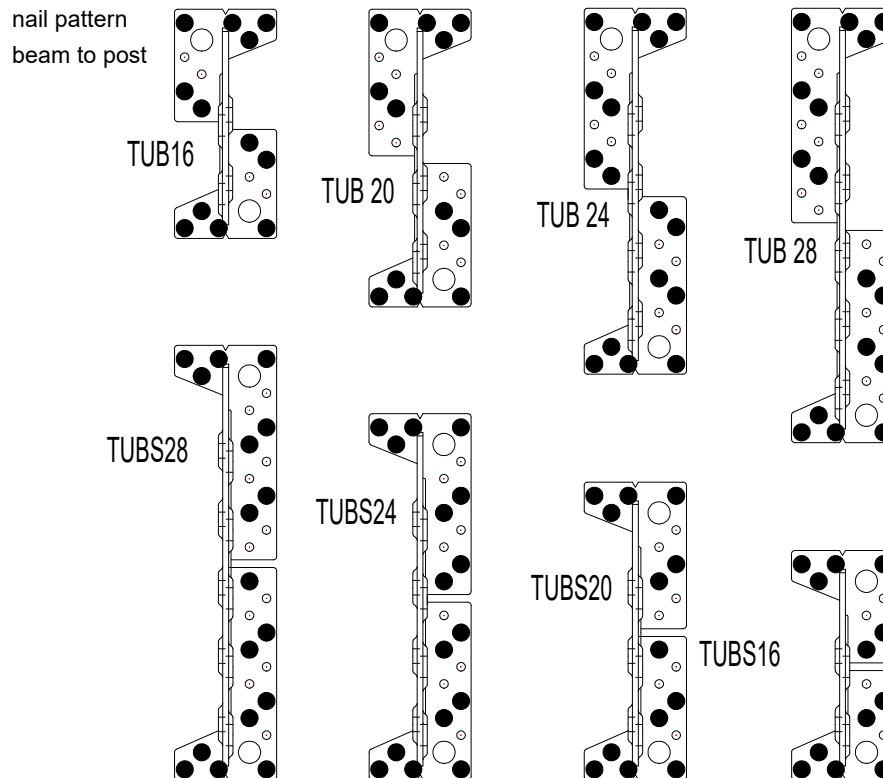
The capacities for $R_{2,k}$ shall be modified as described below the table D2-3



Table D2-7: Characteristic capacities $R_{3,k}$ [kN] TU

| Typ | number of | | joist b / h [mm] | CNA 4,0x40 | | | | | | |
|----------------|-----------|-------|------------------------|------------------------|-----|-----|------|------|------|------|
| | SD | nails | | with screws | | | | | | |
| | | | $R_{3,k}$ [kN] for b = | | | | | | | |
| | | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| TU12 | 4 | 6 | ... / 120 | 1,6 | 3,4 | 4,4 | 4,4 | 4,4 | 4,4 | 4,4 |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 14,9 | 14,9 |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 16,7 | 16,7 | 16,7 |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 18,6 | 18,6 | 18,6 |
| TU12c | 4 | 6 | ... / 120 | 1,6 | 3,4 | 4,4 | 4,4 | 4,4 | 4,4 | 4,4 |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 10,7 |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 10,9 | 10,9 | 10,9 |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 4,0 | 7,3 | 11,9 | 12,5 | 12,5 | 12,5 |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 7,7 | 11,9 | 12,9 | 12,9 | 12,9 |
| without screws | | | | | | | | | | |
| TU12 | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 |
| TU12c | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 |
| CNA 4,0x50 | | | | | | | | | | |
| Typ | number of | | joist b / h [mm] | with screws | | | | | | |
| | SD | nails | | $R_{3,k}$ [kN] for b = | | | | | | |
| | | | | | | | | | | |
| | | | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| TU12 | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,3 | 5,3 | 5,3 | 5,3 | 5,3 |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 15,1 | 17,8 |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 16,7 | 20,2 | 20,2 |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 19,3 | 22,5 | 22,5 |
| TU12c | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,3 | 5,3 | 5,3 | 5,3 | 5,3 |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 13,2 | 13,2 |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 15,1 | 15,1 | 15,1 |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 15,6 | 15,6 | 15,6 |
| without screws | | | | | | | | | | |
| TU12 | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 |
| TU12c | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 |

screw 6,0x L
with L = b-20mm

(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel

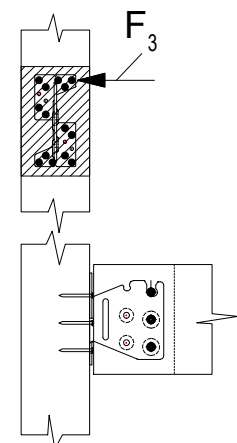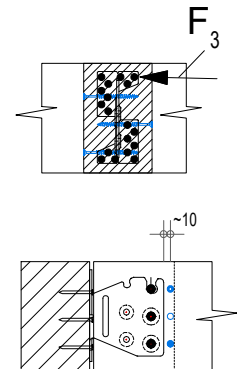





c = index for column nailing

Table D2-8: Characteristic capacities $R_{3,k}$ [kN] TU

| | | | | CSA 5,0x40 | | | | | | | with screws | |
|-------|-----------|-------|---------------------|------------------------|-----|-----|------|------|------|------|----------------|--|
| Typ | number of | | joist b / h [mm] | $R_{3,k}$ [kN] for b = | | | | | | | | |
| | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | | |
| TU12 | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,6 | 5,6 | 5,6 | 5,6 | 5,6 | 5,6 | |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 | 11,9 | |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 15,1 | 17,8 | 17,8 | |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 16,7 | 20,2 | 21,1 | 21,1 | |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 19,3 | 23,4 | 23,4 | 23,4 | |
| TU12c | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,6 | 5,6 | 5,6 | 5,6 | 5,6 | 5,6 | |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 | 11,9 | |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 13,7 | 13,7 | 13,7 | |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 15,8 | 15,8 | 15,8 | 15,8 | |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 16,3 | 16,3 | 16,3 | 16,3 | |
| | | | | | | | | | | | without screws | |
| TU12 | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |
| TU12c | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |
| | | | | | | | | | | | without screws | |
| TU12 | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |
| TU12c | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |

| | | | | CSA 5,0x50 | | | | | | | with screws | |
|-------|-----------|-------|---------------------|------------------------|-----|-----|------|------|------|------|----------------|--|
| Typ | number of | | joist b / h [mm] | $R_{3,k}$ [kN] for b = | | | | | | | | |
| | SD | nails | | 60 | 80 | 100 | 120 | 140 | 160 | 180 | | |
| TU12 | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,9 | 6,1 | 6,1 | 6,1 | 6,1 | 6,1 | |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 | 11,9 | |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 15,1 | 17,8 | 17,8 | |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 16,7 | 20,2 | 22,9 | 22,9 | |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 19,3 | 23,5 | 25,5 | 25,5 | |
| TU12c | 4 | 6 | ... / 120 | 1,6 | 3,4 | 5,9 | 6,1 | 6,1 | 6,1 | 6,1 | 6,1 | |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 3,1 | 4,8 | 6,6 | 8,3 | 10,1 | 11,9 | 11,9 | |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 3,8 | 7,0 | 9,9 | 12,5 | 14,9 | 14,9 | 14,9 | |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 4,0 | 7,3 | 12,0 | 16,7 | 17,2 | 17,2 | 17,2 | |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 7,7 | 12,4 | 17,7 | 17,7 | 17,7 | 17,7 | |
| | | | | | | | | | | | without screws | |
| TU12 | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16 | 3 | 18 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20 | 4 | 22 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24 | 5 | 26 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28 | 6 | 30 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |
| TU12c | 4 | 6 | ... / 120 | 1,2 | 1,7 | 2,2 | 2,8 | 3,3 | 3,8 | 4,3 | 4,3 | |
| TU16c | 3 | 14 | ... / 160 | 1,6 | 2,2 | 2,9 | 3,6 | 4,4 | 5,1 | 5,7 | 5,7 | |
| TU20c | 4 | 14 | ... / 200 | 2,2 | 2,9 | 3,8 | 4,6 | 5,6 | 6,4 | 7,3 | 7,3 | |
| TU24c | 5 | 18 | ... / 240 | 2,7 | 3,6 | 4,7 | 5,8 | 6,7 | 7,9 | 8,8 | 8,8 | |
| TU28c | 6 | 18 | ... / 280 | 3,2 | 4,4 | 5,5 | 6,7 | 7,9 | 9,2 | 10,3 | 10,3 | |

c = index for column nailing



screw 6,0x L
with L = b-20mm


(for timber with b=60mm
use screws 5,0x50)

number of screws =
number of steel dowel

Table D2-9: Characteristic capacities R_{4k} [kN] TU

| $R_{4,k}$ [kN] to beam / to column | | | | | | | | |
|------------------------------------|-----------|-------|----------------------------------|-----------|-----------|-----------|-----------|-----------|
| Typ | number of | | min. size of joist b / h [mm] | CNA4,0x40 | CNA4,0x50 | CNA4,0x60 | CSA5,0x40 | CSA5,0x50 |
| | SD | nails | | | | | | |
| TU12 | 4 | 6 | .../120 | 4,1 | 4,9 | 5,7 | 8,4 | 8,4 |
| TU16 | 3 | 18 | .../160 | 6,1 | 7,5 | 8,9 | 11,4 | 11,4 |
| TU20 | 4 | 22 | .../200 | 8,2 | 9,8 | 11,5 | 16,2 | 16,2 |
| TU24 | 5 | 26 | .../240 | 10,2 | 12,1 | 14,1 | 21,0 | 21,0 |
| TU28 | 6 | 30 | .../280 | 11,8 | 14,4 | 16,7 | 25,4 | 25,8 |
| TU12c | 4 | 6 | .../120 | 4,1 | 4,9 | 5,7 | 8,4 | 8,4 |
| TU16c | 3 | 14 | .../160 | 5,3 | 6,4 | 7,5 | 11,4 | 11,4 |
| TU20c | 4 | 14 | .../200 | 5,9 | 7,6 | 8,7 | 13,1 | 16,2 |
| TU24c | 5 | 18 | .../240 | 7,4 | 9,8 | 11,3 | 16,8 | 21,0 |
| TU28c | 6 | 18 | .../280 | 7,4 | 9,8 | 12,3 | 17,9 | 23,0 |

c = index for column nailing

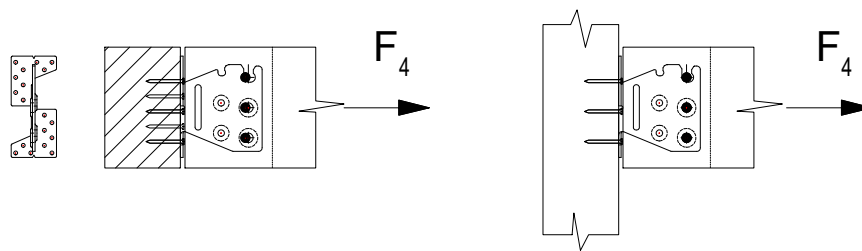

D3 Concealed joist hanger ETNM

| | | | | |
|--------------|-------------------|------|---------|---------|
| | alternative names | | | |
| Product Name | France | UK | Danmark | Germany |
| ETNM | | ETNM | | |

Figure D3-1: drawings

ETNM




Table D3-1: size specification

| Model N° | Width W | Height H | Depth | Angle | |
|---------------|---------|----------|-------|--------|-----------|
| | (mm) | | | degree | Direction |
| ETNM135/130/2 | 70 | 135 | 130 | 90° | ~ |
| ETNM155/130/2 | 70 | 155 | 130 | 90° | ~ |
| ETNM185/130/2 | 70 | 185 | 130 | 90° | ~ |
| ETNM230/130/2 | 80 | 230 | 130 | 90° | ~ |

Table D3-2 number of fastener


| Hanger Type | Header Fasteners | | Joist Fasteners | |
|---------------|----------------------|----------------------------|-----------------|---------------|
| | Ø4.0 connector nails | Bolt M12 Concrete screw | Dowels Ø8 | Dowels Ø12 |
| ETNM135/130/2 | 14 | 5 | ~ | 2 |
| ETNM155/130/2 | 15 | 6 | ~ | 2 |
| ETNM185/130/2 | 18 | 6 | ~ | 2 |
| ETNM230/130/2 | 22 | 6 | ~ | 3 |

Table D3-3: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|------------------------------|-----------------------|
| 3 | S 250 GD | Z275 |
| 3 | stainless steel as described | |

**Table D3-4: Characteristic capacities ETNM $R_{1,k}$
Beam to beam**









| Joist width [mm] | Characteristic capacity $R_{1,k}$ [kN] with CNA4,0x50 connection beam to beam | | | |
|------------------|---|---------|---------|---------|
| | ETNM135 | ETNM155 | ETNM185 | ETNM230 |
| 60 | 11,7 | 14,4 | 17,1 | 26,2 |
| 80 | 12,2 | 15,0 | 17,8 | 27,0 |
| 100 | 13,1 | 16,0 | 18,9 | 28,6 |
| 120 | 14,2 | 17,2 | 20,4 | 30,6 |
| 140 | 15,4 | 18,6 | 22,0 | 32,8 |
| 160 | 16,6 | 20,0 | 23,8 | 35,1 |



**Table D3-5: Characteristic capacities ETNM $R_{1,k}$
Beam to post**

| Joist width [mm] | Characteristic capacity $R_{1,k}$ [kN] with CNA4,0x50 connection beam to post | | | |
|------------------|---|---------|---------|---------|
| | ETNM135 | ETNM155 | ETNM185 | ETNM230 |
| 60 | 11,0 | 13,1 | 15,5 | 25,1 |
| 80 | 11,6 | 13,7 | 16,2 | 25,9 |
| 100 | 12,5 | 14,7 | 17,3 | 27,4 |
| 120 | 13,6 | 15,8 | 18,7 | 29,3 |
| 140 | 14,7 | 17,1 | 20,3 | 31,3 |
| 160 | 15,9 | 18,4 | 21,9 | 33,4 |

Figure D3-2: Nail pattern ETNM
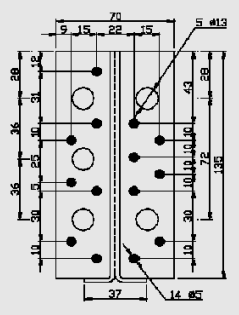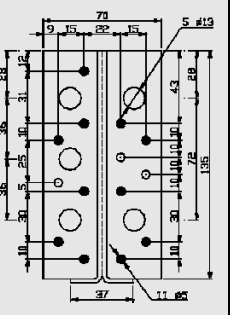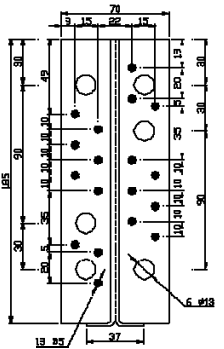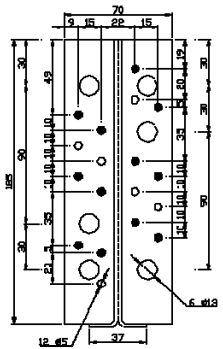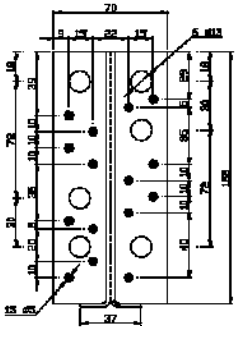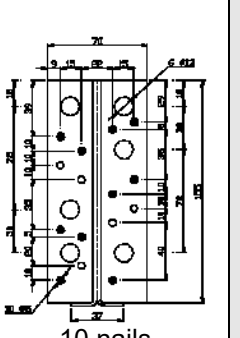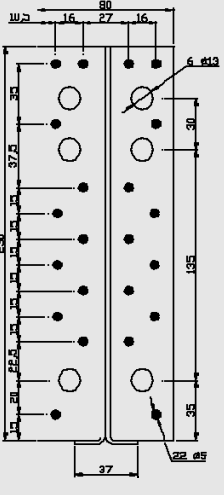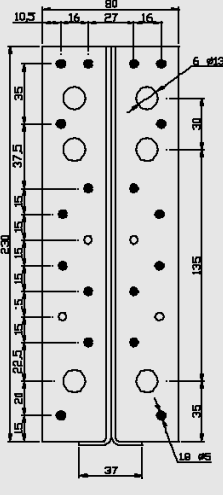
| TYPE | BEAM to BEAM | BEAM to POST | TYPE | BEAM to BEAM | BEAM to POST |
|------|--|--|------|---|--|
| 135 |  |  | 185 |  |  |
| | 14 nails 2 dowels Ø12 | 11 nails 2 dowels Ø12 | | 18 nails 5 dowels Ø2 | 12 nails 5 dowels Ø12 |
| 155 |  |  | 230 |  |  |
| | 15 nails 2 dowels Ø12 | 10 nails 2 dowels Ø12 | | 22 nails 3 dowels Ø12 | 18 nails 3 dowels Ø12 |

D4 Concealed joist hanger BTCx

| Product Name | alternative names | | | |
|--------------|-------------------|-----------|-----------|-----------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| BTCx | | | | BTCx |

Figure D4-1: Dimension drawing of concealed joist hangers

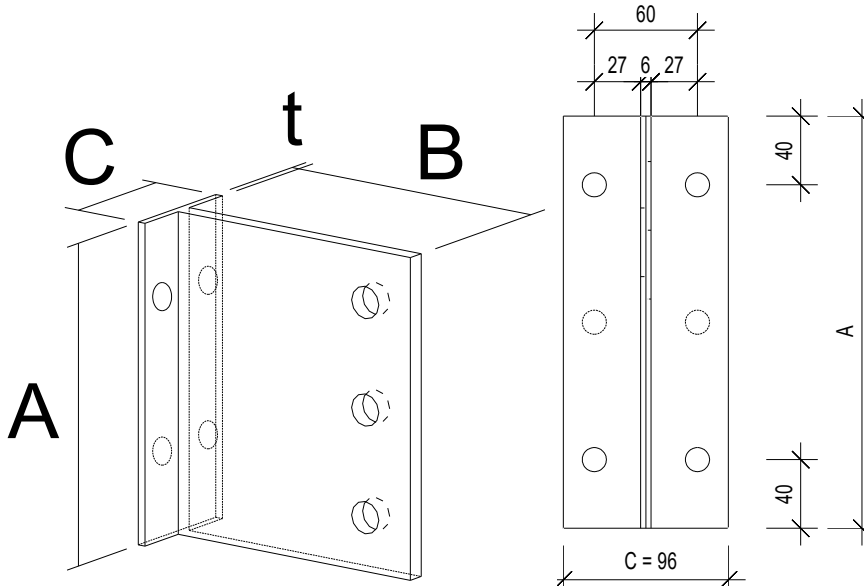


Figure D4-2: Size specification

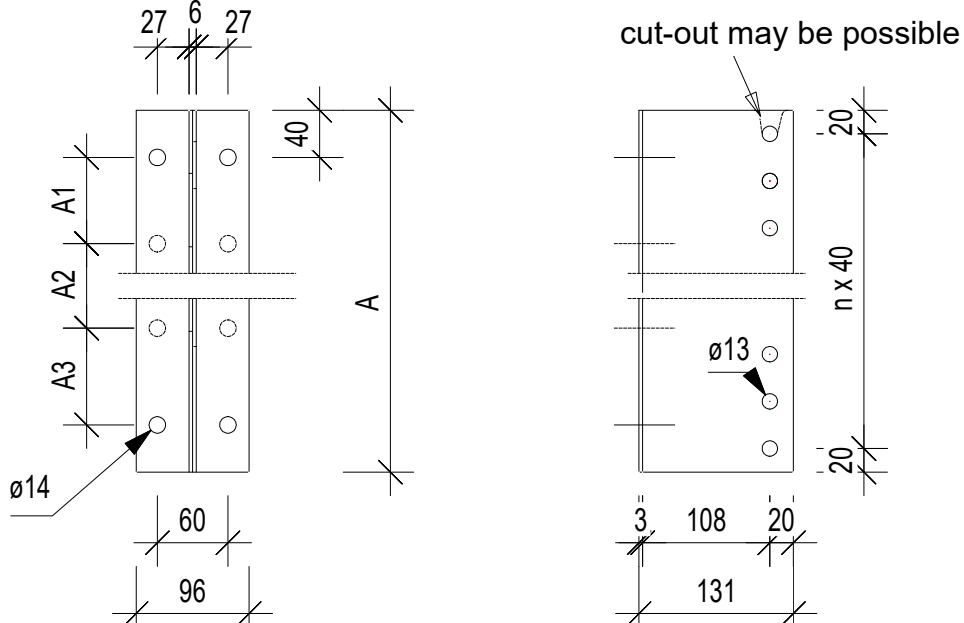


Table D4-1: Size specification

| Type | all size in [mm] | | | | | | | no of holes | |
|--------|------------------|-----|-----|-----|-----|----|---|--------------|-------------|
| | A | A1 | A2 | A3 | B | C | t | Ø14mm anchor | Ø13mm dowel |
| BTC120 | 120 | | | | 128 | 96 | 3 | 2 | 3 |
| BTC160 | 160 | 80 | | | 128 | 96 | 3 | 4 | 4 |
| BTC200 | 200 | 120 | | | 128 | 96 | 3 | 4 | 5 |
| BTC240 | 240 | 160 | | | 128 | 96 | 3 | 4 | 6 |
| BTC280 | 280 | 100 | 100 | | 128 | 96 | 3 | 6 | 7 |
| BTC320 | 320 | 120 | 120 | | 128 | 96 | 3 | 6 | 8 |
| BTC360 | 360 | 140 | 140 | | 128 | 96 | 3 | 6 | 9 |
| BTC400 | 400 | 120 | 120 | 80 | 128 | 96 | 3 | 8 | 10 |
| BTC440 | 440 | 120 | 120 | 120 | 128 | 96 | 3 | 8 | 11 |
| BTC480 | 480 | 120 | 120 | 160 | 128 | 96 | 3 | 8 | 12 |
| BTC520 | 520 | 160 | 160 | 120 | 128 | 96 | 3 | 8 | 13 |
| BTC560 | 560 | 160 | 160 | 160 | 128 | 96 | 3 | 8 | 14 |
| BTC600 | 600 | 160 | 160 | 200 | 128 | 96 | 3 | 8 | 15 |

Table D4-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|-----------------------------|-----------------------|
| 3 | S 250 GD | Z275 |
| 3 | stainless steel as desriped | |

For installation for fire justification, see clause B6

Table D4-3: Characteristic capacities $R_{1,k}$ and $R_{2,k}$

The tables are based on a slope of 0°

For other configurations the following modification are necessary:

for different slope β

| β | 0° | 15° | 30° | 45° |
|---------|-----------|------------|------------|------------|
| factor | 1 | 0,95 | 0,9 | 0,85 |

only for less as 7 SD, for 7 or more SD no reducing is necessary

Characteristic capacity $R_{1,k}$ and $R_{2,k}$ [kN]

| b | 3 SD | 4 SD | 5 SD | 6 SD | 7 SD | 8 SD | 9 SD | 10 SD | 11 SD | 12 SD |
|-----|------|------|------|------|------|------|-------|-------|-------|-------|
| 80 | 11,5 | 18,5 | 26,7 | 35,8 | 45,6 | 56,0 | 66,8 | 77,9 | 89,1 | 100,5 |
| 100 | 12,7 | 20,4 | 29,4 | 39,4 | 50,1 | 61,4 | 73,1 | 85,1 | 97,2 | 109,5 |
| 120 | 14,2 | 22,8 | 32,7 | 43,8 | 55,6 | 68,1 | 80,9 | 94,0 | 107,3 | 120,7 |
| 140 | 15,8 | 25,3 | 36,4 | 48,6 | 61,7 | 75,5 | 89,6 | 104,1 | 118,7 | 133,4 |
| 160 | 17,2 | 27,8 | 40,3 | 53,8 | 68,3 | 83,4 | 99,0 | 114,8 | 130,9 | 147,0 |
| 180 | | | | 54,3 | 69,4 | 85,5 | 102,2 | 119,5 | 133,3 | 147,0 |

b = min width [mm] of timber and length of the dowel

The topmost steel dowel in the cut out hole shall not be considered for $R_{2,k}$

For using steel dowels with a length of 60mm the values for steel dowel with 80mm may be multiplied by 0,95.

The necessary capacity of the bolts should be calculated as:

$$R_{bolt,lat,d} \geq \frac{F_{1,d}}{n}$$

For the upper bolts additional:

$$R_{bolt,ax,d} \geq \frac{F_{1,d} \times 14,4}{d}$$

With:

$R_{bolt,lat,d}$ design capacity of one anchor bolt for shear load, but max. 14,0 kN

$R_{bolt,ax,d}$ design capacity of one anchor bolt for tension load

d height of the BTC -10mm [mm]

n number of anchor bolts

Table D4-4: Characteristic capacities $R_{3,k}$

It is assumed that the force F_3 is action at the top of the BTC. For a force F_3 with a lower distance to the middle of the BTC, the same capacities may be to use

| Type | number of | | Joist min b / h [mm] | $R_{3,k}$ [kN] for b = .. [mm] without screws | | | | | | |
|--------|-----------|-------|-------------------------|---|------|------|------|------|------|------|
| | SD | bolts | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| BTC120 | 3 | 2 | ... / 160 | 2,6 | 2,9 | 3,5 | 4,0 | 4,5 | 5,2 | 5,3 |
| BTC160 | 4 | 4 | ... / 200 | 3,2 | 3,9 | 4,4 | 5,0 | 5,9 | 6,5 | 7,0 |
| BTC200 | 5 | 4 | ... / 240 | 4,0 | 4,9 | 5,5 | 6,3 | 7,2 | 7,8 | 8,8 |
| BTC240 | 6 | 4 | ... / 280 | 4,8 | 5,7 | 6,6 | 7,5 | 8,4 | 9,1 | 10,4 |
| BTC280 | 7 | 6 | ... / 320 | 5,6 | 6,5 | 7,6 | 8,7 | 9,6 | 10,4 | 11,9 |
| BTC320 | 8 | 6 | ... / 360 | 6,4 | 7,3 | 8,6 | 9,7 | 10,8 | 11,8 | 13,4 |
| BTC360 | 9 | 6 | ... / 400 | 7,2 | 8,1 | 9,5 | 10,8 | 12,0 | 13,2 | 14,9 |
| BTC400 | 10 | 8 | ... / 440 | 8,0 | 8,9 | 10,5 | 11,9 | 13,2 | 14,7 | 16,4 |
| BTC440 | 11 | 8 | ... / 480 | 8,8 | 9,7 | 11,4 | 13,0 | 14,4 | 16,1 | 17,8 |
| BTC480 | 12 | 8 | ... / 520 | 9,6 | 10,6 | 12,4 | 14,1 | 15,6 | 17,6 | 19,3 |
| BTC520 | 12 | 8 | ... / 560 | 10,4 | 11,4 | 13,3 | 15,1 | 16,8 | 19,1 | 20,8 |
| BTC560 | 12 | 8 | ... / 600 | 11,2 | 12,3 | 14,3 | 16,2 | 18,0 | 20,5 | 22,3 |
| BTC600 | 12 | 8 | ... / 640 | 12,0 | 13,2 | 15,2 | 17,3 | 19,2 | 22,0 | 23,8 |


SD = steel dowel

Table D4-5: Characteristic capacities $R_{3,k}$ with screws for reinforcement

It is assumed that the force F_3 is in action at the top of the BTC. For a force F_3 with a lower distance to the middle of the BTC, the same capacities may be to use

| Type | number of | | Joist min b / h [mm] | $R_{3,k}$ [kN] for b = .. [mm] with screws * | | | | | | |
|--------|-----------|-------|-------------------------|--|------|------|------|------|------|------|
| | SD | bolts | | 60 | 80 | 100 | 120 | 140 | 160 | 180 |
| BTC120 | 3 | 2 | ... / 160 | 2,6 | 2,9 | 4,4 | 5,3 | 5,3 | 5,3 | 5,3 |
| BTC160 | 4 | 4 | ... / 200 | 3,2 | 4,3 | 6,6 | 7,0 | 7,0 | 7,0 | 7,0 |
| BTC200 | 5 | 4 | ... / 240 | 4,0 | 5,5 | 8,6 | 8,8 | 8,8 | 8,8 | 8,8 |
| BTC240 | 6 | 4 | ... / 280 | 4,8 | 6,3 | 8,8 | 10,6 | 10,6 | 10,6 | 10,6 |
| BTC280 | 7 | 6 | ... / 320 | 5,6 | 6,8 | 9,6 | 12,3 | 12,3 | 12,3 | 12,3 |
| BTC320 | 8 | 6 | ... / 360 | 6,4 | 7,5 | 10,1 | 14,1 | 14,1 | 14,1 | 14,1 |
| BTC360 | 9 | 6 | ... / 400 | 7,2 | 8,1 | 11,0 | 15,2 | 15,8 | 15,8 | 15,8 |
| BTC400 | 10 | 8 | ... / 440 | 8,0 | 8,9 | 11,0 | 15,2 | 17,6 | 17,6 | 17,6 |
| BTC440 | 11 | 8 | ... / 480 | 8,8 | 9,7 | 12,1 | 16,1 | 19,3 | 19,3 | 19,3 |
| BTC480 | 12 | 8 | ... / 520 | 9,6 | 10,6 | 12,8 | 17,1 | 21,1 | 21,1 | 21,1 |
| BTC520 | 12 | 8 | ... / 560 | 10,4 | 11,4 | 13,3 | 17,1 | 22,9 | 22,9 | 22,9 |
| BTC560 | 12 | 8 | ... / 600 | 11,2 | 12,3 | 14,3 | 17,6 | 24,6 | 24,6 | 24,6 |
| BTC600 | 12 | 8 | ... / 640 | 12,0 | 13,2 | 15,2 | 18,8 | 24,6 | 26,4 | 26,4 |

* See clause C.2

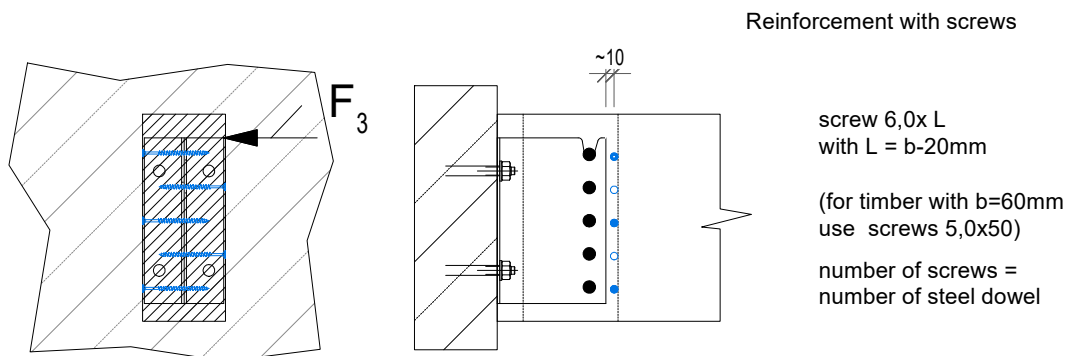

The connection of the bolts to the concrete must be checked:

The bolt group must be able to resist the min :

$$F_{3,d} \text{ [kN]}$$

$$M_{Y,F3,d} = F_{3,d} \times 40 \text{ mm [kNmm]}$$

$$M_{X,F3,d} = F_{3,d} \times (A/2) \text{ [kNmm]} ,$$

with A = the height of the BTC [mm]


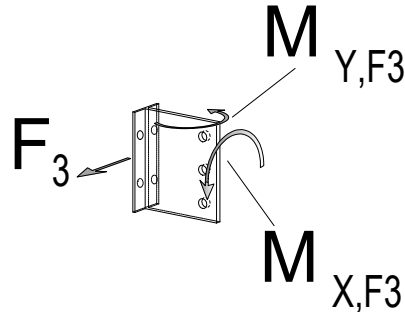


Table D4-6: Characteristic capacities $F_{4,k}$

| no of bolts | $R_{3,k}$ [kN] | min no of dowel |
|-------------|-----------------|-----------------|
| 2 | 6,7/ k_{mod} | 3 |
| 4 | 13,4/ k_{mod} | 3 |
| 6 | 20,1/ k_{mod} | 5 |
| 8 | 26,8/ k_{mod} | 6 |

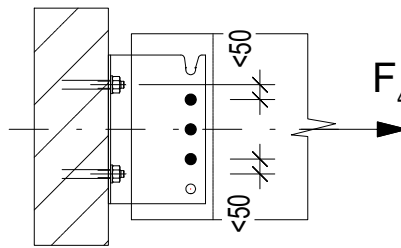

The force is acting in the middle of the joist.

The dowel and anchor bolts should be placed symmetrical to the centreline of the joist, and with a max distance of the anchor to the dowel of 50mm.

It should be checked, that the capacity of bolt is: $R_{bolt,ax,d} \geq \frac{F_{4,d} \times 1,44}{n_b}$

Where:

$R_{bolt,ax,d}$ the axial design capacity of each anchor bolts / bolts

n_b the number of anchor bolts / bolts

$F_{4,d}$ the design load in direction of the joist

For combination it should be checked:

$$\left(\frac{F_{1or2,d}}{R_{1or2,d}} \right)^2 + \left(\frac{F_{3,d}}{R_{3,d}} \right)^2 + \left(\frac{F_{4,d}}{R_{4,d}} \right)^2 \leq 1$$


$$\left(\frac{F_{1,d}}{R_{1,d}} \right)^2 + \left(\frac{F_{2,d}}{R_{2,d}} \right)^2 + \left(\frac{F_{3,d}}{R_{3,d}} \right)^2 + \left(\frac{F_{4,d}}{R_{4,d}} \right)^2 \leq 1$$

F_1 and F_2 have to be considered independently

The anchor bolts should be checked separately for the combination of loads.

D5 ICS

| Product Name | Alternative names | | | |
|--------------|-------------------|--------------|--------------|--------------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| ICS | | | | |

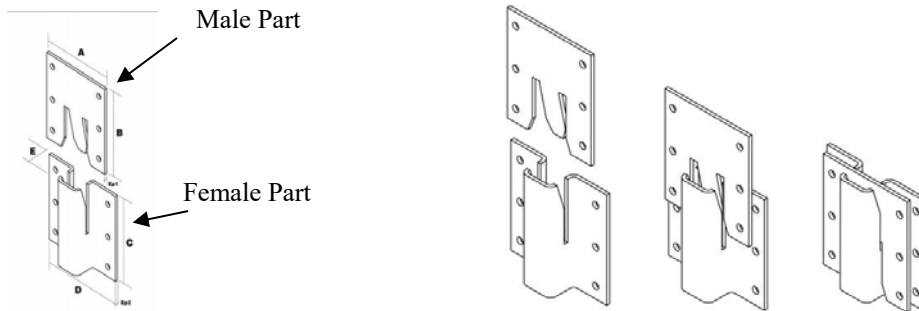Figure D5-1: Drawings**Table D5-2: Dimensions and number of fastener**

| ICS | A | B | C | D | E | Thickness | Holes |
|-------------|----|----|----|----|------|-----------|-------|
| Male Part | 70 | 80 | -- | -- | -- | 2.5 | 6 Ø5 |
| Female Part | -- | -- | 80 | 80 | 23.5 | 2.5 | 6 Ø5 |

Table D5-3: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|------------------------------|-----------------------|
| 3 | S 250 GD | Z275 |
| 3 | stainless steel as described | |

For installation for fire justification, see clause B6

Table D5-4: Characteristic capacities :

Characteristic capacities for single ICS and for timber grade C24:

| | Fasteners | | Characteristic Capacities C24 [kN] | |
|-----|-------------------------|-------------------------|------------------------------------|---------------------|
| | | | Load direction | |
| | Male part | Female part | Shear | Withdrawal |
| ICS | 6 screws CSA Ø5.0x35 | 6 screws CSA Ø5.0x35 | 7.21 ⁽¹⁾ | 4.17 ⁽³⁾ |
| | | | 3.84 ⁽²⁾ | |

(1) Shear capacity is given for a displacement of 15 mm.

(2) Shear capacity is given for a displacement of 5 mm

(3) Withdrawal capacity is given for a displacement of 3 mm.

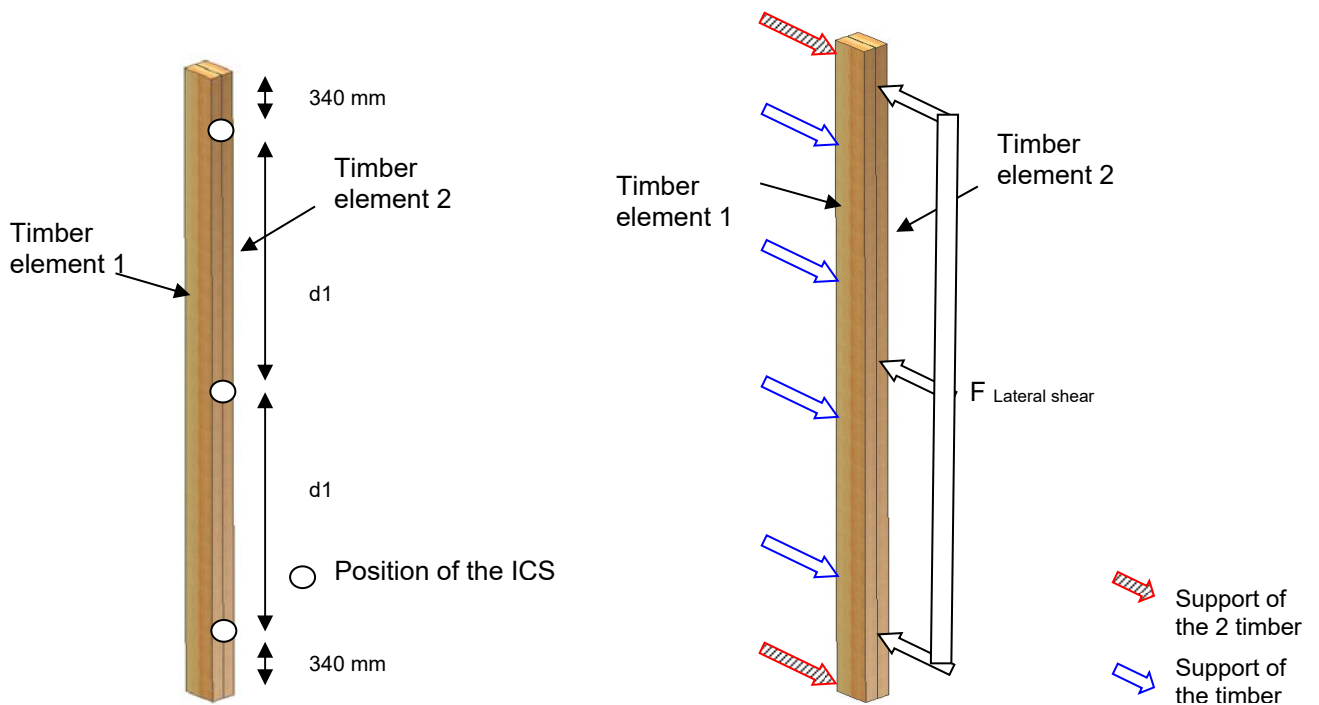
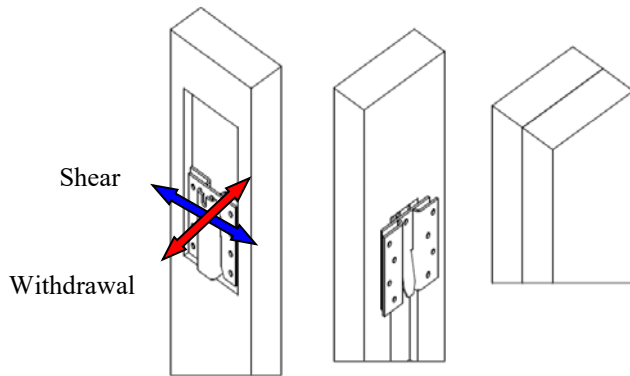


Figure 1 : Timber element and position of ICS

Figure 2: Lateral shear test

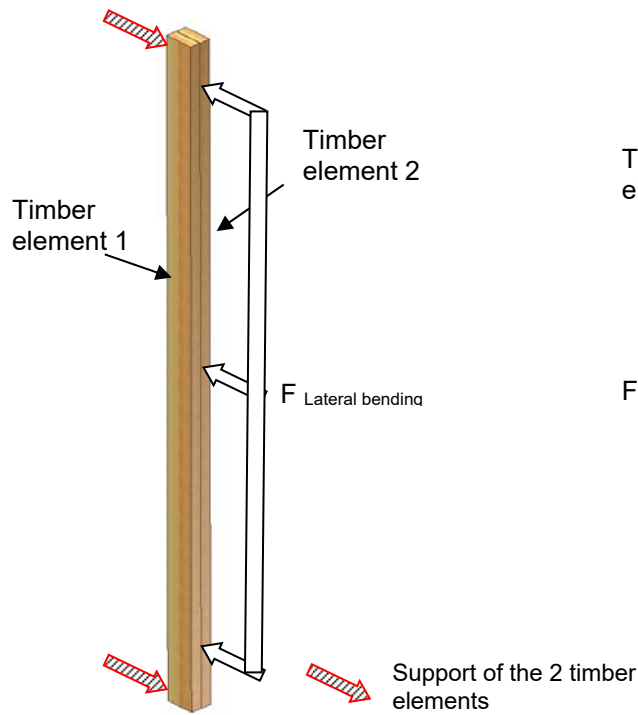


Figure 3 : Lateral bending tests

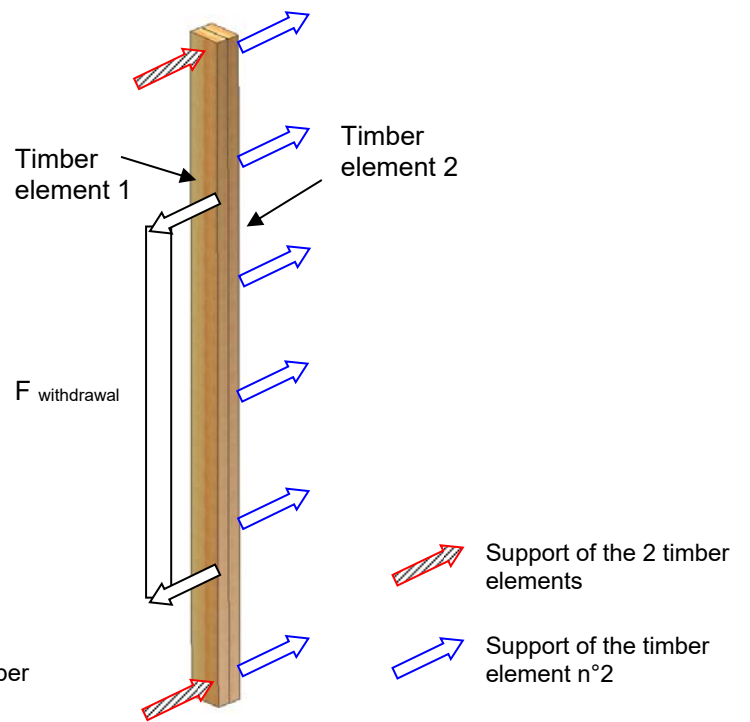


Figure 4: Withdrawal tests

| | Fasteners | | Characteristic Capacities C24 [kN] | | |
|-------|-----------------------------|-----------------------------|------------------------------------|----------------------|---------------------|
| | | | Load direction / configuration | | |
| | Male part | Female part | Lateral Shear | Lateral Bending | Withdrawal |
| 3 ICS | 3 x 6 screws CSA Ø5.0x35 | 3 x 6 screws CSA Ø5.0x35 | 24.3 ⁽¹⁾ | 13.83 ⁽¹⁾ | 5.57 ⁽³⁾ |
| | | | 6.31 ⁽²⁾ | 4.02 ⁽²⁾ | |


- (1) Lateral capacity is given for a displacement of 15 mm.
- (2) Lateral capacity is given for a displacement of 5 mm
- (3) Withdrawal capacity is given for a displacement of 3 mm.

For other timber grade with a lower density, the following k_{dens} ratio should be applied: $k_{dens} = \left(\frac{\rho_k}{350}\right)^2$

D6 ETB

| Product Name | alternative names | | | |
|--------------|-------------------|-----------|-----------|-----------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| ETB | | | | |

Figure D6-1: Drawings

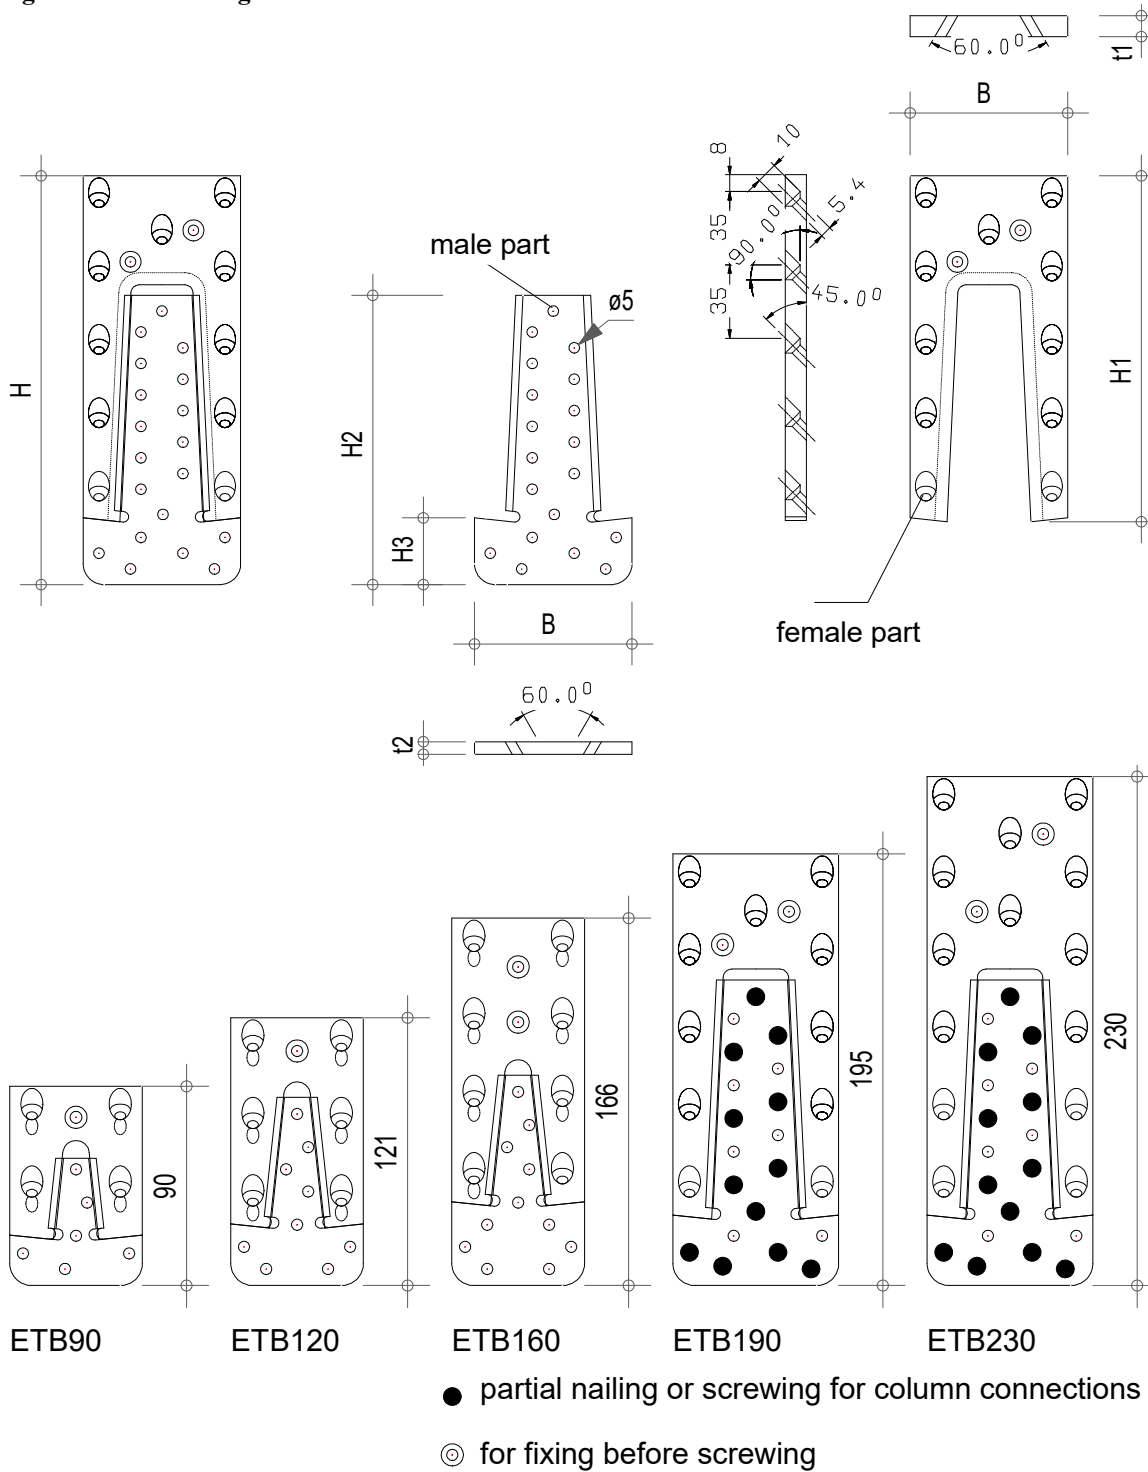

● partial nailing or screwing for column connections

⊙ for fixing before screwing

Table D6-1: dimensions and number of fastener

| Type | sizes [mm] | | | | | | n Ø5,4 | n Ø5 |
|--------|------------|----|-----|-----|------|---------|-----------|---------|
| | H | B | H1 | H2 | H3 | t1 / t2 | | |
| ETB90 | 90 | 60 | 69 | 58 | 22,8 | 10 / 6 | 4 | 6 |
| ETB120 | 121 | 60 | 95 | 85 | 27,8 | 10 / 6 | 6 | 9 |
| ETB160 | 166 | 60 | 130 | 95 | 37,8 | 10 / 6 | 8 | 11 |
| ETB190 | 195 | 75 | 165 | 138 | 31,8 | 10 / 6 | 11 | 19 |
| ETB230 | 230 | 75 | 200 | 138 | 31,8 | 10 / 6 | 14 | 19 |

Table D6-2: Material specification

| Material thickness [mm] | Material Grades | Coating specification |
|-------------------------|--|-----------------------|
| 6 | Aluminium EN AW-6082 T6 according to EN 755-2 stainless steel as described | |
| 10 | | |

For installation for fire justification, see clause B6

Table D6-3: Characteristic capacities :**ETB connectors - Force downward**

$$R_{1,k} = \min \left\{ \begin{array}{l} \frac{n_J^{0,9} \times R_{ax,\alpha,k}}{\sqrt{2}} \\ n_H \times R_{lat,k} \end{array} \right.$$

n_J number of screws in the joist

n_H number of screws or nails in the side grain of the header or column

$R_{lat,k}$ Characteristic value of the load-carrying-capacity of a laterally loaded header/column nail or screw in single shear in a steel-to-timber connection with a thick steel plate according to EN 1995-1-1 or ETA 04/0013 in N

$R_{ax,\alpha,k}$ characteristic axial load-carrying capacity of the screws in the joist according to EN 1995-1-1:2004:2008+A1:2008(E) in N, for the angle between the fiber of timber and the axis of the screw.

D7 EL

| | | | | |
|--------------|-------------------|-----------|-----------|-----------|
| Product Name | alternative names | | | |
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| EL xx | | | | |

xx = size of EL

Figure D7-1: Drawings

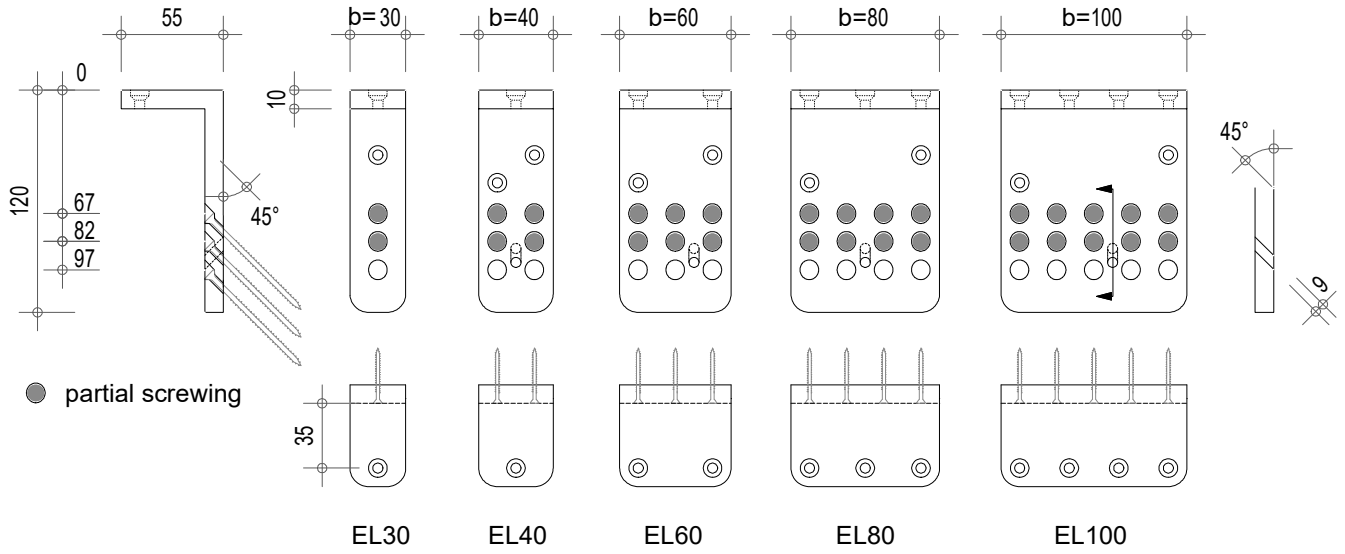


Table D7-1: dimensions and number of fastener

| type | number of holes Ø5,4mm | |
|-------|---------------------------|-----|
| | 45° | top |
| EL30 | 3 | 1 |
| EL40 | 6 | 1 |
| EL60 | 9 | 2 |
| EL80 | 12 | 3 |
| EL100 | 15 | 4 |

Table D7-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|--|-----------------------|
| 6 | Aluminium EN AW-6082 T6 according to EN 755-2 stainless steel as described | |
| 10 | | |

For installation for fire justification, see clause B6

Table D7-3: Characteristic capacities :

$$R_{1,k} = \min \left\{ \begin{array}{l} \frac{n_J^{0,9} \times R_{ax,\alpha,k}}{\sqrt{2}} \\ \frac{k_{c,90} \times f_{c,90ck} \times A_{ef} \times b}{A} \times \left(11,25 + \sqrt{\frac{25 \times f_{y,k} \times A}{k_{c,90} \times f_{c,90,k} \times A_{ef}}} - 380 \right) \\ \frac{278 \times b}{k_{mod}} \end{array} \right.$$

$$R_{4,k} = \min \left\{ \begin{array}{l} 0,3 \times F_{1,d} \\ n_H \times R_{lat,k} \end{array} \right.$$

n_J number of screws in the joist

n_H number of screws in the upper surface of the header

$k_{c,90}$ Factor according to EN 1995-1-1:A1 taking into account the load configuration, the possibility of splitting and the degree of compressive deformation

$f_{c,90,k}$ Characteristic compressive strength perpendicular to the grain in N/mm²

A_{ef} Effective contact area perpendicular to the grain in mm² according to EN 1995-1-1:A1

A Actual contact area perpendicular to the grain in mm²

b Width of the SIMPSON STRONG-TIE® EL hanger in mm


$f_{y,k}$ Aluminium minimum yield strength in N/mm²; $f_{y,k} = 250$ N/mm²

$F_{1,d}$ design value of the joist support load perpendicular to the joist axis in N


$R_{ax,\alpha,k}$ characteristic axial load-carrying capacity of the screws in the joist according to EN 1995-1-1:2004:2008+A1:2008(E) in N, for the angle between the fiber of timber and the axis of the screw.

$R_{lat,k}$ Characteristic value of the load-carrying-capacity of a laterally loaded header nail or screw in N

| type | A [mm] | A_{ef} [mm] | A_{ef}/A |
|-------|--------|---------------|------------|
| EL30 | 1350 | 3600 | 2,67 |
| EL40 | 1800 | 4500 | 2,5 |
| EL60 | 2700 | 5400 | 2 |
| EL80 | 3600 | 6300 | 1,75 |
| EL100 | 4500 | 7200 | 1,6 |

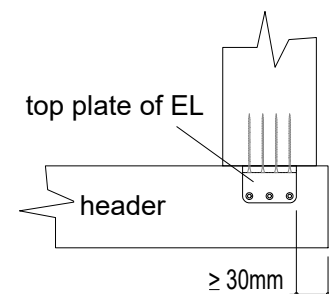

The value A_{ef} based on minimum distance of 30mm between the EL and the end of

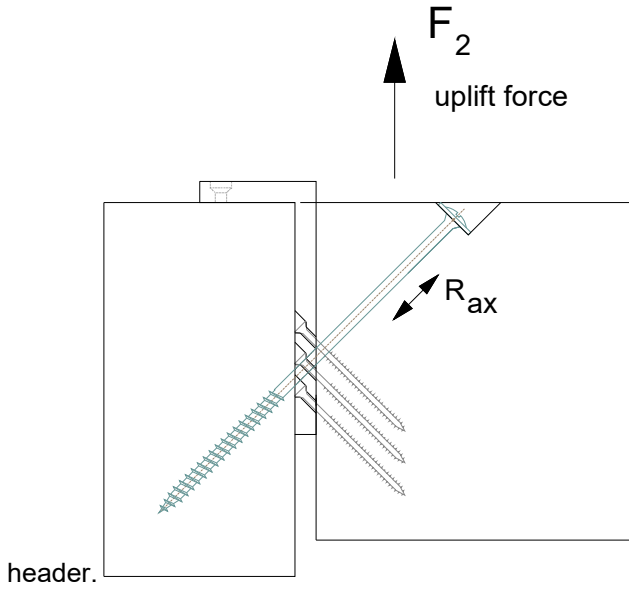

An uplift force may be adsorbed by an extra screw as shown above.

$$R_{2,k} = \frac{R_{ax,k}(Screw)}{\sqrt{2}}$$

$R_{ax,k}(Screw)$ Characteristic axial load-carrying capacity of the extra screw as the min of threaded part and pull through capacity of the head.

D8 ELS

| | | | | |
|--------------|-------------------|-----------|-----------|-----------|
| Product Name | alternative names | | | |
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| ELS xx | | | | |

xx = Size of ELS

Figure D8-1: Drawings

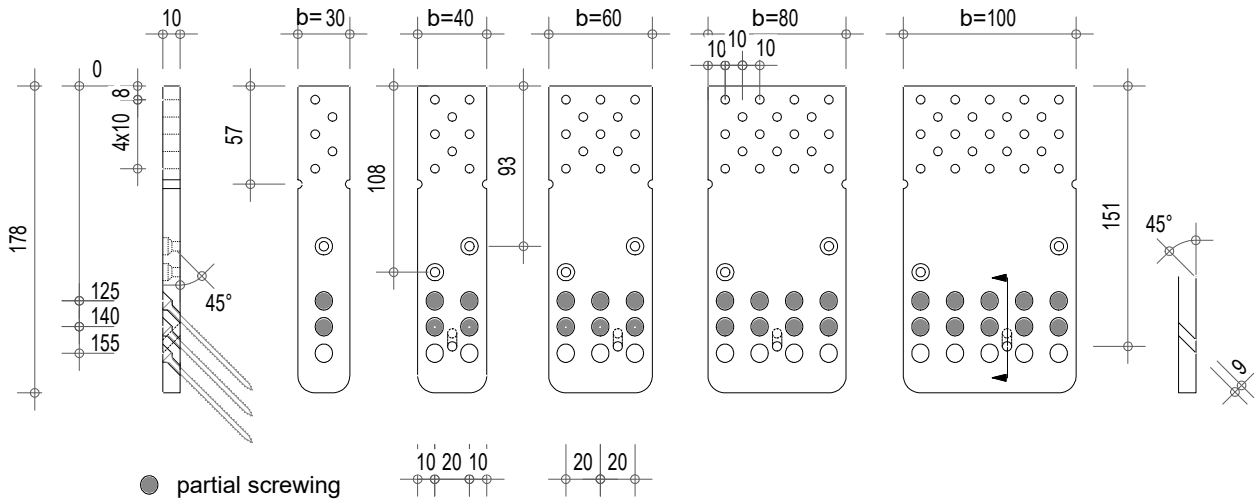


Table D8-1: dimensions and number of fastener

| type | number of holes | |
|--------|-----------------|-------------|
| | Ø5,4 45° | Ø5,0 top |
| ELS30 | 3 | 5 |
| ELS40 | 6 | 8 |
| ELS60 | 9 | 13 |
| ELS80 | 12 | 15 |
| ELS100 | 15 | 19 |

Table D8-2: Material specification

| Material thickness | Material Grades | Coating Specification |
|--------------------|--|-----------------------|
| 10 | Aluminium EN AW-6082 T6 according to EN 755-2 stainless steel as described | |

For installation for fire justification, see clause B6

Table D8-3: Characteristic capacities :


$$R_{1,k} = \min \begin{cases} \frac{n_J^{0,9} \times R_{ax,\alpha,k}}{\sqrt{2}} \\ n_H \times R_{lat,k} \end{cases}$$

n_J number of screws in the joist

n_H number of screws in the upper surface of the header

$R_{ax,\alpha,k}$ characteristic axial load-carrying capacity of the screws in the joist according to EN 1995-1-1:2004:2008+A1:2008(E)
 For a connection with a slope $< 0^\circ$, it shall be check the permission for angle between the fiber of timber and the axis of the screw.

$R_{lat,k}$ characteristic value of the load-carrying-capacity of a laterally loaded header nail or screw in N

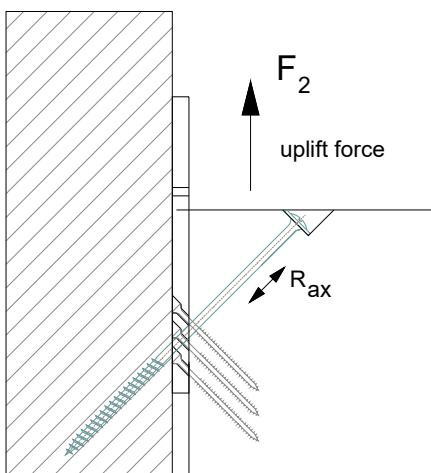

An uplift force may be adsorbed by an extra screw as shown above.


$$R_{2,k} = \frac{R_{ax,k}(Screw)}{\sqrt{2}}$$

$R_{ax,k}$ characteristic axial load-carrying capacity of the extra screw as the min of threaded part and pull through capacity of the head.

D9 CBH

| Product Name | alternative names | | | |
|---------------|-------------------|--------------|--------------|--------------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| CBH xxx / 2.5 | | | | |

xxx = size of CBH

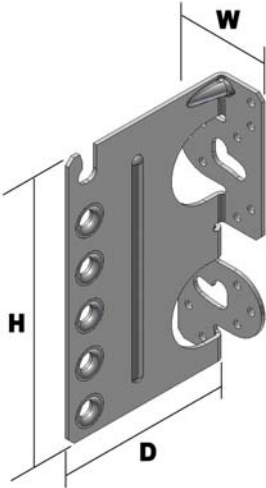Figure D9-1: Drawings**Table D9-1: Dimensions and number of fastener**

| Model | [mm] | | | | Angle | |
|------------|---------|----------|---------|-----------|--------|-----------|
| | Width W | Height H | Depth D | Thickness | degree | Direction |
| CBH105/2,5 | 40 | 105 | 100 | 2,5 | 90° | ~ |
| CBH150/2,5 | 60 | 150 | 113,5 | 2,5 | 90° | ~ |
| CBH180/2,5 | 60 | 180 | 113,5 | 2,5 | 90° | ~ |
| CBH220/2,5 | 60 | 220 | 113,5 | 2,5 | 90° | ~ |

| Model | Header Fasteners | | Joist Fasteners |
|------------|-------------------|---------------------------------|----------------------------------|
| | nails or screws * | Bolts Anchors Wood screws | Dowel Ø10 acc. To EN 14592 |
| CBH105/2,5 | 8 | 2-Ø8 | 3 |
| CBH150/2,5 | 14 | 2-Ø10 | 5 |
| CBH180/2,5 | 16 | 2-Ø10 | 6 |
| CBH220/2,5 | 22 | 2-Ø10 | 7 |

* According to ETA 04/0013 or according to EN14592

Washer for a wood/ rigid support connection.

The minimum dimension has to be used:

Bolt Ø10 + Washer M10 (Øext = 20 – Øint = 11mm)

Bolt Ø8 + Washer M8 (Øext = 16 – Øint = 8,5mm) for CBH105

Table D9-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|------------------------------|-----------------------|
| 3 | S 250 GD | Z275 |
| 3 | stainless steel as described | |

For installation for fire justification, see clause B6

Table D9-3: Characteristic capacities $R_{1,k}$ [kN] timber to timber:

Characteristic value [kN] of a CBH concealed Joist hangers for connections between timber header beam and timber supported joist. Header fastener: CNA4,0x60.

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 0 | | | | | | 5 | | | | | | 10 | | | | | |
| CBH150 | 18,0 | 18,6 | 20,7 | 22,4 | 24,0 | 24,0 | 17,8 | 18,4 | 20,3 | 22,0 | 23,8 | 23,8 | 17,5 | 18,1 | 20,0 | 21,6 | 23,4 | 23,5 |
| CBH180 | 25,0 | 26,4 | 29,5 | 32,1 | 32,6 | 32,6 | 24,7 | 26,1 | 29,1 | 31,6 | 32,4 | 32,4 | 24,3 | 25,6 | 28,5 | 31,0 | 32,1 | 32,1 |
| CBH220 | 32,6 | 34,2 | 37,9 | 41,1 | 42,8 | 42,8 | 32,2 | 33,7 | 37,3 | 40,4 | 42,4 | 42,4 | 31,8 | 33,2 | 36,6 | 39,7 | 42,0 | 42,0 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 15 | | | | | | 20 | | | | | | 25 | | | | | |
| CBH150 | 17,3 | 17,9 | 19,6 | 21,2 | 22,9 | 23,3 | 17,1 | 17,6 | 19,3 | 20,8 | 22,4 | 23,0 | 16,9 | 17,4 | 19,0 | 20,4 | 22,0 | 22,7 |
| CBH180 | 24,0 | 25,2 | 28,0 | 30,5 | 31,8 | 31,8 | 23,6 | 24,8 | 27,5 | 29,9 | 31,4 | 31,4 | 23,4 | 24,5 | 27,0 | 29,3 | 31,1 | 31,1 |
| CBH220 | 31,4 | 32,7 | 35,9 | 38,9 | 41,6 | 41,6 | 31,0 | 32,3 | 35,3 | 38,2 | 41,1 | 41,1 | 30,7 | 31,8 | 34,8 | 37,5 | 40,4 | 40,7 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 30 | | | | | | 35 | | | | | | 40 | | | | | |
| CBH150 | 16,7 | 17,2 | 18,7 | 20,1 | 21,6 | 22,5 | 16,6 | 17,0 | 18,4 | 19,8 | 21,2 | 22,3 | 16,5 | 16,8 | 18,2 | 19,5 | 20,9 | 22,1 |
| CBH180 | 23,1 | 24,1 | 26,6 | 28,8 | 30,8 | 30,8 | 22,8 | 23,8 | 26,2 | 28,4 | 30,5 | 30,5 | 22,7 | 23,6 | 25,9 | 28,0 | 30,1 | 30,3 |
| CBH220 | 30,4 | 31,5 | 34,3 | 37,0 | 39,7 | 40,4 | 30,1 | 31,2 | 33,9 | 36,5 | 39,1 | 40,0 | 30,0 | 31,0 | 33,6 | 36,1 | 38,7 | 39,8 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|
| Slope | 45 | | | | | |
| CBH150 | 16,3 | 16,7 | 18,0 | 19,3 | 20,6 | 21,9 |
| CBH180 | 22,5 | 23,4 | 25,6 | 27,6 | 29,7 | 30,1 |
| CBH220 | 29,8 | 30,8 | 33,3 | 35,7 | 38,3 | 39,5 |

Table D9-4: Characteristic capacities $R_{1,k}$ [kN] timber to steel/concrete:

Characteristic values [kN] for connection where the CBH joist hanger is bolted to a steel or reinforced concrete structural member and carrying a timber supported joist.

1. Dowel characteristic capacity

 $F_{k,dowels}$

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 0 | | | | | | 5 | | | | | | 10 | | | | | |
| CBH150 | 12,4 | 13,2 | 15,6 | 17,7 | 19,5 | 19,5 | 12,2 | 13,0 | 15,2 | 17,3 | 19,3 | 19,3 | 12,0 | 12,7 | 14,9 | 16,9 | 19,0 | 19,0 |
| CBH180 | 19,3 | 21,1 | 25,2 | 28,8 | 29,7 | 29,7 | 18,9 | 20,7 | 24,6 | 28,1 | 29,2 | 29,2 | 18,5 | 20,2 | 23,9 | 27,4 | 28,8 | 28,8 |
| CBH220 | 23,8 | 25,9 | 30,6 | 34,9 | 37,1 | 37,1 | 23,4 | 25,4 | 29,8 | 34,0 | 36,6 | 36,6 | 22,9 | 24,8 | 29,0 | 33,0 | 36,0 | 36,0 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 15 | | | | | | 20 | | | | | | 25 | | | | | |
| CBH150 | 11,7 | 12,4 | 14,5 | 16,4 | 18,4 | 18,7 | 11,5 | 12,1 | 14,1 | 15,9 | 17,9 | 18,3 | 11,3 | 11,8 | 13,7 | 15,4 | 17,3 | 18,0 |
| CBH180 | 18,2 | 19,7 | 23,3 | 26,6 | 28,3 | 28,3 | 17,8 | 19,2 | 22,6 | 25,8 | 27,8 | 27,8 | 17,4 | 18,8 | 22,0 | 25,0 | 27,3 | 27,3 |
| CBH220 | 22,4 | 24,2 | 28,2 | 32,1 | 35,3 | 35,3 | 22,0 | 23,6 | 27,4 | 31,1 | 34,7 | 34,7 | 21,5 | 23,0 | 26,7 | 30,2 | 34,0 | 34,1 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Slope | 30 | | | | | | 35 | | | | | | 40 | | | | | |
| CBH150 | 11,0 | 11,6 | 13,4 | 15,0 | 16,8 | 17,7 | 10,8 | 11,3 | 13,0 | 14,6 | 16,3 | 17,4 | 10,7 | 11,1 | 12,7 | 14,2 | 15,9 | 17,1 |
| CBH180 | 17,0 | 18,3 | 21,4 | 24,3 | 26,8 | 26,8 | 16,7 | 17,9 | 20,9 | 23,6 | 26,4 | 26,4 | 16,4 | 17,6 | 20,4 | 23,1 | 26,0 | 26,0 |
| CBH220 | 21,1 | 22,5 | 26,0 | 29,4 | 33,0 | 33,5 | 20,7 | 22,1 | 25,4 | 28,6 | 32,2 | 33,0 | 20,4 | 21,7 | 24,9 | 28,0 | 31,4 | 32,6 |

| Widths | 60 | 80 | 100 | 120 | 140 | 160 |
|--------|------|------|------|------|------|------|
| Slope | 45 | | | | | |
| CBH150 | 10,5 | 10,9 | 12,5 | 13,9 | 15,5 | 16,9 |
| CBH180 | 16,2 | 17,3 | 20,0 | 22,6 | 25,4 | 25,7 |
| CBH220 | 20,1 | 21,3 | 24,4 | 27,4 | 30,8 | 32,2 |

2. Max characteristic capacity [kN] of the steel part $F_{k,steel}$

| Model | $F_{k,steel}$ |
|--------|---------------|
| CBH150 | 15,9 |
| CBH180 | 23,3 |
| CBH220 | 26,1 |

3. Design capacity of the CBH – $F_{d,CBH}$

$$F_{d,CBH} = \min \left\{ \begin{array}{l} \frac{F_{k,dowels} \times k_{mod}}{\gamma_M} \\ \frac{F_{k,steel}}{\gamma_M} \end{array} \right.$$

Table D9-5: Characteristic capacities timber to timber CBH105/2,5:

| R _{1,k} [kN] | width of joist = length of steel dowel [mm] | | |
|-----------------------|---|------------------------------|------------------------------|
| | 45 | 50 | 60 |
| CNA 4,0x40 | 8,9 | 8,9 | 9,2 |
| CNA 4,0x50 | 9,6 | 9,6 | 9,9 |
| CNA 4,0x60 | min. of: 10,2 ; 11,2/kmod | min. of: 10,3 ; 11,2/kmod | min. of: 10,5 ; 11,2/kmod |
| CSA 5,0x35 | min. of: 10,6 ; 11,2/kmod | min. of: 10,6 ; 11,2/kmod | min. of: 10,8 ; 11,2/kmod |
| CSA 5,0x40 | min. of: 12 ; 11,2/kmod | min. of: 12 ; 11,2/kmod | min. of: 12,2 ; 11,2/kmod |
| CSA 5,0x50 | min. of: 13,6 ; 11,2/kmod | min. of: 13,7 ; 11,2/kmod | min. of: 13,8 ; 11,2/kmod |

Table D9-6: Characteristic capacities timber to timber CBH105/2,5:

| R _{2,k} [kN] | width of joist = length of steel dowel [mm] | | |
|-----------------------|---|------------------------------|------------------------------|
| | 45 | 50 | 60 |
| CNA 4,0x40 | 6,4 | 6,5 | 6,6 |
| CNA 4,0x50 | 7,1 | 7,2 | 7,3 |
| CNA 4,0x60 | 7,7 | 7,8 | 7,9 |
| CSA 5,0x35 | 8,4 | 8,5 | 8,6 |
| CSA 5,0x40 | 9,8 | 9,8 | 9,9 |
| CSA 5,0x50 | min. of: 11,5 ; 11,2/kmod | min. of: 11,5 ; 11,2/kmod | min. of: 11,6 ; 11,2/kmod |


Table D9-7: Characteristic capacities timber to steel/concrete CBH105/2,5:

| [kN] | width of joist = length of steel dowel [mm] |
|------------------|--|
| | ≥ 45mm |
| R _{1,k} | min. of: 13,6 ; 11,2/kmod |
| R _{2,k} | min. of: 11,5 ; 11,2/kmod |

For sloped connection shall be use the following factors for the values from Table D9-5 to D9-7:

for different slope β


| | | | | |
|---------|----|------|-----|------|
| β | 0° | 15° | 30° | 45° |
| factor | 1 | 0,95 | 0,9 | 0,85 |




D10 ETS / ETSN

| Product Name | alternative names | | | |
|--------------|-------------------|-----------|-----------|-----------|
| | Branch 36 | Branch 40 | Branch 46 | Branch 47 |
| ETS | | | | |
| ETSN | | | | |

Figure D10-1: Drawings

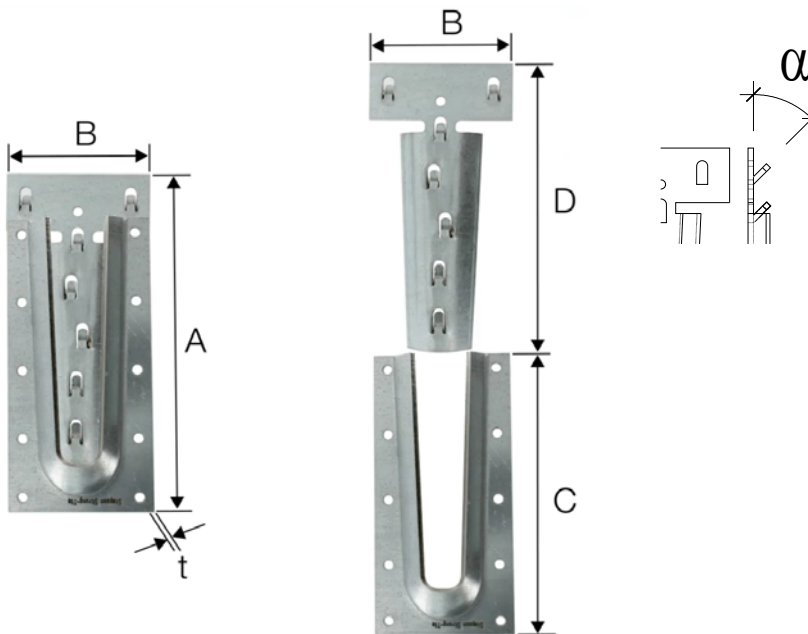

ETS

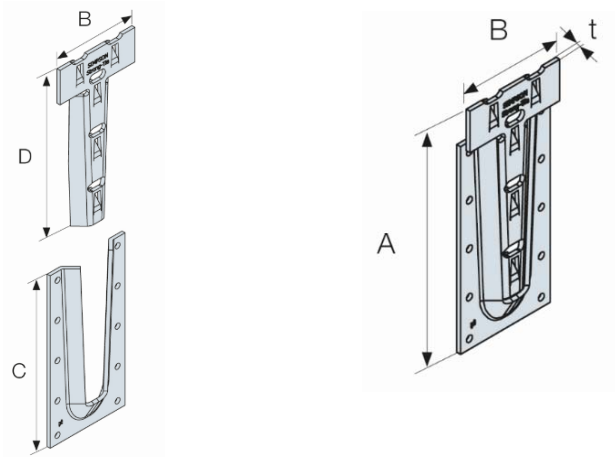

ETSN

Table D10-1: Dimensions and number of fastener

| References | Product dimensions [mm] | | | | | angle α | Joist Dimension | | | Header holes $\varnothing 5$ | Joist holes $\varnothing 6$ Pan Holes |
|----------------|-------------------------|----|-----|-----|---|-------------------|-----------------|-------------------------------|--------|---------------------------------|--|
| | A | B | C | D | t | | Width | | Height | | |
| | | | | | | Min. | Min. | Max. | | | |
| ETS100 | 100 | 65 | 70 | 70 | 3 | 45° | 70 | | | 4 | 3 |
| ETS140 | 140 | 65 | 100 | 100 | 3 | 45° | 75 | | | 8 | 5 |
| ETS180 | 180 | 75 | 150 | 150 | 3 | 45° | 85 | | | 10 | 7 |
| ETSN100 | 100 | 60 | 70 | 70 | 3 | 35° | 70 | Depends on screw length | | 4 | 3 |
| ETSN130 | 130 | 65 | 100 | 100 | 3 | 35° | 75 | | | 8 | 4 |
| ETSN180 | 180 | 75 | 150 | 150 | 3 | 35° | 85 | | | 10 | 5 |

Table D10-2: Material specification

| Material thickness [mm] | Material Grades |
|-------------------------|--|
| 3 | Pre-galvanized steel Grade S250GD + Z (min Z275) according to EN 10346 with tolerances according to EN 10143 except if another material is specified. Or Stainless steel number 1.4401 or number 1.4404 according to EN 10088-2 with a minimum characteristic 0.2% yield stress of 240 MPa, a minimum 1.0% yield stress of 270 MPa and a minimum ultimate tensile strength of 530 MPa or a stainless steel with a minimum characteristic 0.2% yield stress of 240 MPa, a minimum 1.0% yield stress of 270 MPa and a minimum ultimate tensile strength of 530 MPa. If ETS are made using Stainless Steel, stainless fasteners need to be used. |

For installation for fire justification, see clause B6

**Table D10-3: Characteristic capacities [kN] for ETS:
ETS connectors - Force downward**

$$R_{1,k} = \min \left\{ \begin{array}{l} \frac{n_J^{0,9} \times R_{ax,\alpha,k}}{\sqrt{2}} \\ n_H \times R_{lat,k} \end{array} \right.$$

n_J number of screws at 45° in the joist

n_H number of screws in the side grain of the header

$R_{lat,k}$ Characteristic value of the load-carrying-capacity of a laterally loaded header/column nail or screw in single shear in a steel-to-timber connection with a thick steel plate according to EN 1995-1-1 or ETA 04/0013 in N

$R_{ax,\alpha,k}$ characteristic axial load-carrying capacity of the screws in the joist according to EN 1995-1-1:2004:2008+A1:2008(E) in N, for the angle between the fiber of timber and the axis of the screw.

Table D10-4: Characteristic capacity [kN] for ETSN

ETSN connectors - Force downward

ETSN100

$$R_{1,E} = \min \begin{cases} 2.45 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 4 \times R_{v,i,k} \end{cases}$$

ETSN130

$$R_{1,E} = \min \begin{cases} 3.27 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 8 \times R_{v,i,k} \end{cases}$$

ETSN180

$$R_{1,E} = \min \begin{cases} 4.09 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 10 \times R_{v,i,k} \end{cases}$$

On column, fully screwed on the joist, partially screwed/nailed on the column:

ETSN100

$$R_{1,E} = \min \begin{cases} 2.45 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 3.70 \times R_{v,i,k} \end{cases}$$


ETSN130

$$R_{1,E} = \min \begin{cases} 3.27 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 4.01 \times R_{v,i,k} \end{cases}$$


ETSN180

$$R_{1,E} = \min \begin{cases} 4.09 \times R_{ax,i,k} \\ 30.60 / k_{mod} \\ 5.70 \times R_{v,i,k} \end{cases}$$


Corresponding nailing/screwing pattern:



ETSN100/22-C

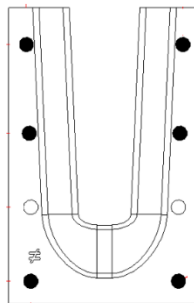

ETSN130/22-C



ETSN180/22-C

With


$R_{ax,i,k}$ characteristic axial capacity of the screws skewed in the supported member, based on the angle between screw and grain. Any slope of the supported member works if the screw approval allows an angle between screw axis and grain down to 0°. Otherwise, the slope shall be between -25 and +90°.

$R_{v,i,k}$ characteristic lateral capacity of the screw in the header
 k_{mod} partial safety factor depending on load duration

D11 ICST

| | | | | |
|--------------|-------------------|--------|----|---|
| Product Name | alternative names | | | |
| | UK | France | DK | D |
| ICST | | | | |

Figure D11-1: Drawings

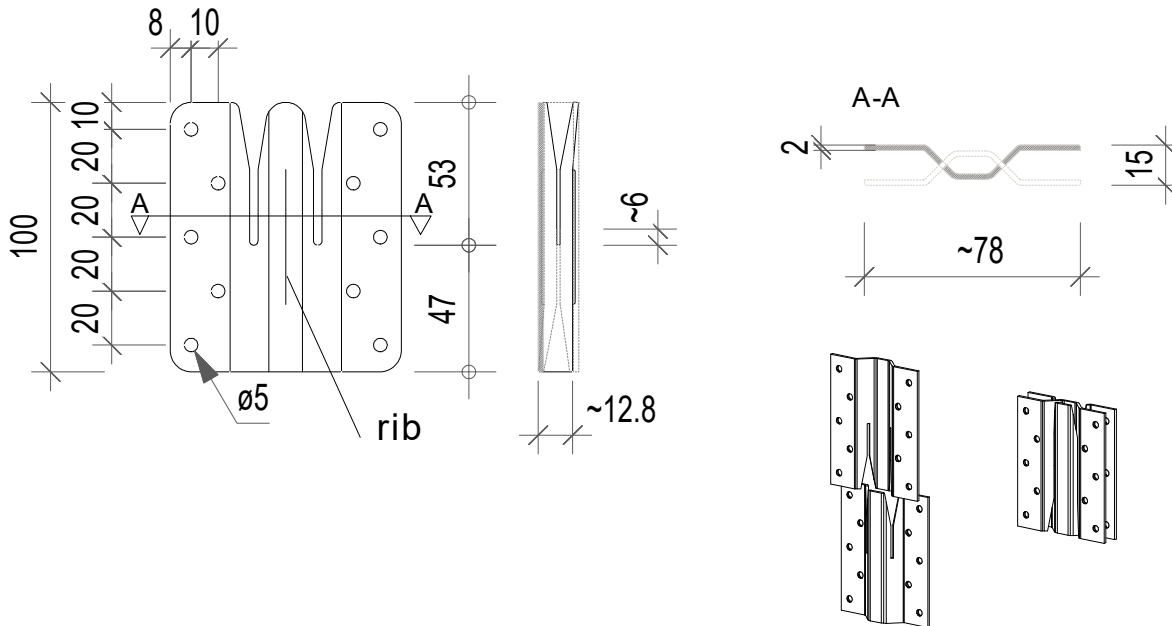

For a connection 2 single pieces have to be use as a pair

Table D11-1: Size specification

| Dimensions | | | | Number of Fasteners | |
|------------|-----|----|---|---------------------|------------------|
| A | B | C | D | Supporting Member | Supported Member |
| 78 | 100 | 15 | 2 | 10 | 10 |

The ICST consists of two single pieces

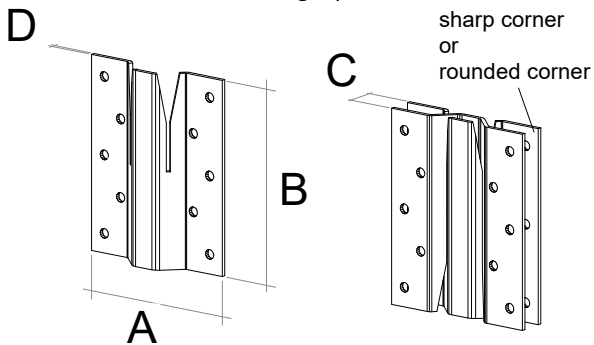


Table D11-2: Material specification

| Material thickness | Material Grades | Coating specification |
|--------------------|------------------------------------|--------------------------------|
| 2 | S250 GD according to EN 10326:2004 | Z275 according to EN10326:2004 |

Or stainless steel according to clause II-1

For installation for fire justification, see clause B6

Figure D11-2: Nail/screw pattern

Full nailing

e.g. CNA 4,0xl nails , CSA5,0xl screws


Table D11-3: Characteristic capacity [kN]

| For one pair of ICST = two single pieces | characteristic capacities [kN] per connection (one pair) | |
|--|--|-----------------------------|
| | $R_{3,k}$ | $R_{4,k}$ |
| min of: | $6,72 \cdot R_{lat,k}$ | min of: $4 \times R_{ax,k}$ |
| | $16,9/k_{mod}$ | $5,35/k_{mod}$ |

With


$R_{lat,k}$ = the lateral capacity of one single used fastener

$R_{ax,k}$ = the axial capacity of one single used fastener



For connection between timber elements (e.g. two wall elements) multiple ICST may be used.

The two single pieces are to place on the “same” high (for example same distance “a” from the top as described below), by the mounting the elements are to fit into each other.

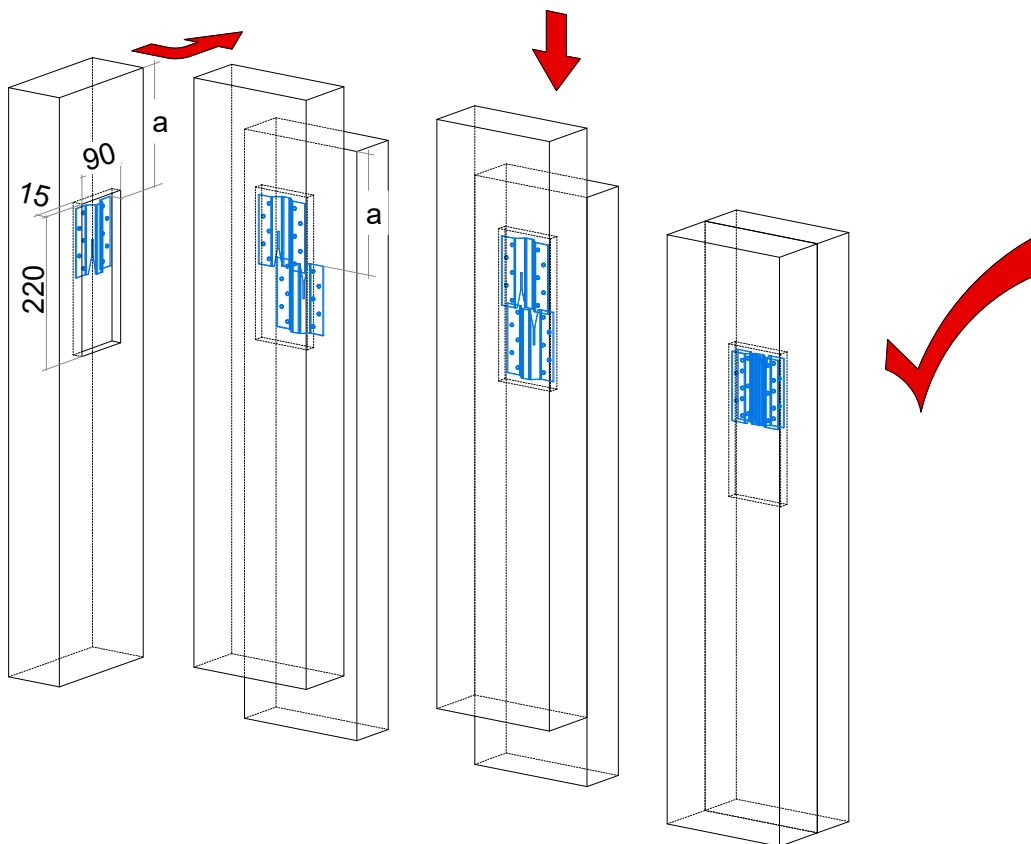

D12 Janebo : JHHU, JHDU, JHGU, JHH, JHD, JHG

| Product Name | alternative names | | | |
|--------------|-------------------|--------|----|-------|
| | UK | France | DK | D |
| JHHxx | | | | |
| JHD1-xx | | | | JHDxx |
| JHGxx | | | | |
| JHHUxx | - | - | - | |
| JHDUxx | - | - | - | |
| JHGUxx | - | - | - | - |

Types with the “U” are for products with steel dowel for uplift;

Drawings

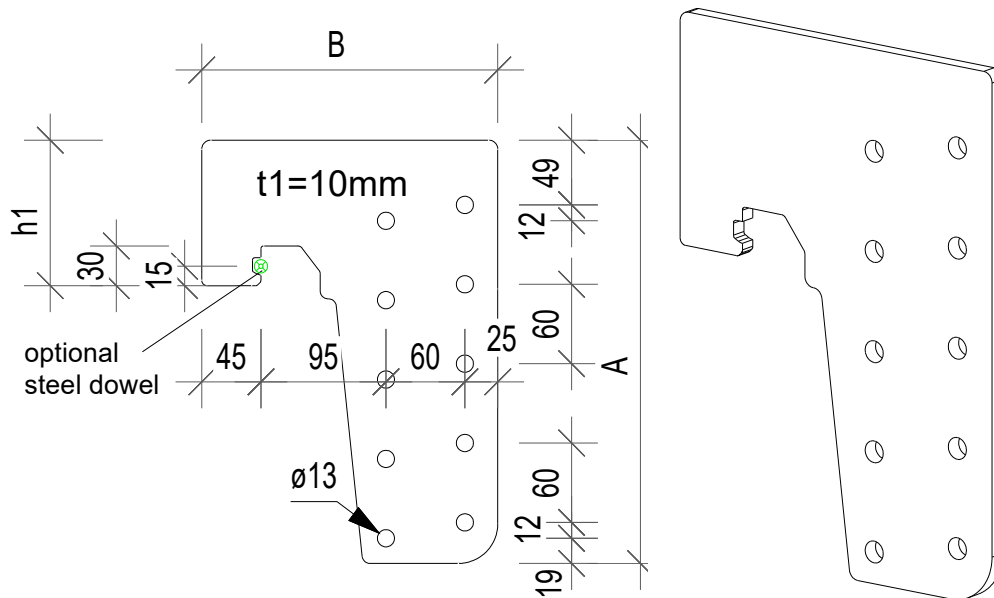


Figure D12-1: Dimensioned drawings of JHHU

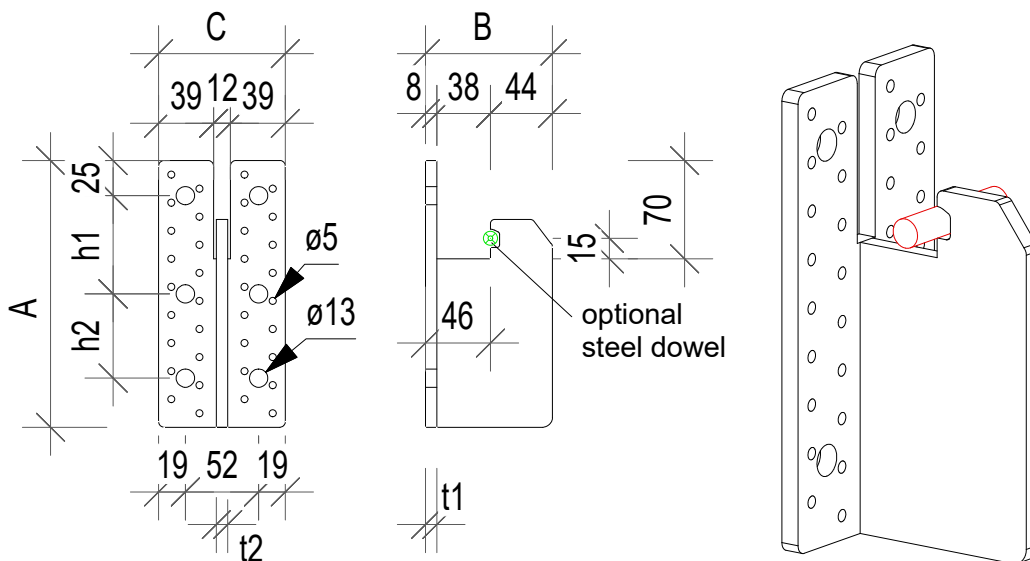


Figure D12-2: Dimensioned drawings of JHDU

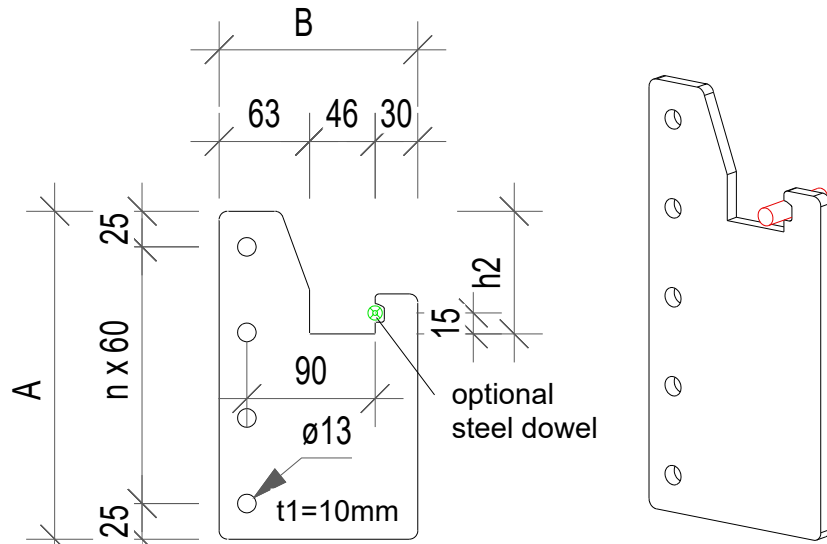


Figure D12-3: Dimensioned drawings for JHGU

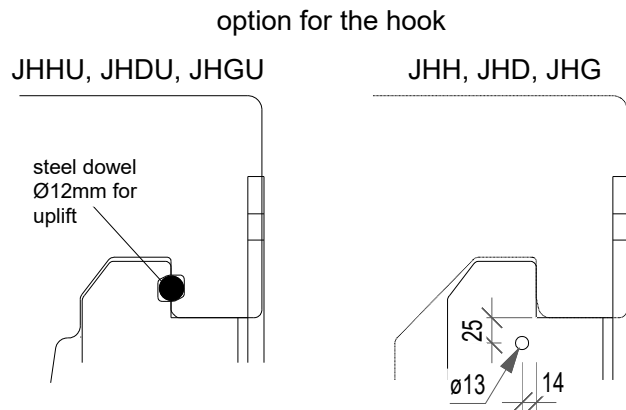


Figure D12-4: The hook for all types can be made in two different version, for an uplift force only the left one can be use.

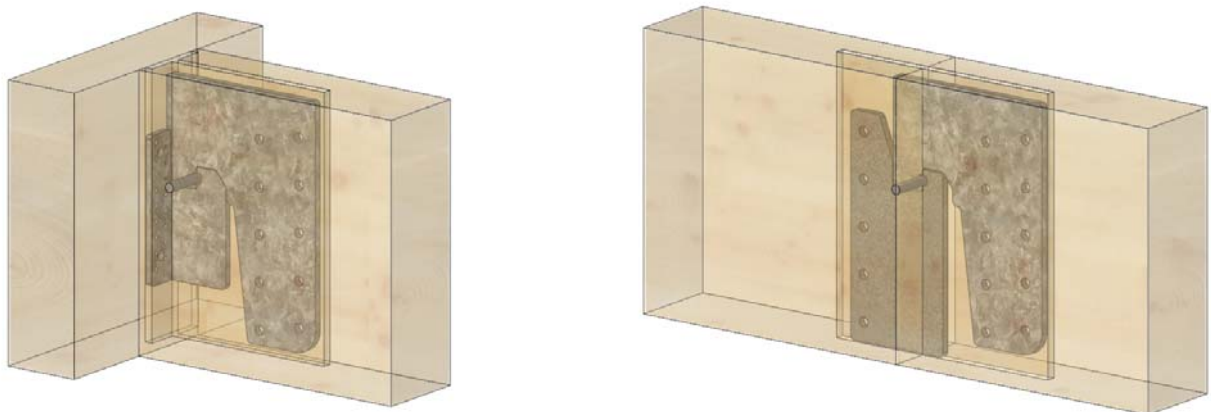


Figure D12-5: example of use, for an uplift force (F_2) the steel dowel as shown in figure D12-4 on the left one has to be installed

Table D12-1: Size specification

| | sizes [mm] | | | | | | | no of holes | |
|-----------------|------------|-----|----|----|----|-----|-----|-------------|-------|
| | A | B | C | t1 | t2 | h1 | h2 | Ø5mm | Ø13mm |
| JHH140/JHHU140 | 140 | 225 | | 10 | | 110 | | | 4 |
| JHH180/JHHU180 | 180 | 225 | | 10 | | 110 | | | 6 |
| JHH200/JHHU200 | 200 | 225 | | 10 | | 110 | | | 6 |
| JHH260/JHHU260 | 260 | 225 | | 10 | | 110 | | | 8 |
| JHH320/JHHU320 | 320 | 225 | | 10 | | 110 | | | 10 |
| JHH380/JHHU380 | 380 | 225 | | 10 | | 140 | | | 12 |
| JHHU440/JHH440 | 440 | 225 | | 10 | | 170 | | | 14 |
| JHHU500/JHH500 | 500 | 225 | | 10 | | 170 | | | 16 |
| JHHU560/JHH560 | 560 | 225 | | 10 | | 170 | | | 18 |
| JHHU620/JHH620 | 620 | 225 | | 10 | | 170 | | | 20 |
| JH DU20/JHD1-20 | 110 | 90 | 90 | 8 | 8 | 60 | | 20 | 2 |
| JH DU24/JHD1-24 | 130 | 90 | 90 | 8 | 8 | 80 | | 24 | 2 |
| JH DU36/JHD1-36 | 190 | 90 | 90 | 8 | 8 | 140 | | 36 | 4 |
| JHD1-48/JHD1-48 | 250 | 90 | 90 | 8 | 8 | 100 | 100 | 48 | 4 |
| JH DU60/JHD1-60 | 310 | 90 | 90 | 8 | 9 | 130 | 130 | 60 | 6 |
| JH DU72/JHD72 | 370 | 90 | 90 | 8 | 9 | 130 | 130 | 72 | 6 |
| JH DU84/JHD84 | 430 | 90 | 90 | 8 | 9 | 130 | 130 | 84 | 6 |
| JH DU96/JHD96 | 490 | 90 | 90 | 8 | 9 | 130 | 130 | 96 | 6 |
| JH GU200/JHG200 | 170 | 139 | | 10 | | | 86 | | 3 |
| JH GU260/JHG260 | 230 | 139 | | 10 | | | 86 | | 4 |
| JH GU320/JHG320 | 290 | 139 | | 10 | | | 86 | | 5 |
| JH GU380/JHG380 | 350 | 139 | | 10 | | | 116 | | 6 |
| JH GU440/JHG440 | 410 | 139 | | 10 | | | 146 | | 7 |
| JH GU500/JHG500 | 470 | 139 | | 10 | | | 146 | | 8 |
| JH GU560/JHG560 | 530 | 139 | | 10 | | | 146 | | 9 |
| JH GU620/JHG620 | 590 | 139 | | 10 | | | 146 | | 10 |

Material specification

Standard material:

S355JR according to EN10025 + electroplated zinc Fe/Zn12/B according to EN2081 or comparable

Alternative:

S235JR according to EN10025 + electroplated zinc Fe/Zn12/B according to EN2081 or comparable

The capacities [kN] in the tables are based on the application with the following fastener:

CNA-nails and CSA-screws according to ETA04/0013


Steel dowel Ø12mm with $f_{u,k} = 360 \text{ N/mm}^2$

For installation for fire justification, see clause B6

Characteristic capacities

The checks below have to be made for both parts of a connection, eg: JHH with JH DU or JHHU with JH GU, the weakest part is decisive.

$$R_{i,j,d} = \min \left\{ R_{i,jt,k} ; \frac{R_{i,js,k}}{k_{\text{mod}}} \right\} \times k_{\text{mod}} / \gamma_M$$

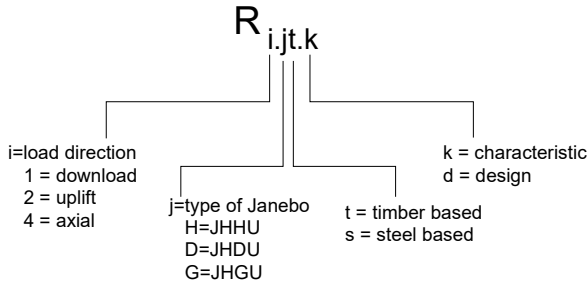

$$R_{i,jt,d} = R_{i,jt,k} \times k_{\text{mod}} / \gamma_M$$

$$R_{i,js,d} = R_{i,js,k} / \gamma_M$$

$$\eta_{1,j,s} = \frac{F_{1,d}}{R_{1,js,d}}$$

$$\eta_{1,j,t} = \frac{F_{1,d}}{R_{1,jt,d}}$$

Or for uplift:

$$\eta_{1,j,s} = \frac{F_{2,d}}{R_{2,js,d}}$$

$$\eta_{1,j,t} = \frac{F_{2,d}}{R_{2,jt,d}}$$



The factors $k_{4,j,t}$ and $k_{4,j,s}$ are given in the table for the respective values η_i .

Check:

$$\frac{F_{1,d}}{R_{1,j,d}} \leq 1 \quad \text{and} \quad \frac{F_{4,d}}{R_{4,jt,d}} \leq k_{4,jt} \quad \text{and} \quad \frac{F_{4,d}}{R_{4,js,d}} \leq k_{4,js}$$

Or for uplift (only for the types ...U/xx):

$$\frac{F_{2,d}}{R_{2,j,d}} \leq 1 \quad \text{and} \quad \frac{F_{4,d}}{R_{4,jt,d}} \leq k_{4,jt} \quad \text{and} \quad \frac{F_{4,d}}{R_{4,js,d}} \leq k_{4,js}$$

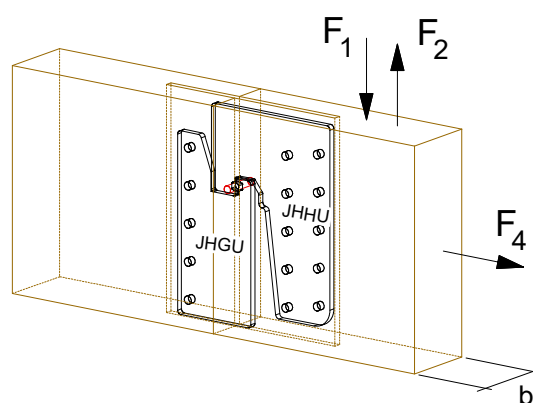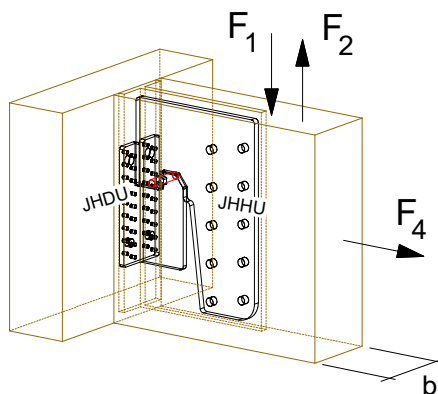


For timber elements with a density $\rho_k > 350 \text{ kg/m}^3$, values can be increased as shown by the following table:

| R _{i,jt,k} values may be increase: | | | |
|---|----------------------------------|-------------|-------------|
| | to ρ_k [kg/m ³] | | |
| from ρ | 380 | 410 | 430 |
| 350 | 1,04 | 1,08 | 1,11 |


The values from the tables D12-2, D12-4 and D12-6 are based on a full nailing, using of all steel dowel holes.

standard connection
to use all nailholes / all holes for steel dowel


JHDUxx




JHHUxx

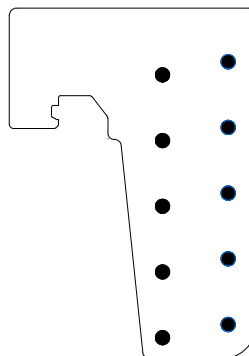


JHGUxx




JHD1-xx
JHDxx



JHHxx

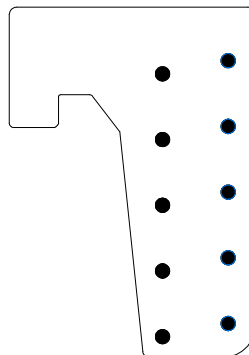

JHGxx



The steel based capacities for products, made from the material S235JG, have to be multiply with the factor 0,65 .

Connection to Column:

It's possible to use the JH DU also for connection to column, in this case it is to use a nail pattern as shown following

In this case, the capacity for connection to beam shall be multiply with the factors are given in the following both tables.


Table D12-10: Column factors JH DU
factors for "column" nail pattern

| for | JH DU20 | JH DU24 | JH DU36 | JH DU48 | JH DU60 | JH DU72 | JH DU84 | JH DU96 |
|---------------------|---------|---------|---------|---------|---------|---------|---------|---------|
| R _{1,Dt.k} | 0,61 | 0,51 | 0,56 | 0,50 | 0,53 | 0,50 | 0,52 | 0,50 |
| R _{4,Dt.k} | 0,25 | 0,57 | 0,58 | 0,54 | 0,55 | 0,53 | 0,53 | 0,52 |
| R _{2,Dt.k} | 0,62 | 0,54 | 0,56 | 0,51 | 0,53 | 0,50 | 0,52 | 0,50 |

Table Dx-11: Column factors JH HU
factors for "column" dowel pattern

| for | JH HU 140 | JH HU 180 | JH HU 200 | JH HU 260 | JH HU 320 | JH HU 380 | JH HU 440 | JH HU 500 | JH HU 560 | JH HU 620 |
|---------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| R _{1,Ht.k} | 0,47 | 0,51 | 0,51 | 0,54 | 0,56 | 0,57 | 0,59 | 0,61 | 0,62 | 0,64 |
| R _{4,Ht.k} | 0,78 | 0,76 | 0,73 | 0,64 | 0,62 | 0,64 | 0,62 | 0,61 | 0,61 | 0,60 |

column / partial connection

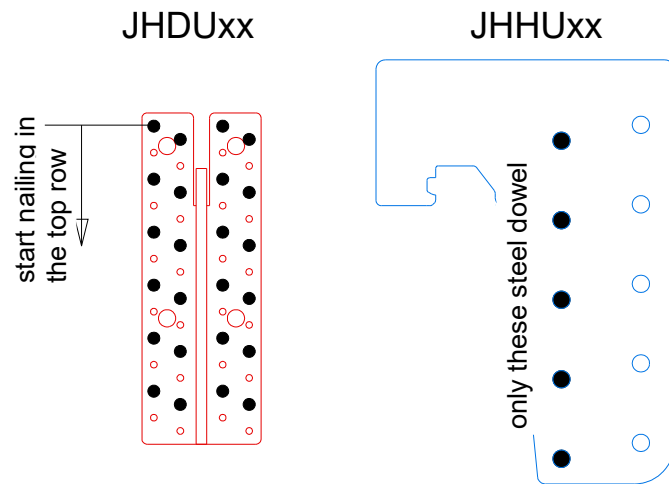

Connection to concrete / rigid support

Force direction F₁ / F₂

The anchorage has to have a capacity, to absorb the following described forces.

Download:

Each of the both upper bolts has to have a axial capacity of min:

$$R_{ax.bolt.d} \geq F_{1,d} \times 24mm / (e_{bolt} \times 2)$$

Uplift (only for connection with minimum 4 bolts):

Both lower bolts have to have an axial capacity of min:

$$R_{ax.bolt.d} \geq F_{2,d} \times 64mm / (e_{bolt} \times 2)$$

Each of the bolts must have a lateral capacity of min:

$$R_{lat.bolt.d} \geq F_{1,d} / n_{bolt}$$



or

$$R_{lat.bolt.d} \geq F_{2,d} / n_{bolt}$$

with:

e_{bolt} = size A – 50mm

n_{bolt} = number of all bolts

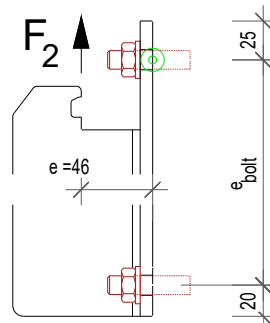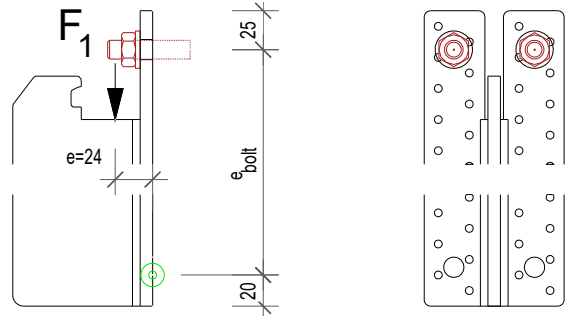

The limit for the axial force is given with 5,3 kN for each of the upper bolts, and a limit for the lateral force in each bolt with 30,0 kN.




The active force in the bolts can be determined also with software, e.g. anchor designer

Force direction F₄

The force in the upper bolts have to be calculate as following:

$$F_{upper.bolt.ax.d} = F_{4,d} \times a / ((a+b) \times 2)$$


The limit for the axial force is also given with 5,3 kN for each of the upper bolts.

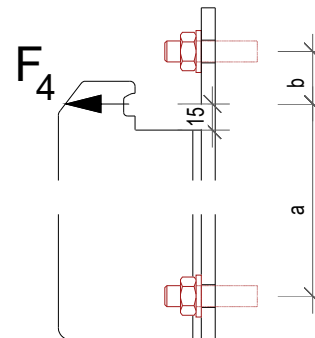

D13 ATFN

| | | | | |
|--------------|------|--------|----|---|
| Product Name | UK | France | DK | D |
| | ATFN | | | |

Drawings

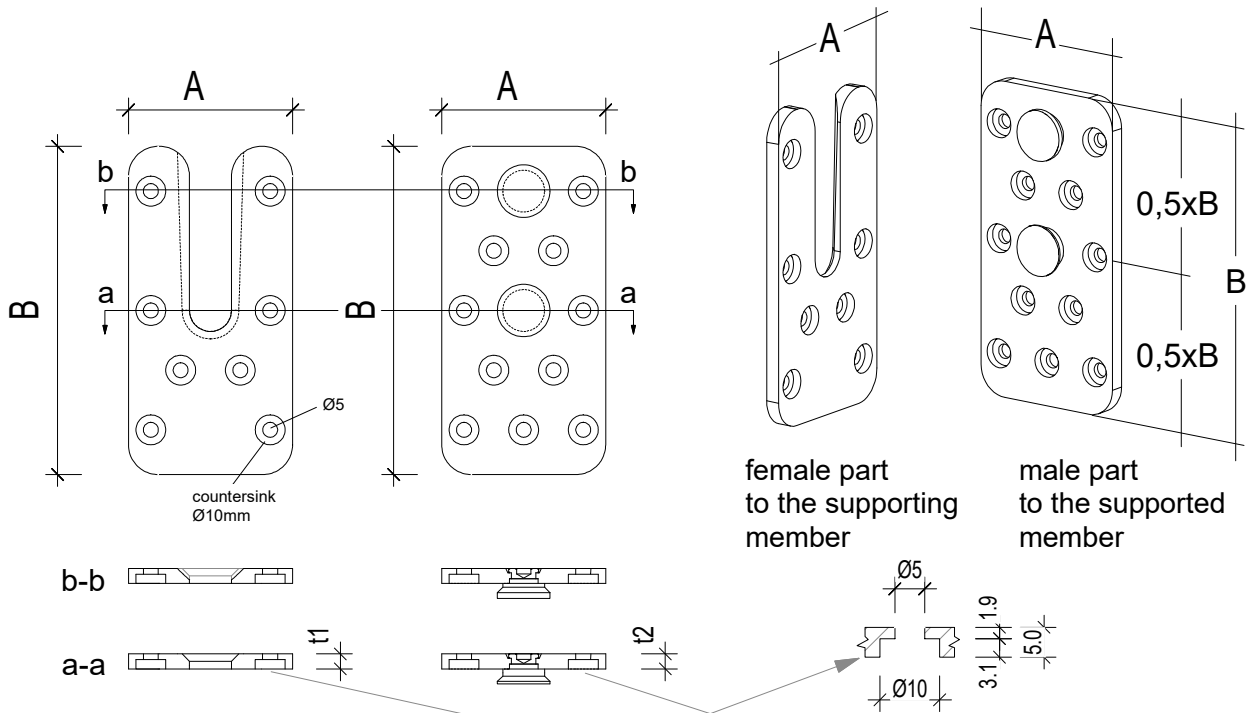

| type | dimension [mm] | | | | number of holes | |
|------------|----------------|-----|----|----|-----------------|-----------|
| | A | B | t1 | t2 | female part | male part |
| ATFN55/110 | 55 | 110 | 5 | 5 | 8 | 11 |
| ATFN55/150 | 55 | 150 | 5 | 5 | 11 | 15 |
| ATFN55/190 | 55 | 190 | 5 | 5 | 14 | 21 |
| ATFN75/150 | 75 | 150 | 5 | 5 | 17 | 22 |
| ATFN75/190 | 75 | 190 | 5 | 5 | 21 | 28 |

Material specification

Plates: S355MC according to EN10149 + -Fe/Zn12/A or Fe/Zn12/B acc. to EN 2081

Pins: steel with a minimum yield strength of 580N/mm² a minimum tensile strength of 610 N/mm² and a minimum ultimate strain of 16%. The pins are connected with the plates by compression strain

Connection to the supporting member: CNA-nails and CSA-screws according to ETA04/0013

Connection to the supported member: CSA-screws according to ETA04/0013

For installation for fire justification, see clause B6

Characteristic capacities

For connection, where the header is prevented for rotation:

$$R_{1,k} = \min (R_{1,J,k} ; R_{1,H,k})$$

$$R_{3,k} = 0,5 \times R_{1,k}$$

$$R_{4,k} = 0,25 \times R_{1,k}$$

For connection, where the header is free to rotate:

$$R^e_{1,k} = \min (R^e_{1,J,k} ; R^e_{1,H,k})$$

$$R^e_{3,k} = 0,5 \times R^e_{1,k}$$

$$R^e_{4e,k} = 0,25 \times R^e_{1,k}$$

For load combination:

$$\left(\frac{F_{1,d}}{R_{1,d}} \right)^2 + \left(\frac{F_{3,d}}{R_{3,d}} \right)^2 + \left(\frac{F_{4,d}}{R_{4,d}} \right)^2 \leq 1,0$$

For $R^e_{i,d}$ correspondingly

Where:


$$R_{1,J,k} = \min \begin{cases} 240 \times f_{h,J,k} \left[\sqrt{2 + \frac{1,84}{f_{h,J,k}}} - 1 \right] + 2 \times \rho_{k,J}^{0,8} \\ 375 \sqrt{f_{h,J,k}} + 2 \times \rho_{k,J}^{0,8} \\ 240 \times f_{h,J,k} \end{cases}$$

$$R_{1,H,k} = \frac{1}{\sqrt{\left(\frac{1}{n_H \times R_{lat,H,k}} \right)^2 + \left(\frac{10 \times z_{max,H}}{I_{p,H} \times R_{ax,H,k}} \right)^2}}$$

$$R^e_{1,J,k} = \frac{1}{\sqrt{\left(\frac{1}{R_{1,J,k}} \right)^2 + \left(\frac{e_J \times z_{max,J}}{I_{p,J} \times 7,5 \times \rho_{k,J}} \right)^2}}$$

$$R^e_{1.H.k} = \frac{1}{\sqrt{\left(\frac{1}{n_H \times R_{lat.H.k}}\right)^2 + \left(\frac{e_H \times z_{max.H}}{I_{p.H} \times R_{ax.H.k}}\right)^2}}$$

- n_J number of screws in the joist
- n_H number of screws/nails in the header/column
- $f_{h.J.k}$ joist embedding strength in N/mm²; $f_{h.J.k} = 0,0047 * \rho_{k.J}^{1.24}$
- $\rho_{k.J}$ characteristic density of joist in kg/m³; $\rho_{k.J} \leq 460 \text{ kg/m}^3$
- $R_{lat.H.k}$ the characteristic lateral capacity of the fastener in the header
- $R_{lat.J.k}$ the characteristic lateral capacity of the fastener in the joist
- $R_{ax.H.k}$ the characteristic axial capacity of the fastener in the header
- $R_{ax.J.k}$ the characteristic axial capacity of the fastener in the joist
- e_J eccentricity of the joist connection in mm , generally $e_J = 0,5 B_H + 10 \text{ mm}$
- e_H eccentricity of the header connection in mm; generally $e_H = 0,5 B_H$
- B_H header width in mm

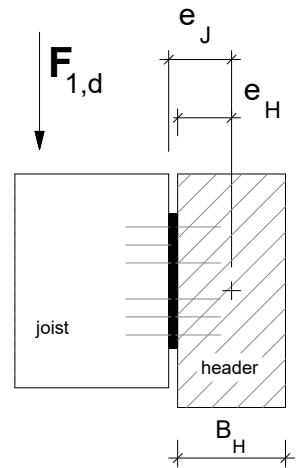

| type | $I_{p.H} / z_{max.H}$ | $I_{p.J} / z_{max.J}$ |
|------------|-----------------------|-----------------------|
| ATFN55/110 | 156 | 260 |
| ATFN55/150 | 286 | 474 |
| ATFN55/190 | 436 | 752 |
| ATFN75/150 | 424 | 619 |
| ATFN75/190 | 910 | 1000 |